
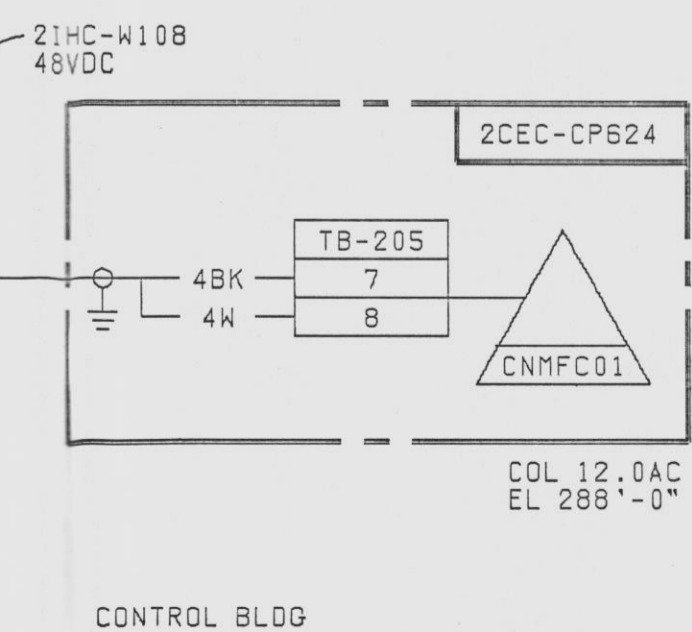
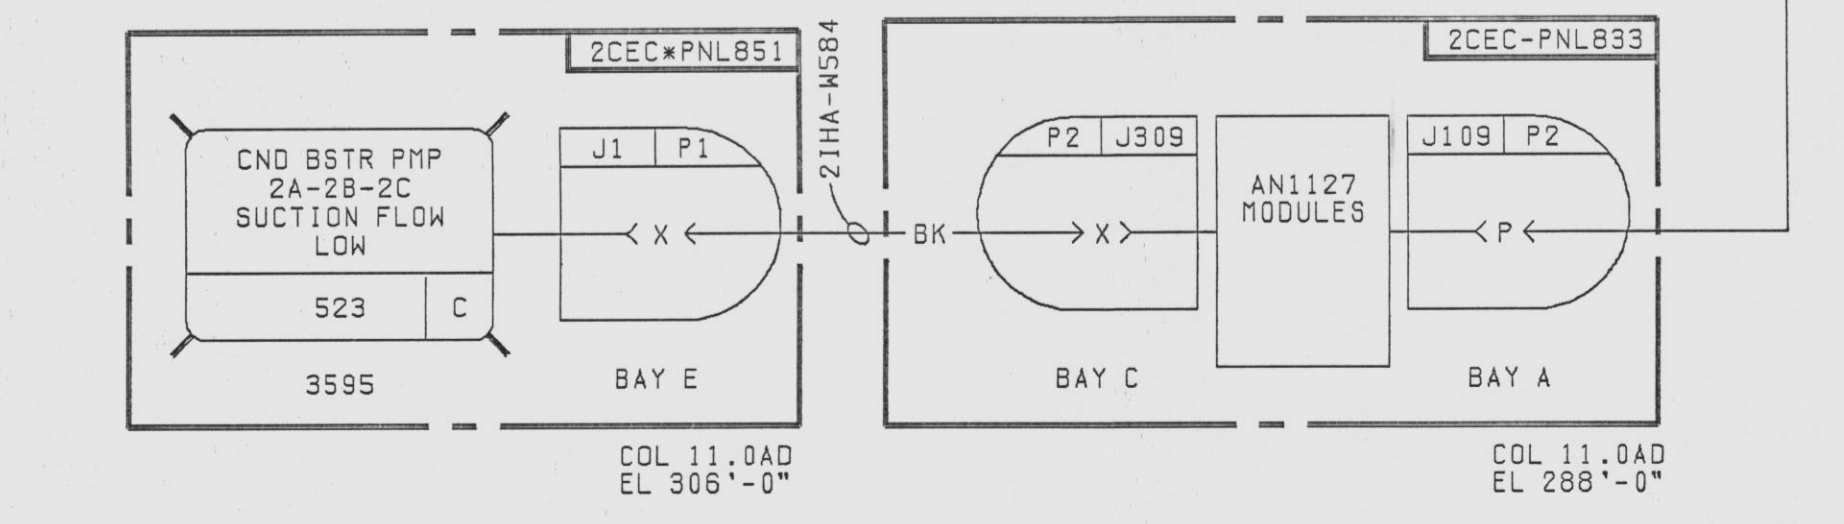
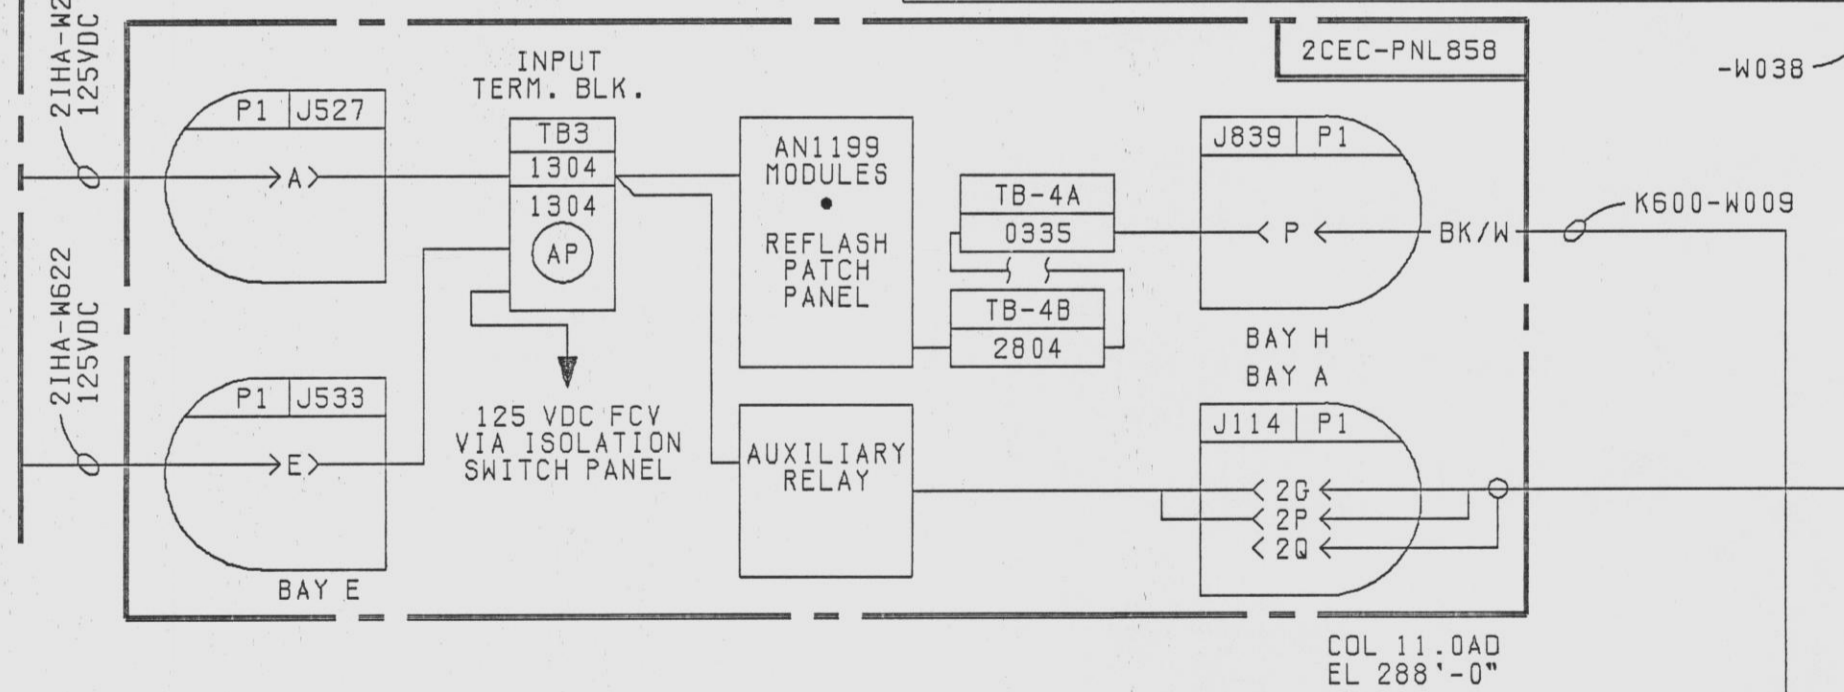


CONTINUED FROM SHEET 1

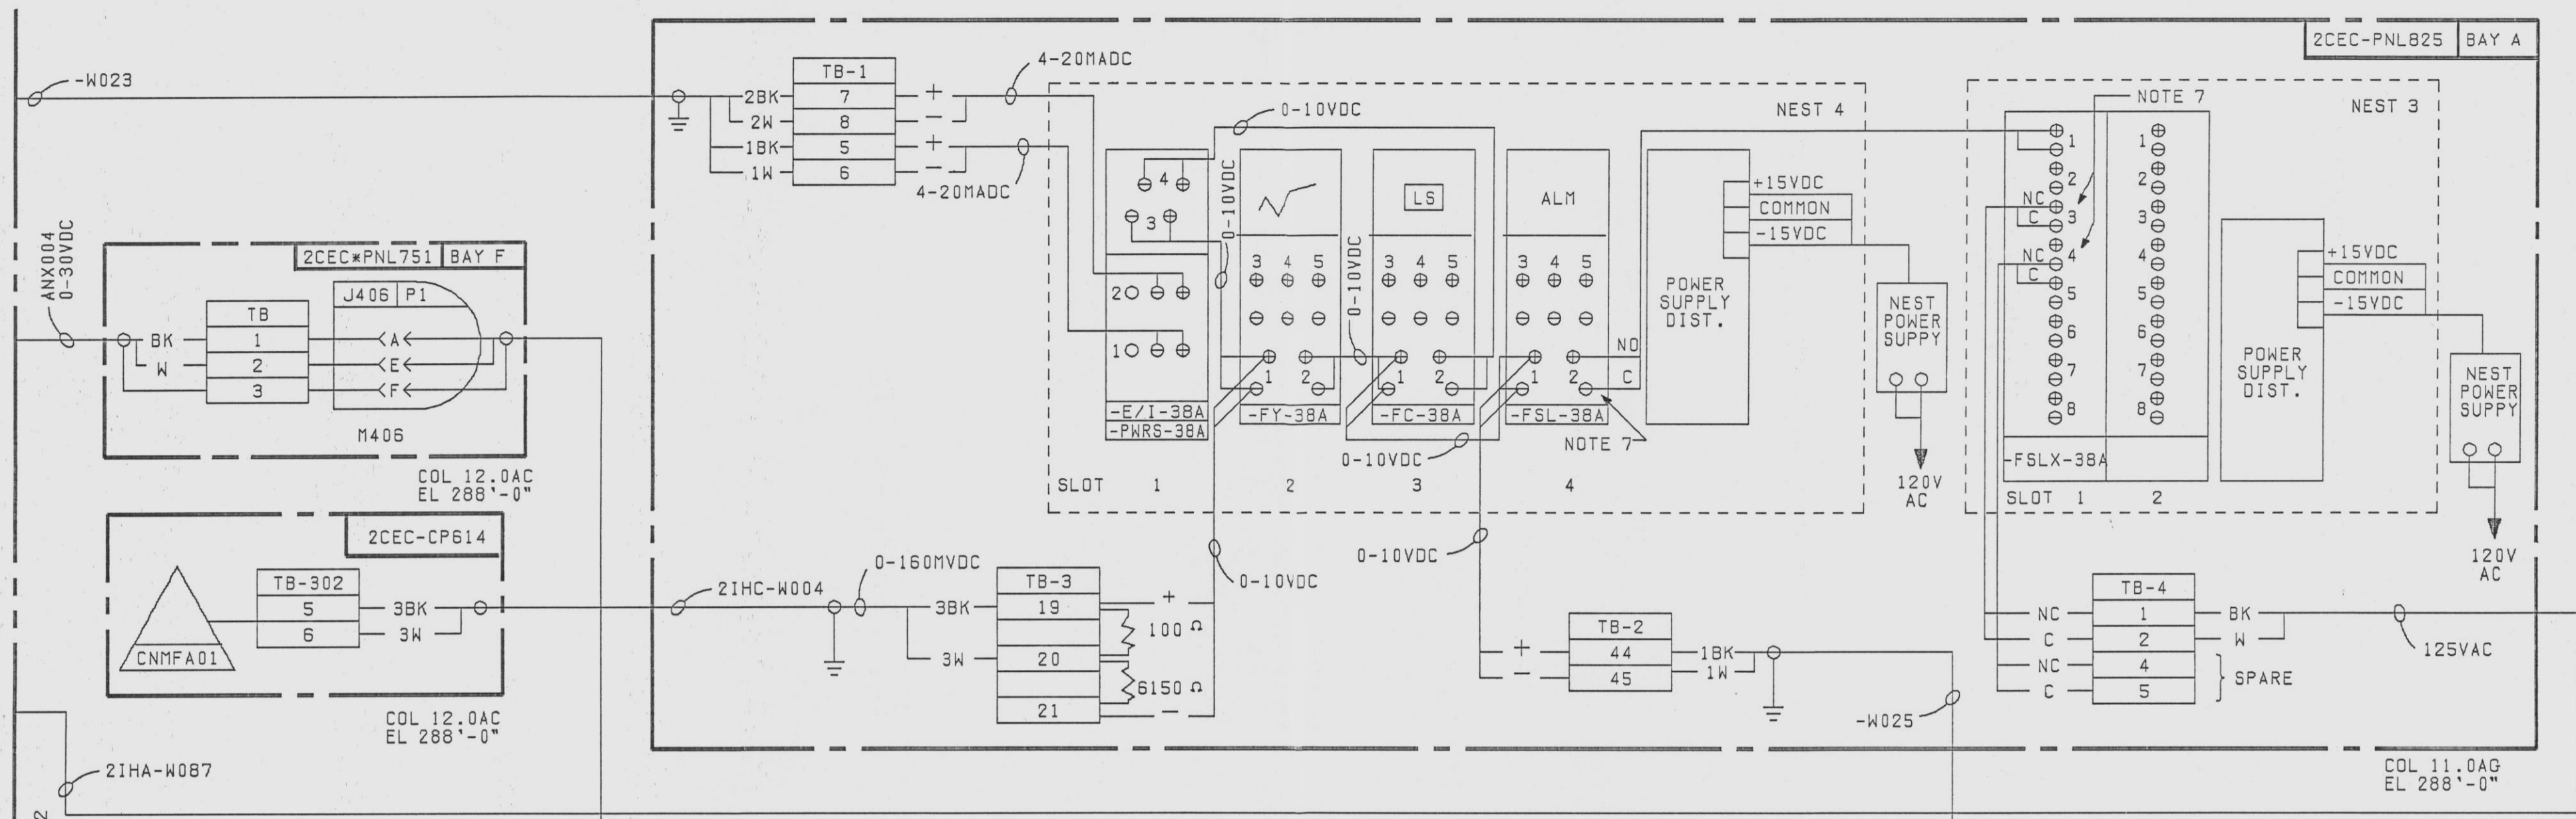

SI
APERTURE
CARD

QA CAT II

TEST LOOP DIAGRAM
CONDENSATE BOOSTER PUMP P2A SUCT FLOW
2CNM-FT-38A, -FV-38A

NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

SHEET 2 OF 2

12177-TL2CNM-075



9305050035 D 9305050035