


STONE & WEBSTER ENGINEERING CORPORATION

CLG TWR BASIN WTR TEMP

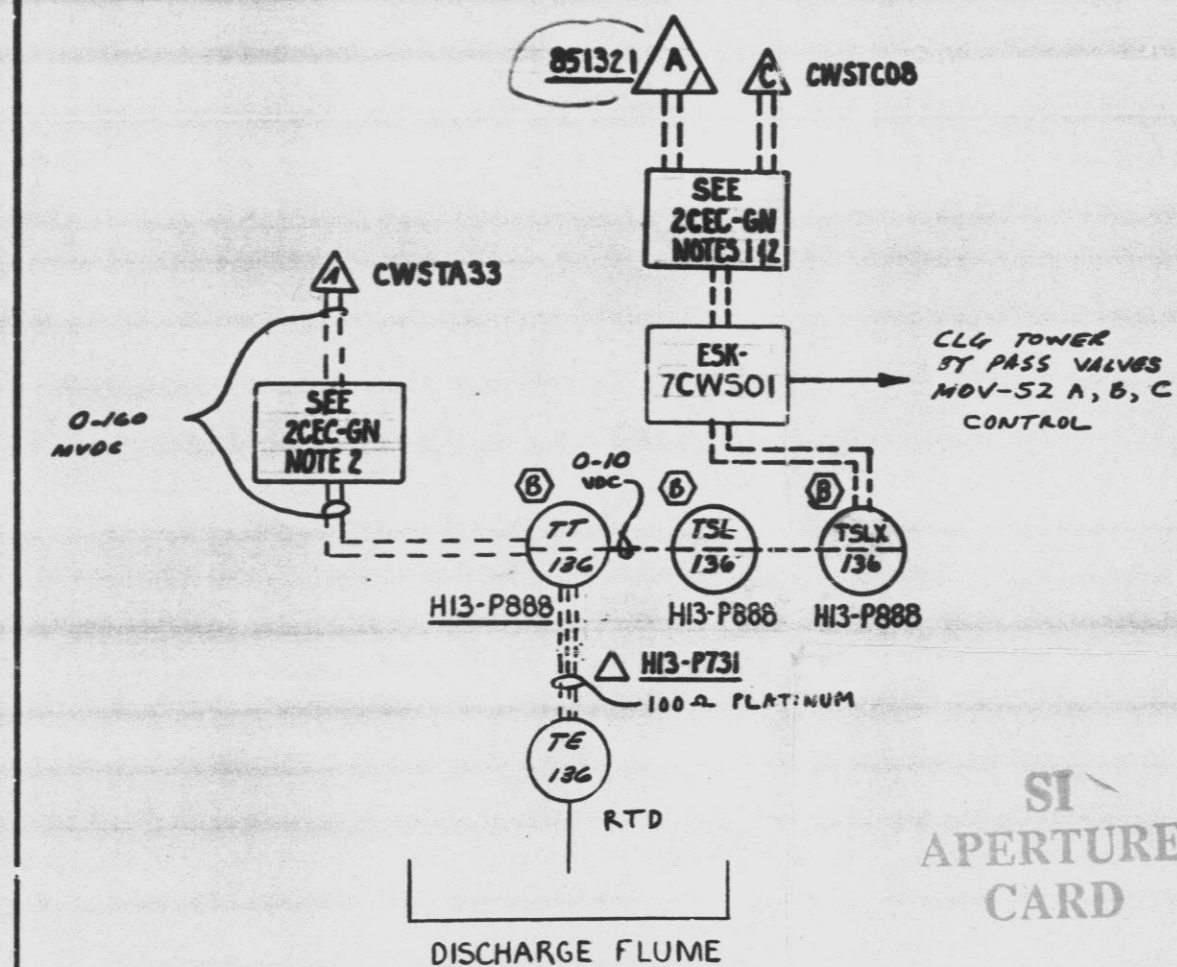

NOTE:  
1. TE 136 TO BE SUPPLIED WITH 25 FOOT ARMORED SHEATH.

SI APERTURE CARD

REF: LSK-2-1.1E  
QA CAT II

			DCI 2	DCI		
			10/8/82	12/16/80		
			MECH-DGS	MPR		
5	4	3	PSM	2		
			CHH			

CIRCULATING WATER SYSTEM  
NIAGARA MOHAWK POWER CORPORATION  
NINE MILE POINT NUCLEAR STATION  
UNIT 2

REF DWG FSK-2-1D  
J.O.12177  
LOOP DIAGRAM  
2CWS-136

9305060133 D