


STONE & WEBSTER ENGINEERING CORPORATION

CLG TWR BASIN WTR TEMP

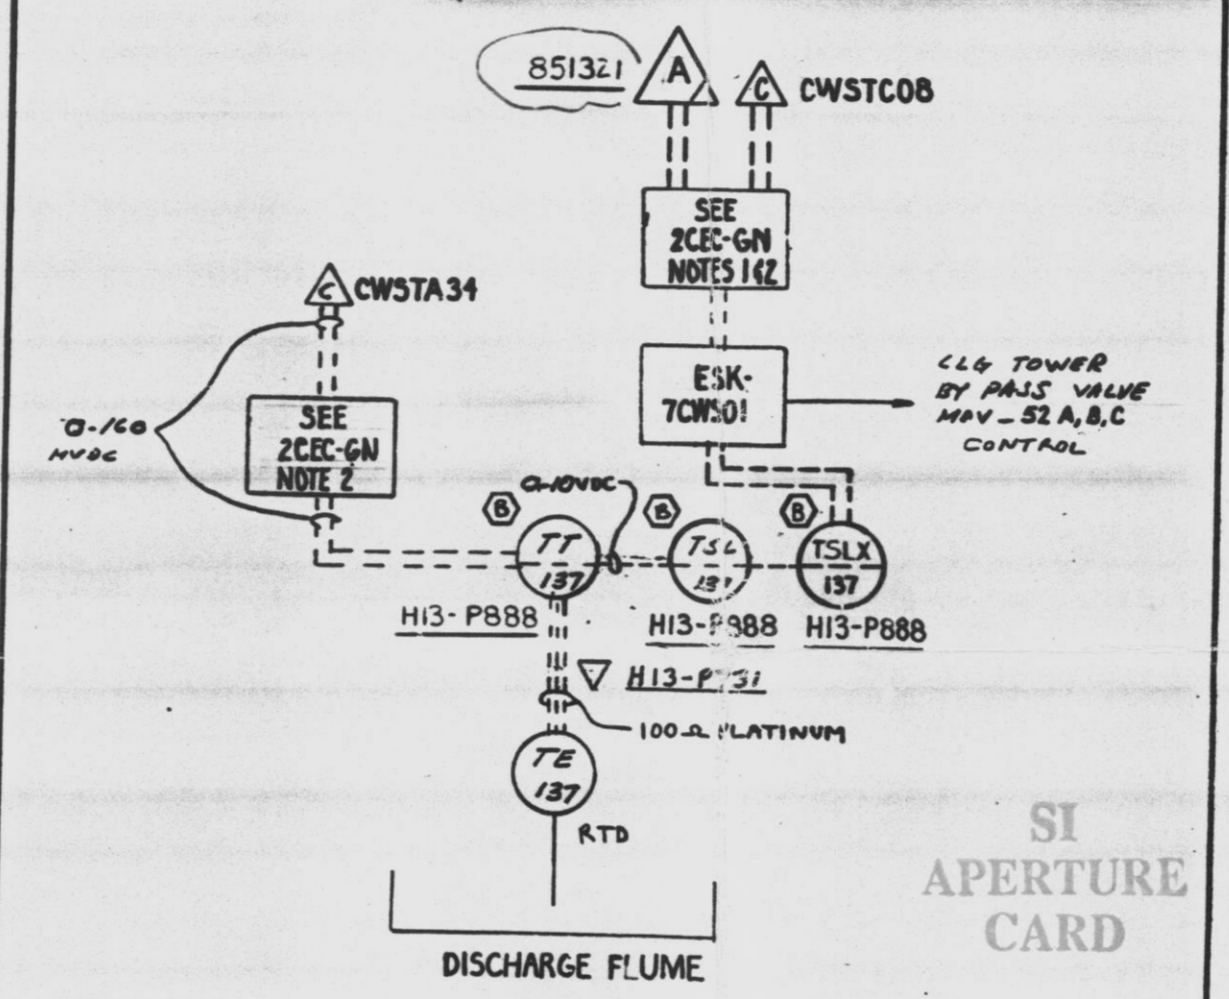

NOTE:
1. TE 137 TO BE SUPPLIED WITH 2 1/2-FOOT ARMORED SHEATH.

SI APERTURE CARD

REF: LSK-2-1.1E
QA CAT II

			DCI 2	DCI		
			10/18/82	12/1/82		
5	4	3	MECH-005	3B	2	
				SH		

CIRCULATING WATER SYSTEM
NIAGARA MOHAWK POWER CORPORATION
NINE MILE POINT NUCLEAR STATION
UNIT 2

REF DWG FSK-2-1D
J.O. 12177
LOOP DIAGRAM
2CWS-137

9305060139 D

9305060139