


INFORMATION ONLY

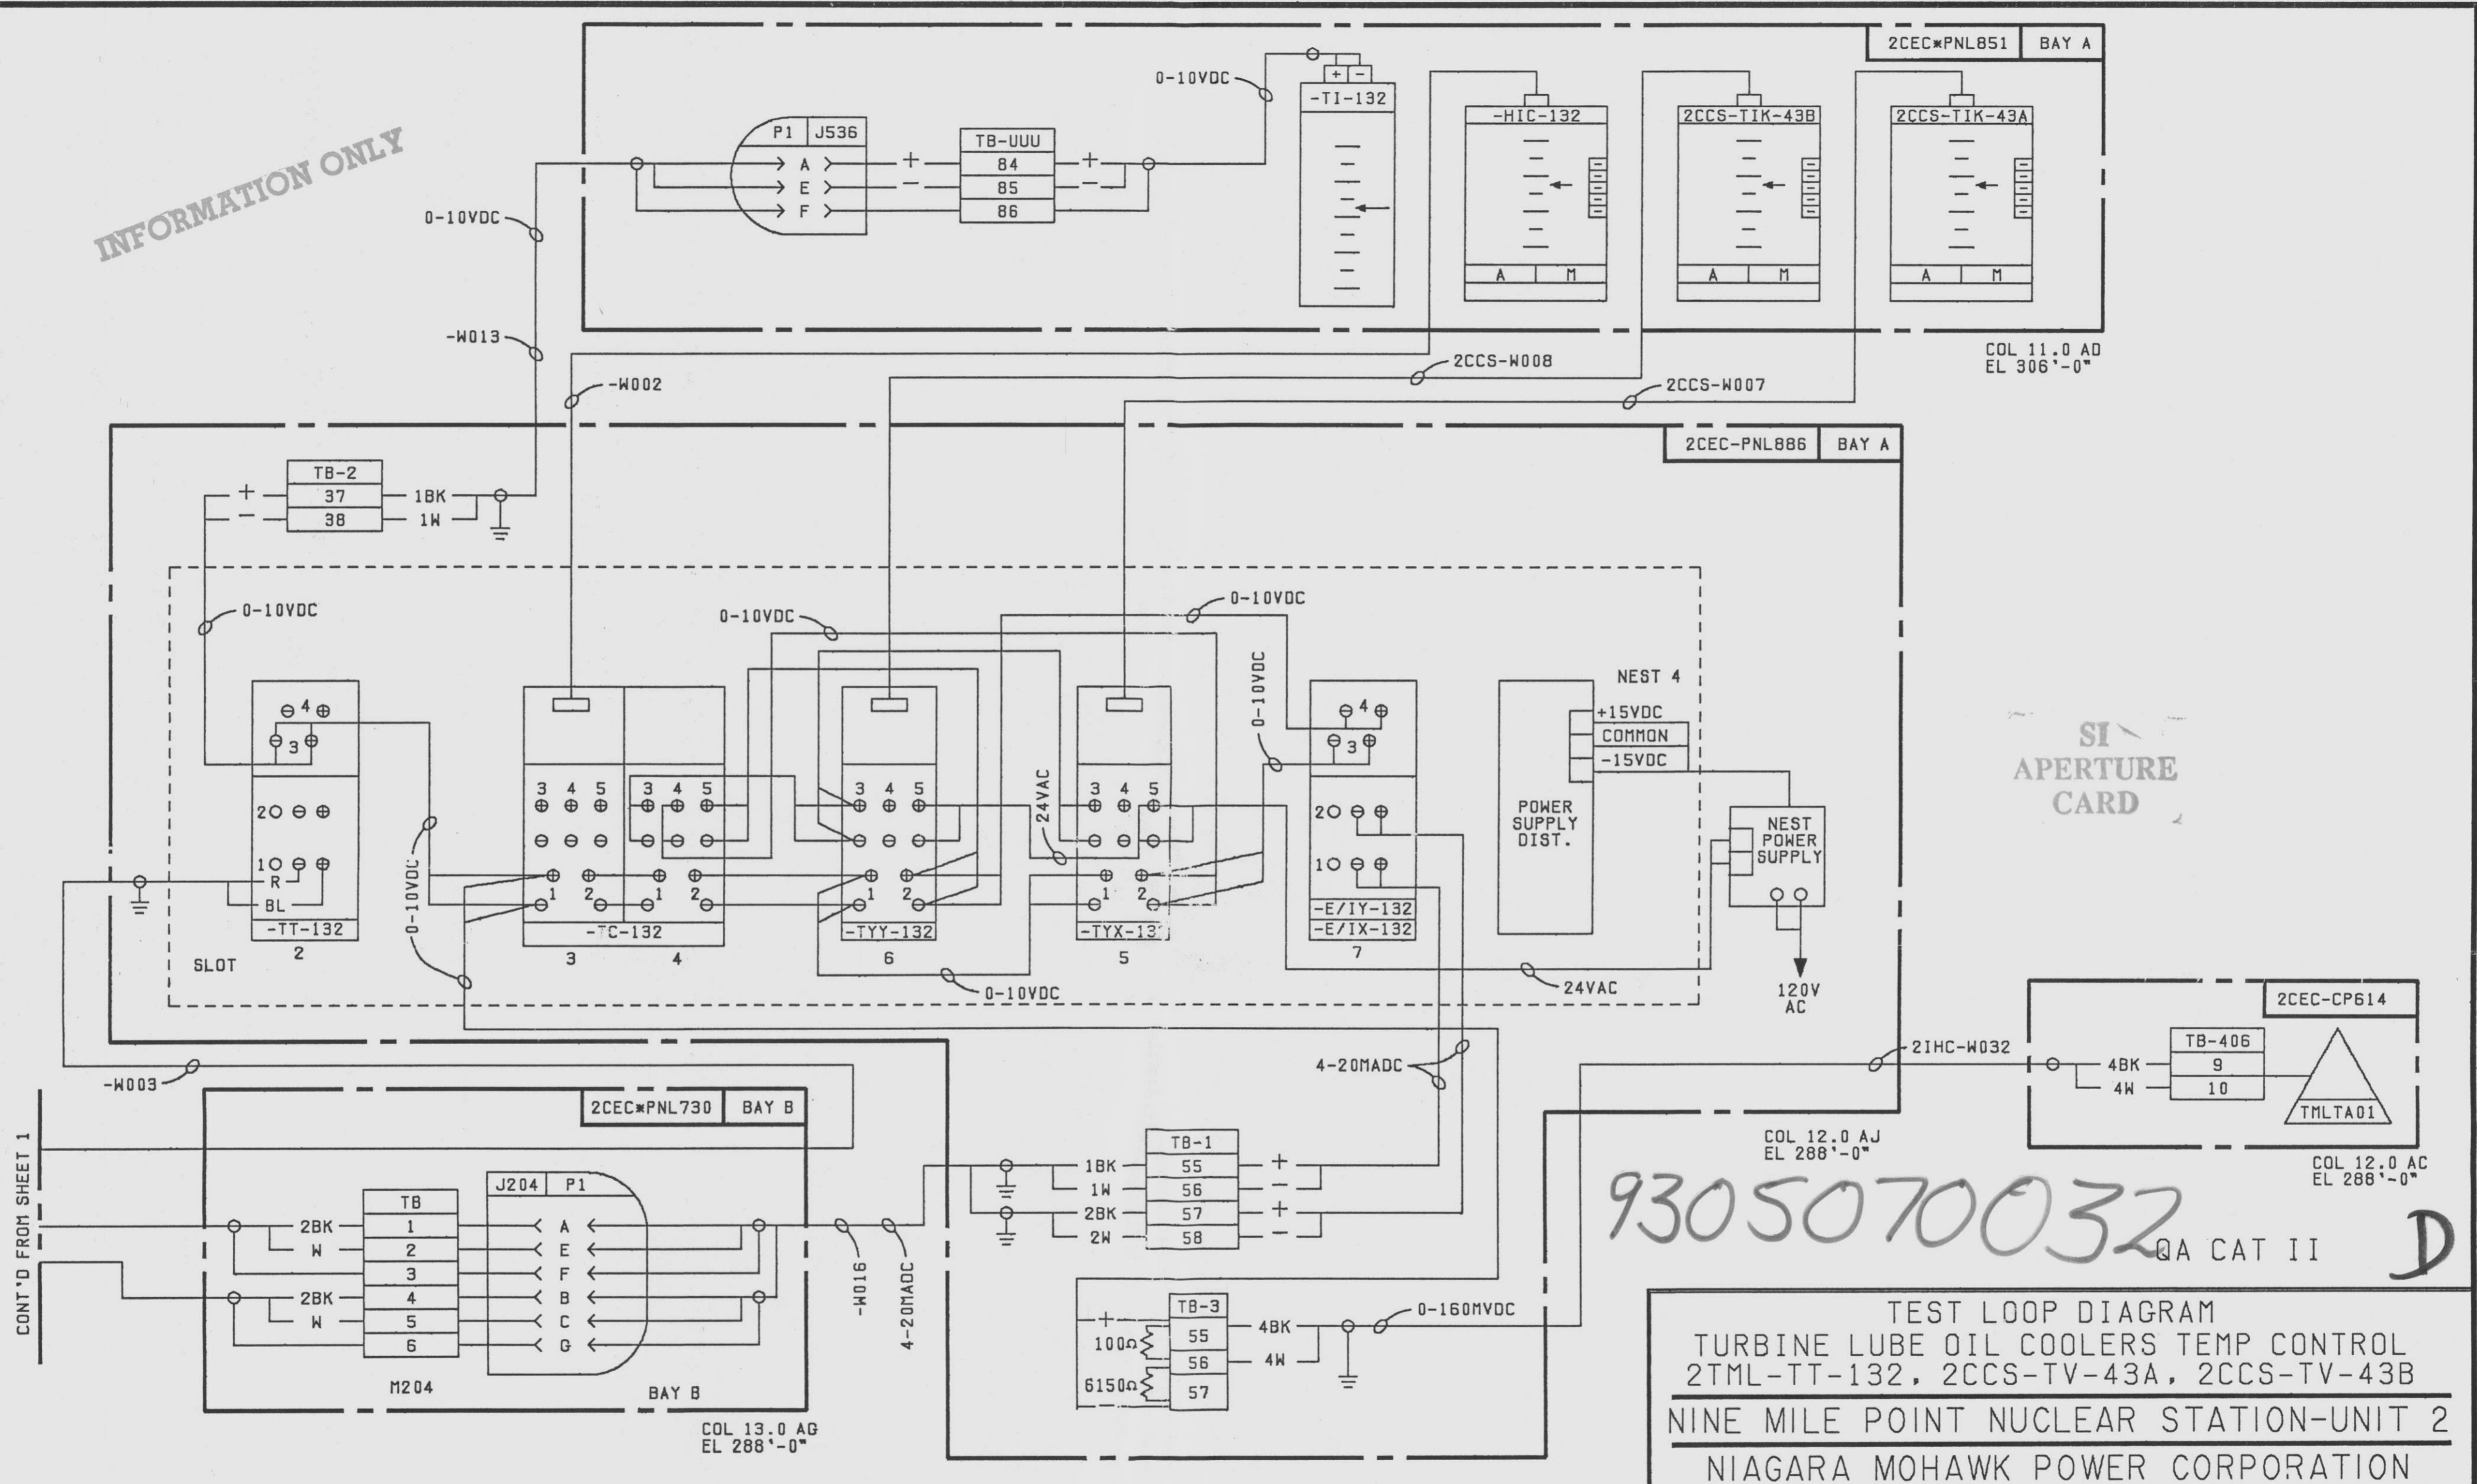

9305070032

QA CAT II

D

TEST LOOP DIAGRAM
 TURBINE LUBE OIL COOLERS TEMP CONTROL
 2TML-TT-132, 2CCS-TV-43A, 2CCS-TV-43B
 NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

SHEET 2 OF 2

12177-TL2TML-003

4	DATE PREPARED	3	DATE PREPARED	2	DATE PREPARED	1	DATE PREPARED	0	DATE PREPARED
	APPROVED		APPROVED		APPROVED		APPROVED		APPROVED



9305070032