


FOR INFORMATION ONLY

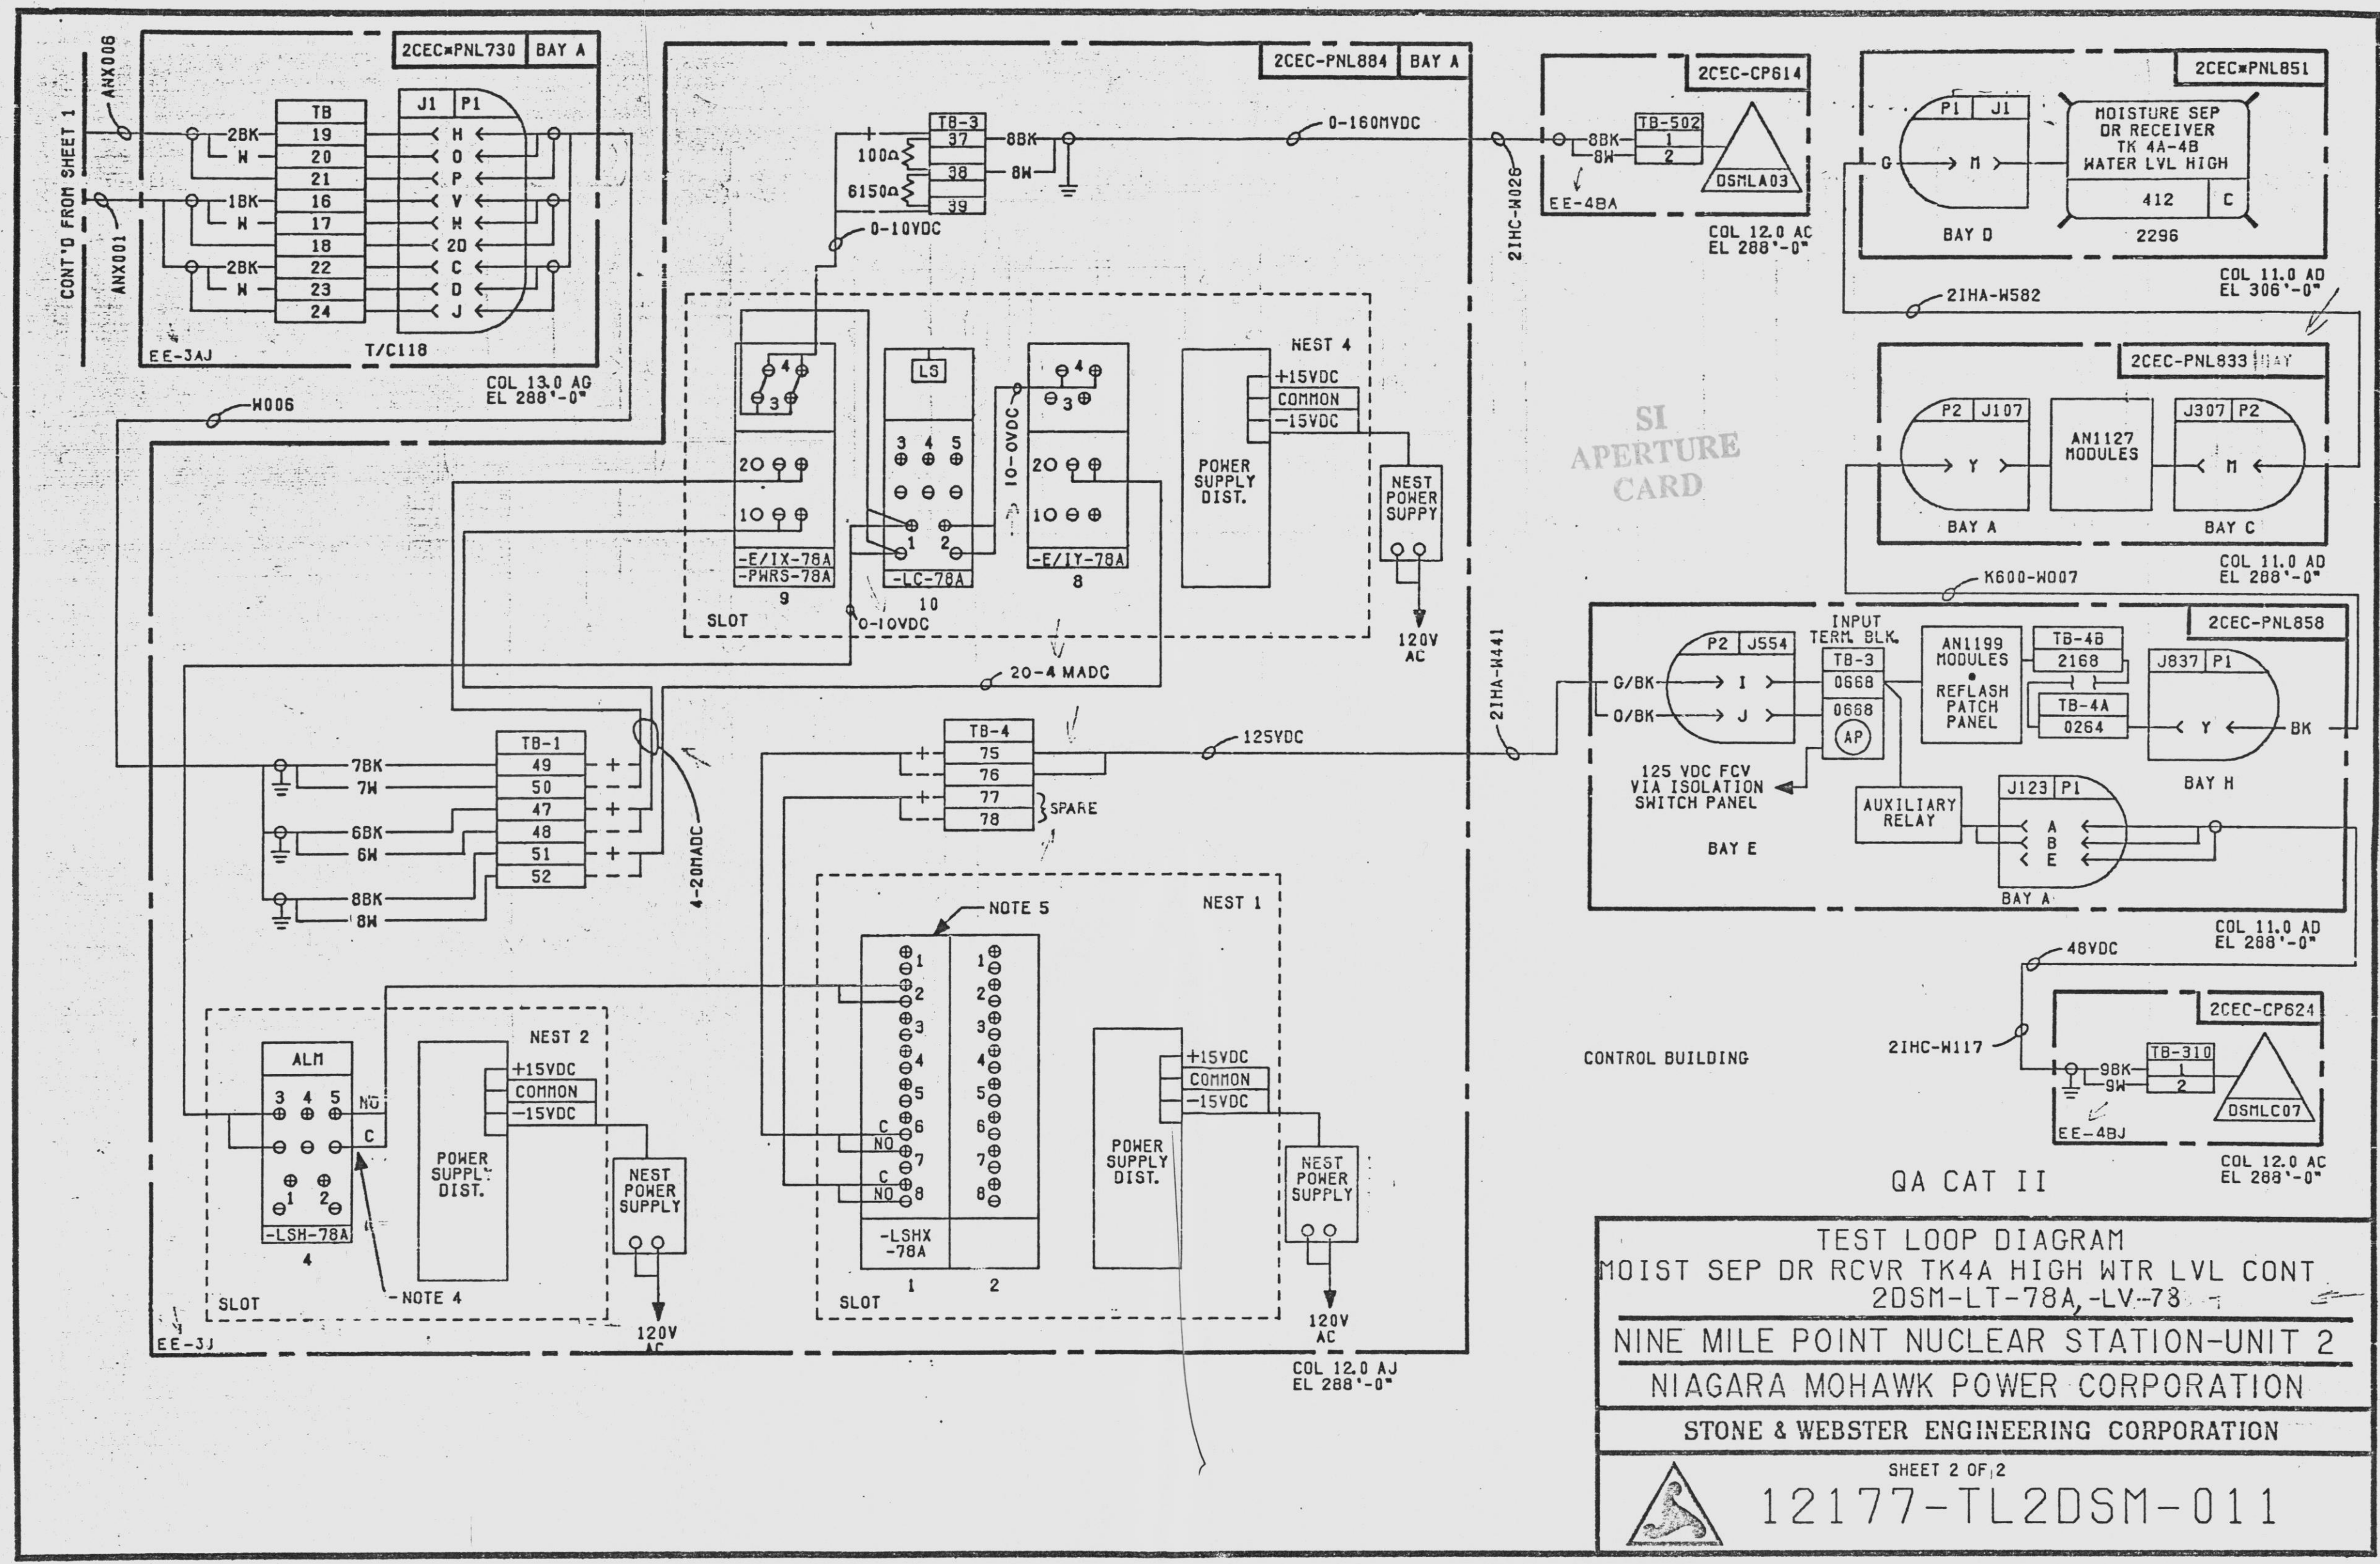

TEST LOOP DIAGRAM
 MOIST SEP DR RCVR TK4A HIGH WTR LVL CONT
 2DSM-LT-78A, -LV-78

NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

SHEET 2 OF 2
 12177-TL2DSM-011

INFORMATION ONLY

9305070309 D