


CONTINUED FROM SHEET 1

CONTINUED ON SHEET 3

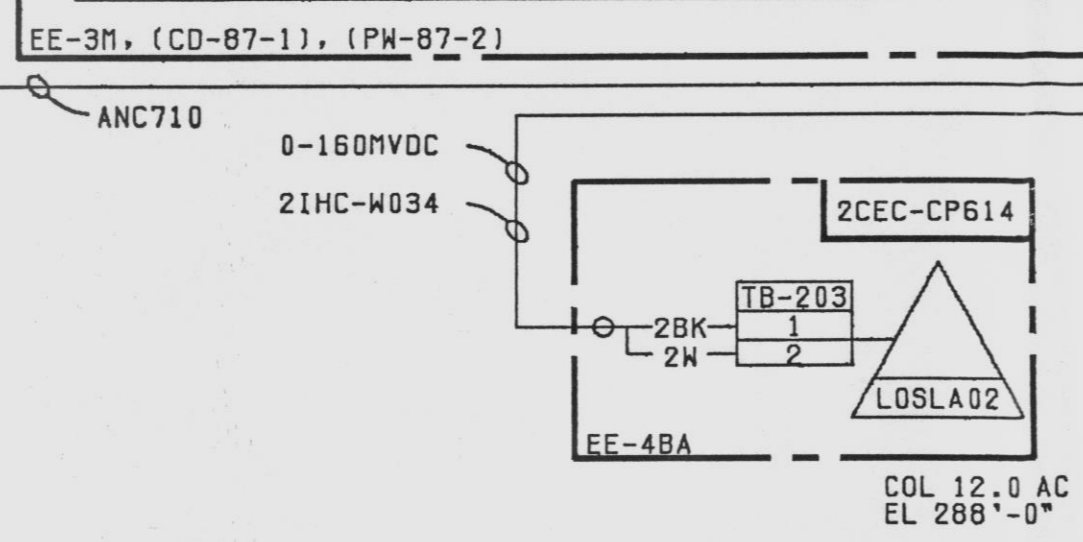

INFORMATION ONLY

QA CAT II  
9305/00025

TEST LOOP DIAGRAM  
 DIRTY OIL STORAGE TANK TK2 LEVEL  
 2LOS-LIT-126  
 NINE MILE POINT NUCLEAR STATION-UNIT 2  
 NIAGARA MOHAWK POWER CORPORATION  
 STONE & WEBSTER ENGINEERING CORPORATION

SHEET 2 OF 3  
 12177-TL2LOS-001



9305/00025  
 D