


07-409-91

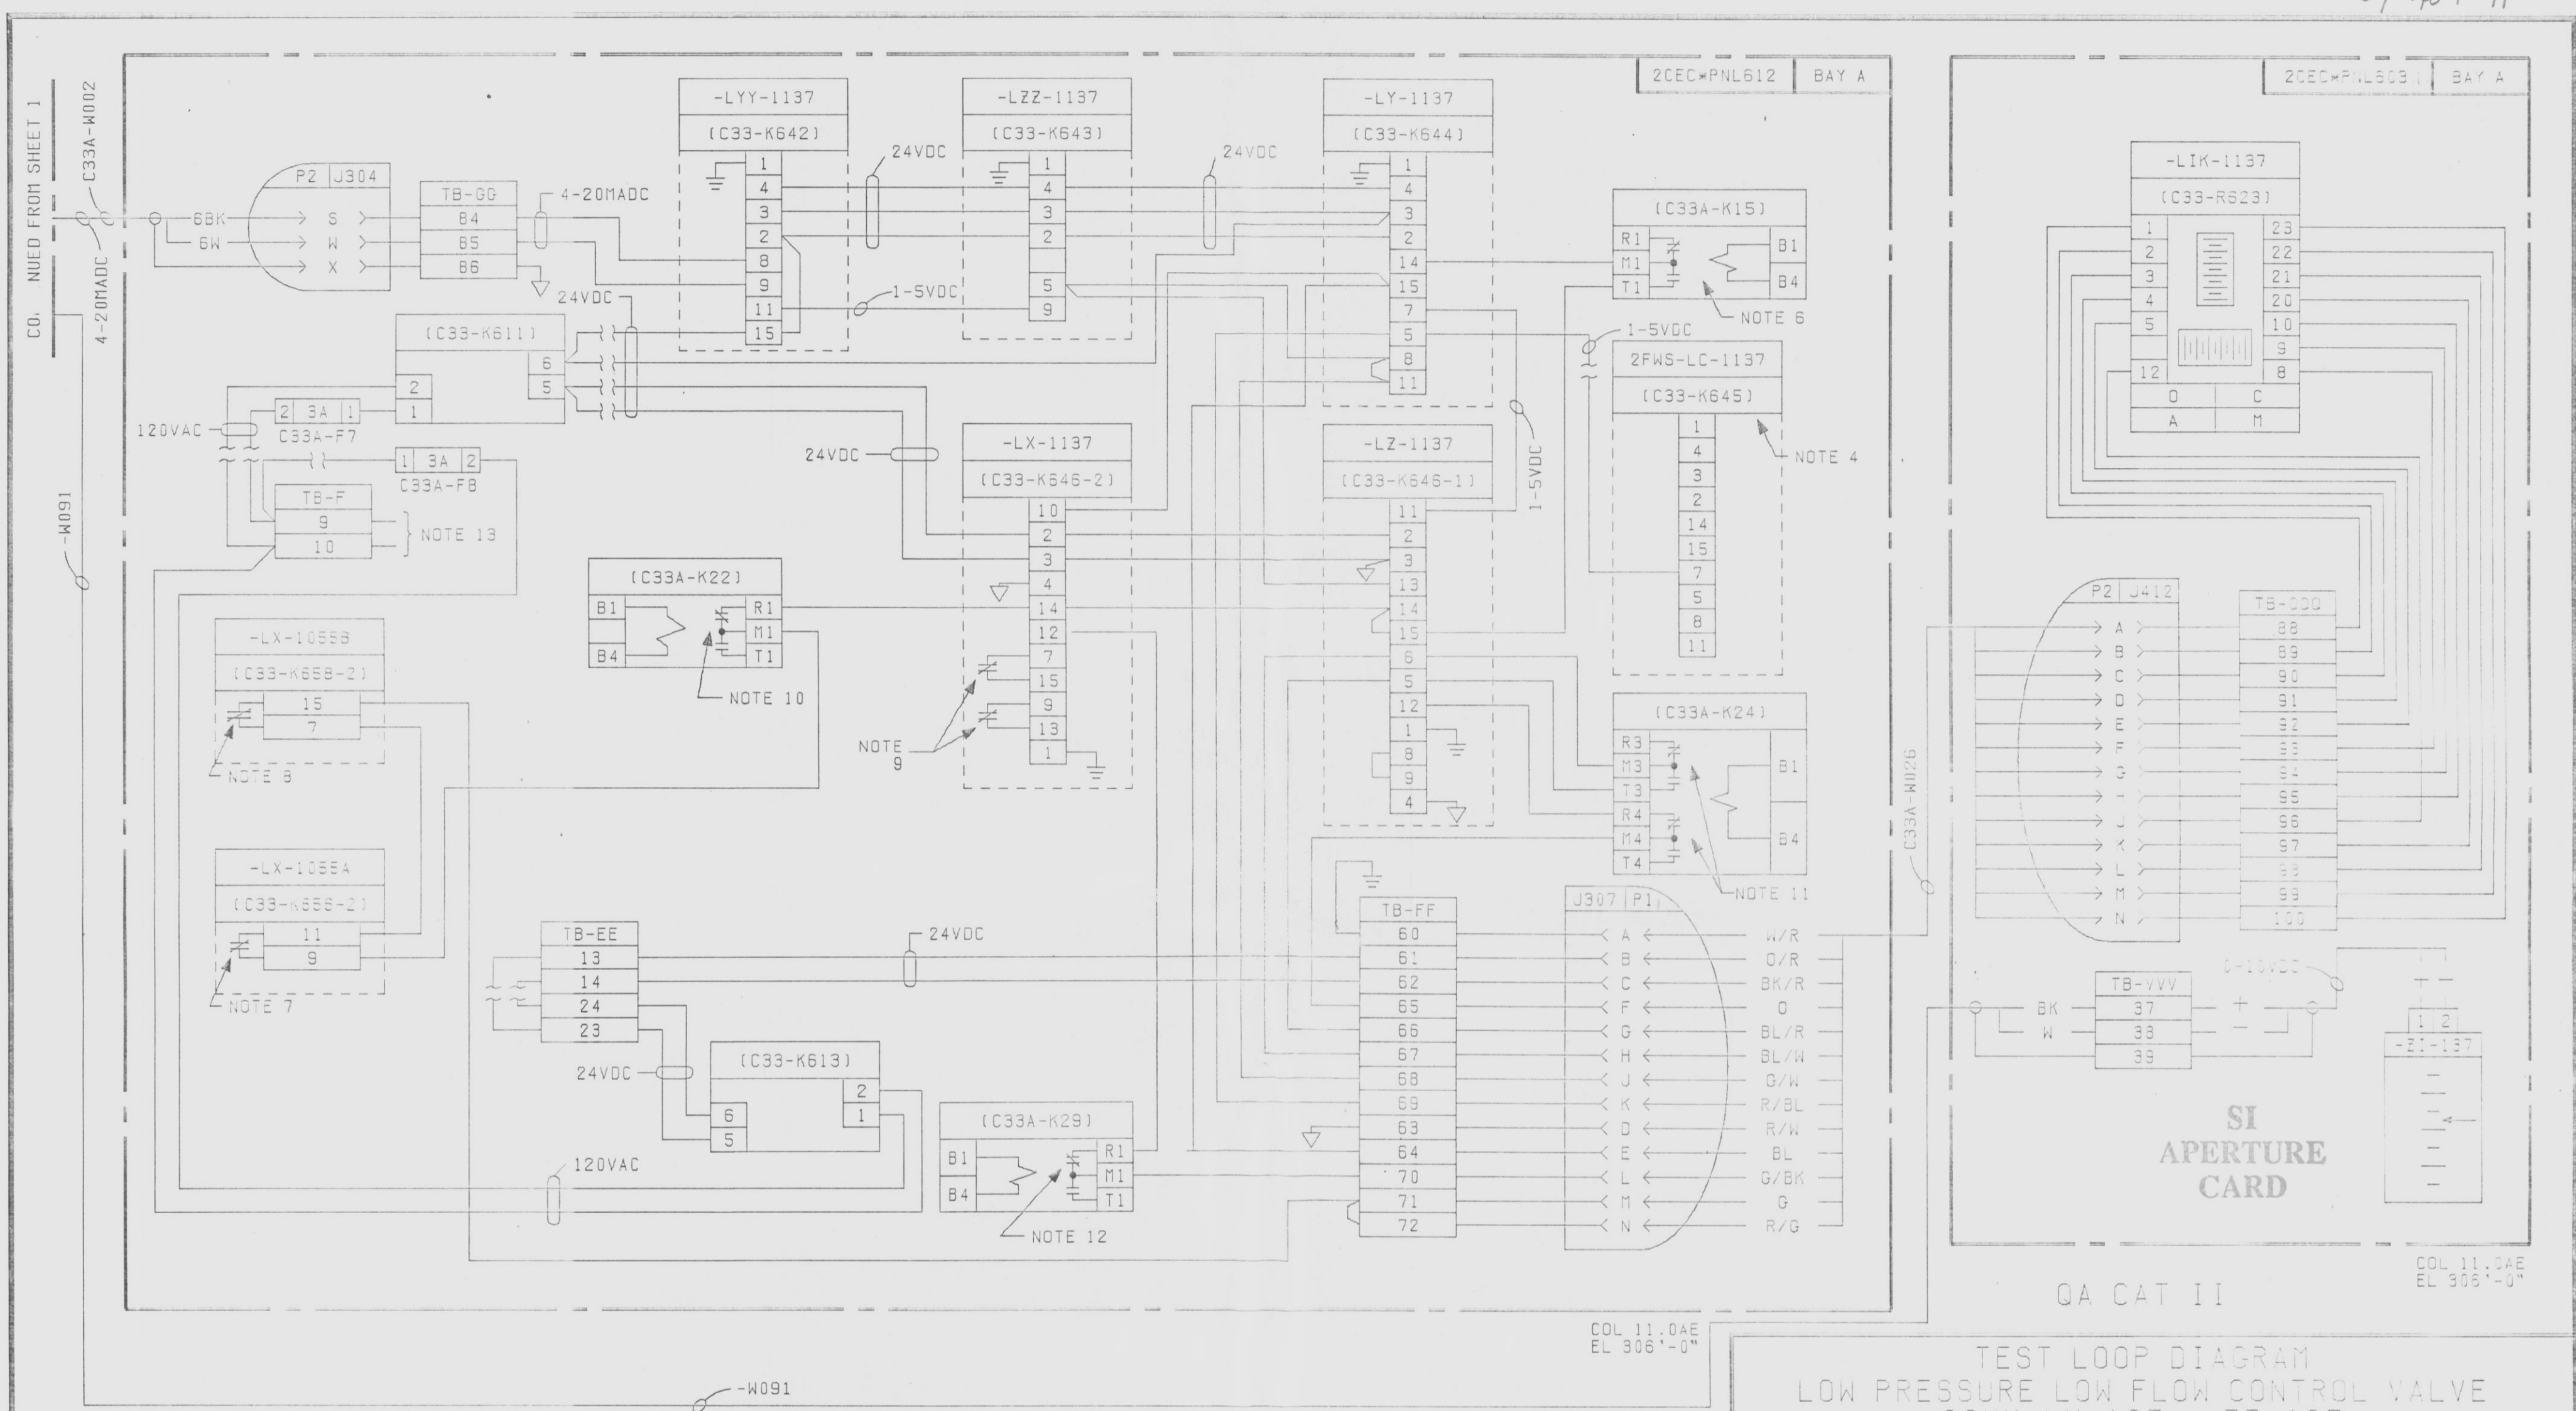

CONTROL BUILDING

QA CAT II

COL 11:0AE
EL 306'-0"

COL 11:0AE
EL 306'-0"

INFORMATION ONLY

TEST LOOP DIAGRAM
 LOW PRESSURE LOW FLOW CONTROL VALVE
 2CNM-LV-137, -ZT-137

NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION



SHEET 2 OF 2
 12.177-TL2CNM-157

9305100143 D