07-414-91

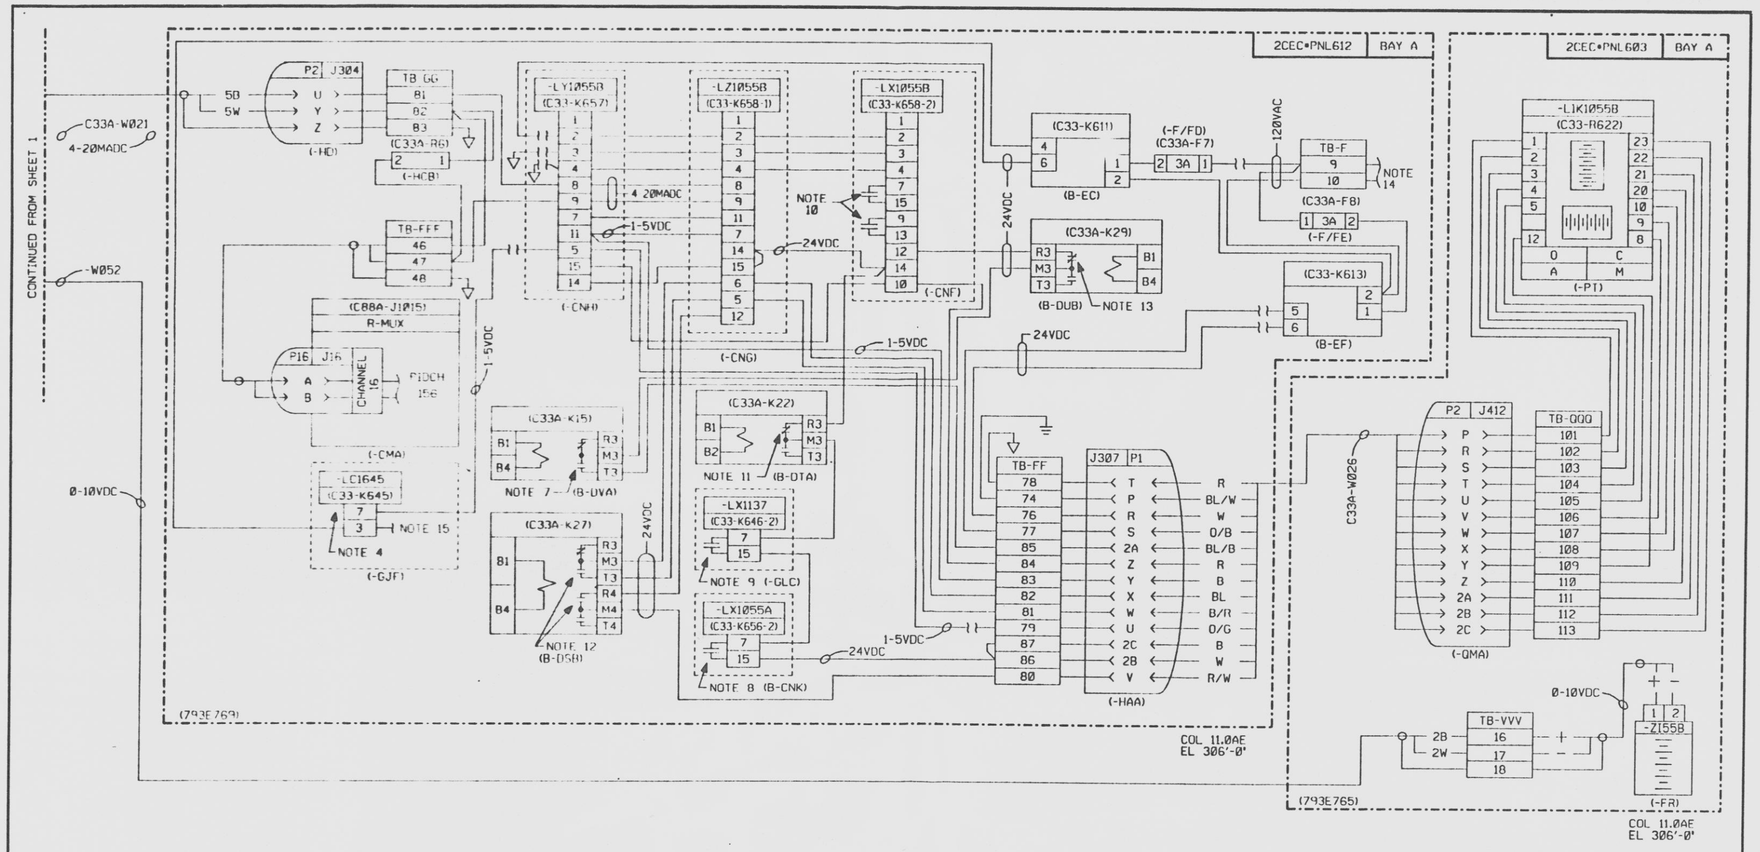

QA CAT II

TEST LOOP DIAGRAM
HIGH PRESSURE LOW FLOW CONTROL VALVE
2FWS-LV55B, ZE55B

NINE MILE POINT NUCLEAR STATION-UNIT 2

NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

SHEET 2 OF 2

12177- TL2FWS-083

INFORMATION ONLY

SI APERTURE CARD

PLANT USE ONLY-PRINT APPROVAL

APPR.	APPR.	APPR.
DATE	DATE	DATE
I&C	SSS	CSO

NUCLEAR NON-SAFETY RELATED

NIAGARA MOHAWK

STA. NINE MILE POINT NUCLEAR STATION UNIT NO.2

ACC NO

TEST LOOP DIAGRAM
HIGH PRESSURE LOW FLOW CONTROL VALVE
2FWS-LV55B, ZE55B

DATE 10/9/89

SCALE NONE

DWG NO TL2FWS-083 SH.2 OF 2

MK	DATE	BY	MF	DESCRIPTION	CK	APP
1	10/9/89	JBP		ORIGINAL ISSUE-		

9305100172 D