


EE-3WA, 0007.222-001-020

SI APERTURE CARD

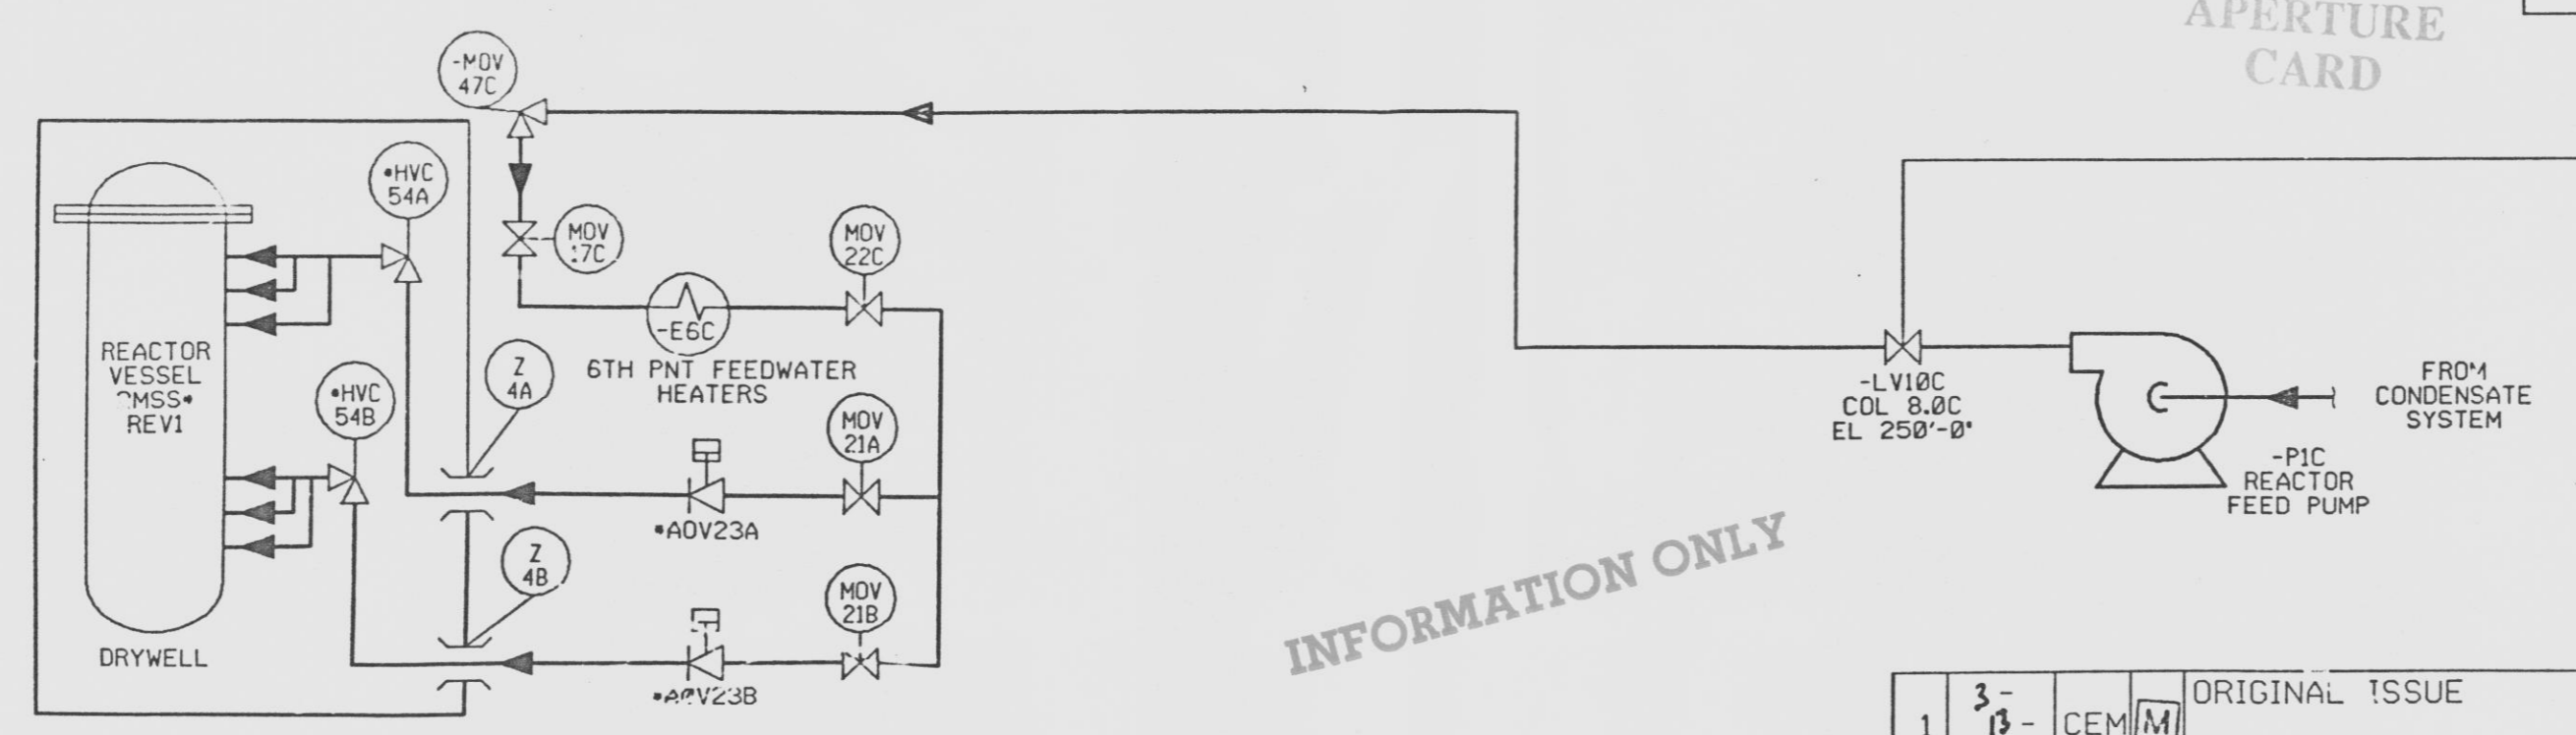

INFORMATION ONLY

PLANT USE ONLY - PRINT APPROVAL

DATE	DATE	DATE
I&C	SSS	CSO

NUCLEAR NON-SAFETY RELATED

NIAGARA MOHAWK NINE MILE POINT NUCLEAR STATION - UNIT 2 SCRIBA, N.Y.

TEST LOOP DIAGRAM
MAIN FEEDWATER CONTROL VALVE
2FWS-LV10C

SCALE	DRAWING NO.
NONE	TL2FWS-089 54.2 OF 4

1	3-13-91	CEM	M	ORIGINAL ISSUE	
MK	DATE	BY	MF	DESCRIPTION	CK APP

9305100189 D

CONTINUED ON SHEET 3

NOTE THIS DRAWING WAS REVISED USING THE FOLLOWING REVISIONS:

C

B

A

1 5 10

A

B

C