


CONTINUED FROM SHEET 3

CNX008

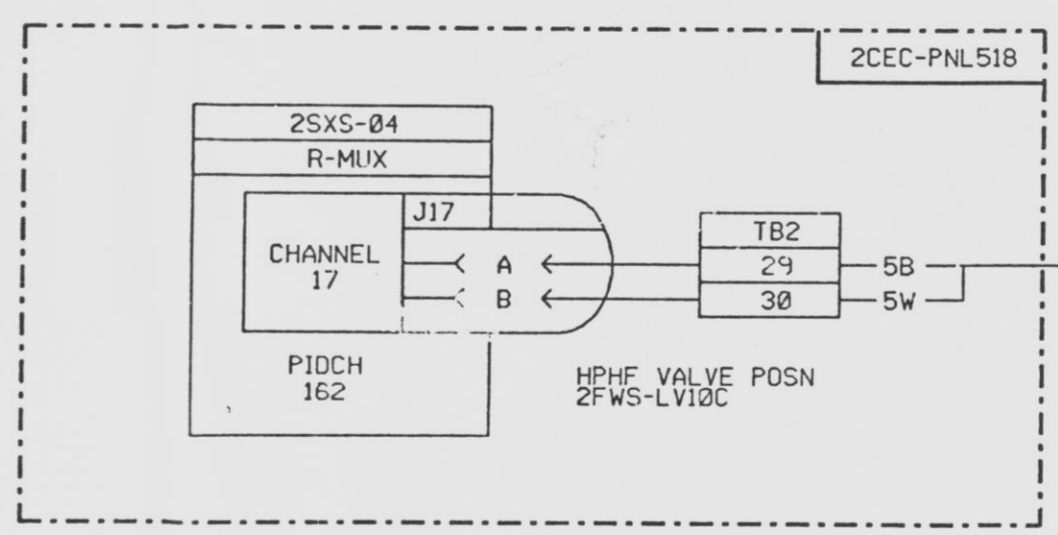

SI APERTURE CARD

PLANT USE ONLY - PRINT APPROVAL

APPR.	DATE	APPR.	DATE	APPR.	DATE
I&C		SSS		CSO	

CONTROL BUILDING

INFORMATION ONLY

NUCLEAR NON-SAFETY RELATED

NIAGARA MOHAWK NINE MILE POINT NUCLEAR STATION - UNIT 2 SCRIBA, N.Y.

TEST LOOP DIAGRAM
MAIN FEEDWATER CONTROL VALVE
2FWS-LV10C

SCALE	DRAWING NO.	SH. 4 OF 4
NONE	TL2FWS-089	

1	3-13-91	CEM	M	ORIGINAL ISSUE	
DATE	BY	MF	DESCRIPTION	CK	APP

930510.0194 D

NOTE: THIS DRAWING WAS PREPARED USING COMPUTER AIDED DRAUGHTING. DO NOT MAKE LOCAL CHANGES.