

50-220/410  
Docket  
File



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D.C. 20555-0001  
January 18, 1995

Mr. B. Ralph Sylvia  
Executive Vice President, Nuclear  
Niagara Mohawk Power Corporation  
Nine Mile Point Nuclear Station  
P.O. Box 63  
Lycoming, NY 13093

SUBJECT: RESPONSE TO NRC BULLETIN 90-01 SUPPLEMENT 1 FOR NINE MILE POINT  
NUCLEAR STATION UNIT NOS. 1 AND 2 (NMP-1 AND NMP-2)  
(TAC NOS. M85412 AND M85413)

Dear Mr. Sylvia:


NRC Bulletin 90-01, Supplement 1, "Loss of Fill-Oil in Transmitters  
Manufactured by Rosemount," was issued on December 22, 1992. Supplement 1 was  
issued to update information provided in Bulletin 90-01 and to delineate  
additional licensee actions and reporting requirements. Niagara Mohawk Power  
Corporation (NMPC) provided its response to Supplement 1 for NMP-1 and NMP-2  
by letters dated March 8, 1993, and December 14, 1994.

The NRC staff, with technical assistance from its contractor, the Idaho  
National Engineering Laboratory, has reviewed and evaluated NMPC's responses.  
The conclusions of our contractor are presented in the enclosed Technical  
Evaluation Report (TER) (EGG-DNSP-10919, September 1994). Our contractor  
concluded in its TER that NMPC has completed the reporting requirements of  
Supplement 1 of NRC Bulletin 90-01, except notification of the completion of  
all actions committed to (Reporting Requirement 2.c). Our contractor also  
concluded that NMPC conforms to the requested actions of Supplement 1 to NRC  
Bulletin 90-01. NMPC's December 14, 1994, letter notified the NRC of the  
completion of all actions committed to.

240028

9501260087	950118
PDR	ADOCK 05000220
	PDR

A01  
NRC FILE CENTER COPY  
*[Signature]*  
DF01



B. Sylvia

January 18, 1995

Our enclosed safety evaluation documents our review and concurrence with the contractor's findings. Since NMPC has completed all the actions committed to, we have determined that NMPC's responses to NRC Bulletin 90-01, Supplement 1, are acceptable and this item is complete.

Sincerely,

Original signed by

Donald S. Brinkman, Senior Project Manager  
Project Directorate I-1  
Division of Reactor Projects - I/II  
Office of Nuclear Reactor Regulation

Docket Nos. 50-220  
and 50-410

Enclosures: 1. Safety Evaluation  
2. Technical Evaluation Report

cc w/encls: See next page

Distribution:


Docket File	MCase	NLe
PUBLIC	CVogan	OGC
PD I-1 Rdg.	DBrinkman	ACRS (4)
SVarga	DSpaulding	CCowgill, RI
JZwolinski	JWermiel	

DOCUMENT NAME: H:\NMP1-2\NM85412.LTR

To receive a copy of this document, indicate in the box: "C" = Copy without enclosures "E" = Copy with enclosures "N" = No copy

OFFICE	LA:PDI-1	<input checked="" type="checkbox"/>	PM:PDI-1	<input checked="" type="checkbox"/>	D:PDI-1	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
NAME	CVogan <i>CV</i>		DBrinkman:cn		MCase <i>MC</i>				
DATE	01/17/95		01/17/95 <i>NAB</i>		01/18/95				

OFFICIAL RECORD COPY

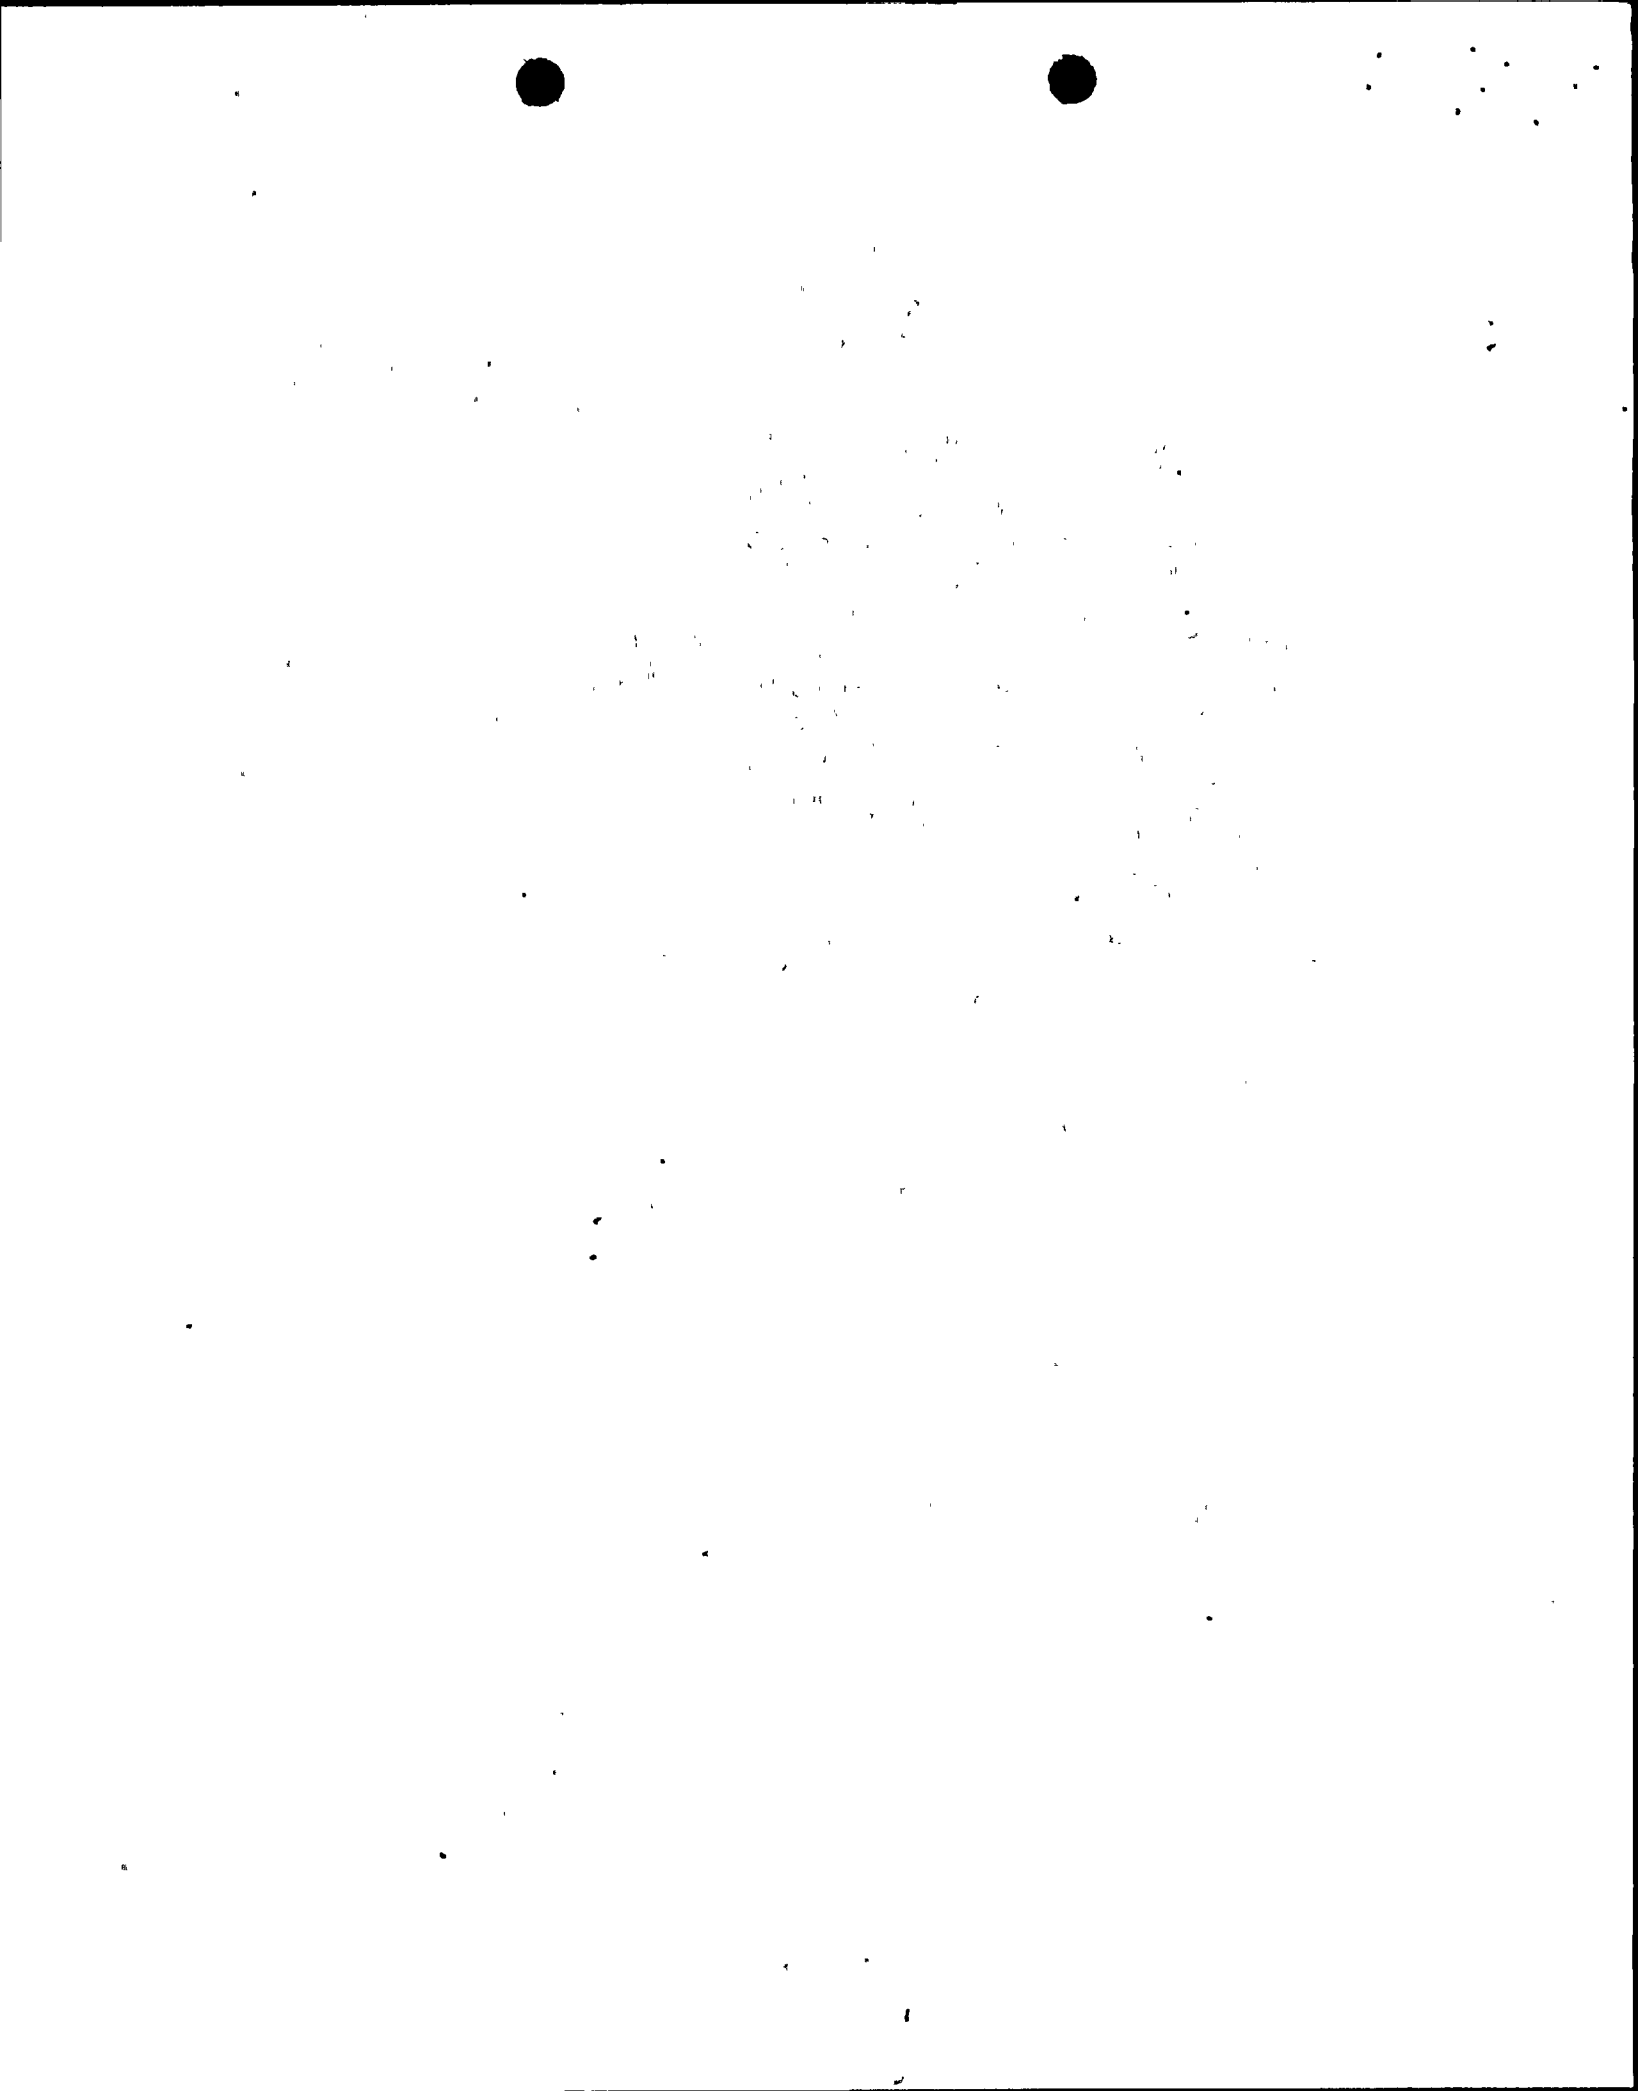


B. Sylvia

-2-

January 18, 1995

Our enclosed safety evaluation documents our review and concurrence with the contractor's findings. Since NMPC has completed all the actions committed to, we have determined that NMPC's responses to NRC Bulletin 90-01, Supplement 1, are acceptable and this item is complete.

Sincerely,



Donald S. Brinkman, Senior Project Manager  
Project Directorate I-1  
Division of Reactor Projects - I/II  
Office of Nuclear Reactor Regulation

Docket Nos. 50-220  
and 50-410

Enclosures: 1. Safety Evaluation  
2. Technical Evaluation Report

cc w/encs: See next page



B. Ralph Sylvia  
Niagara Mohawk Power Corporation

cc:

Mark J. Wetterhahn, Esquire  
Winston & Strawn  
1400 L Street, NW  
Washington, DC 20005-3502

Supervisor  
Town of Scriba  
Route 8, Box 382  
Oswego, NY 13126

Mr. Louis F. Storz  
Vice President - Nuclear Generation  
Niagara Mohawk Power Corporation  
Nine Mile Point Nuclear Station  
P.O. Box 63  
Lycoming, NY 13093

Resident Inspector  
U. S. Nuclear Regulatory Commission  
P.O. Box 126  
Lycoming, NY 13093

Gary D. Wilson, Esquire  
Niagara Mohawk Power Corporation  
300 Erie Boulevard West  
Syracuse, NY 13202

Regional Administrator, Region I  
U. S. Nuclear Regulatory Commission  
475 Allendale Road  
King of Prussia, PA 19406

Ms. Donna Ross  
New York State Energy Office  
2 Empire State Plaza  
16th Floor  
Albany, NY 12223

Mr. Martin J. McCormick, Jr.  
Vice President  
Nuclear Safety Assessment  
and Support  
Niagara Mohawk Power Corporation  
Nine Mile Point Nuclear Station  
P.O. Box 63  
Lycoming, NY 13093

Nine Mile Point Nuclear Station  
Unit Nos. 1 and 2

Mr. Richard B. Abbott  
Unit 1 Plant Manager  
Nine Mile Point Nuclear Station  
P.O. Box 63  
Lycoming, NY 13093

Mr. Kim A. Dahlberg  
Plant Manager, Unit 2  
Nine Mile Point Nuclear Station  
P.O. Box 63  
Lycoming, NY 13093

Charles Donaldson, Esquire  
Assistant Attorney General  
New York Department of Law  
120 Broadway  
New York, NY 10271

Mr. Paul D. Eddy  
State of New York Department of  
Public Service  
Power Division, System Operations  
3 Empire State Plaza  
Albany, NY 12223

Mr. David K. Greene  
Manager Licensing  
Niagara Mohawk Power Corporation  
Nine Mile Point Nuclear Station  
P.O. Box 63  
Lycoming, NY 13093

Mr. Richard Goldsmith  
Syracuse University  
College of Law  
E. I. White Hall Campus  
Syracuse, NY 12223

Mr. Richard M. Kessel  
Chair and Executive Director  
State Consumer Protection Board  
99 Washington Avenue  
Albany, NY 12210

