

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9708190024 DOC. DATE: 97/08/08 NOTARIZED: NO DOCKET #
 FACIL: 50-220 Nine Mile Point Nuclear Station, Unit 1, Niagara Powe 05000220
 AUTH. NAME AUTHOR AFFILIATION
 CONWAY, J.T. Niagara Mohawk Power Corp.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk) *See Reports*

SUBJECT: Forwards ISI summary rept conducted between 950404-970510 per requirements of ASME B&PV Code Section XI.

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+250
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code, - GL-89-04


NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD1-1 LA		1	1		PD1-1 PD		1	1
	HOOD, D		1	1					
INTERNAL:	ACRS		1	1		AEOD/SPD/RAB		1	1
	<u>FILE CENTER 01</u>		1	1		NRR/DE/EMEB		1	1
	NUDOCS-ABSTRACT		1	1		OGC/HDS3		1	0
	RES/DET/EIB		1	1		RES/DET/EMMEB		1	1
EXTERNAL:	LITCO ANDERSON		1	1		NOAC		1	1
	NRC PDR		1	1					

C
A
T
E
G
O
R
Y
1
D
O
C
U
M
E
N
T

NOTE TO ALL "RIDS" RECIPIENTS:
PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTTR 14 ENCL 13

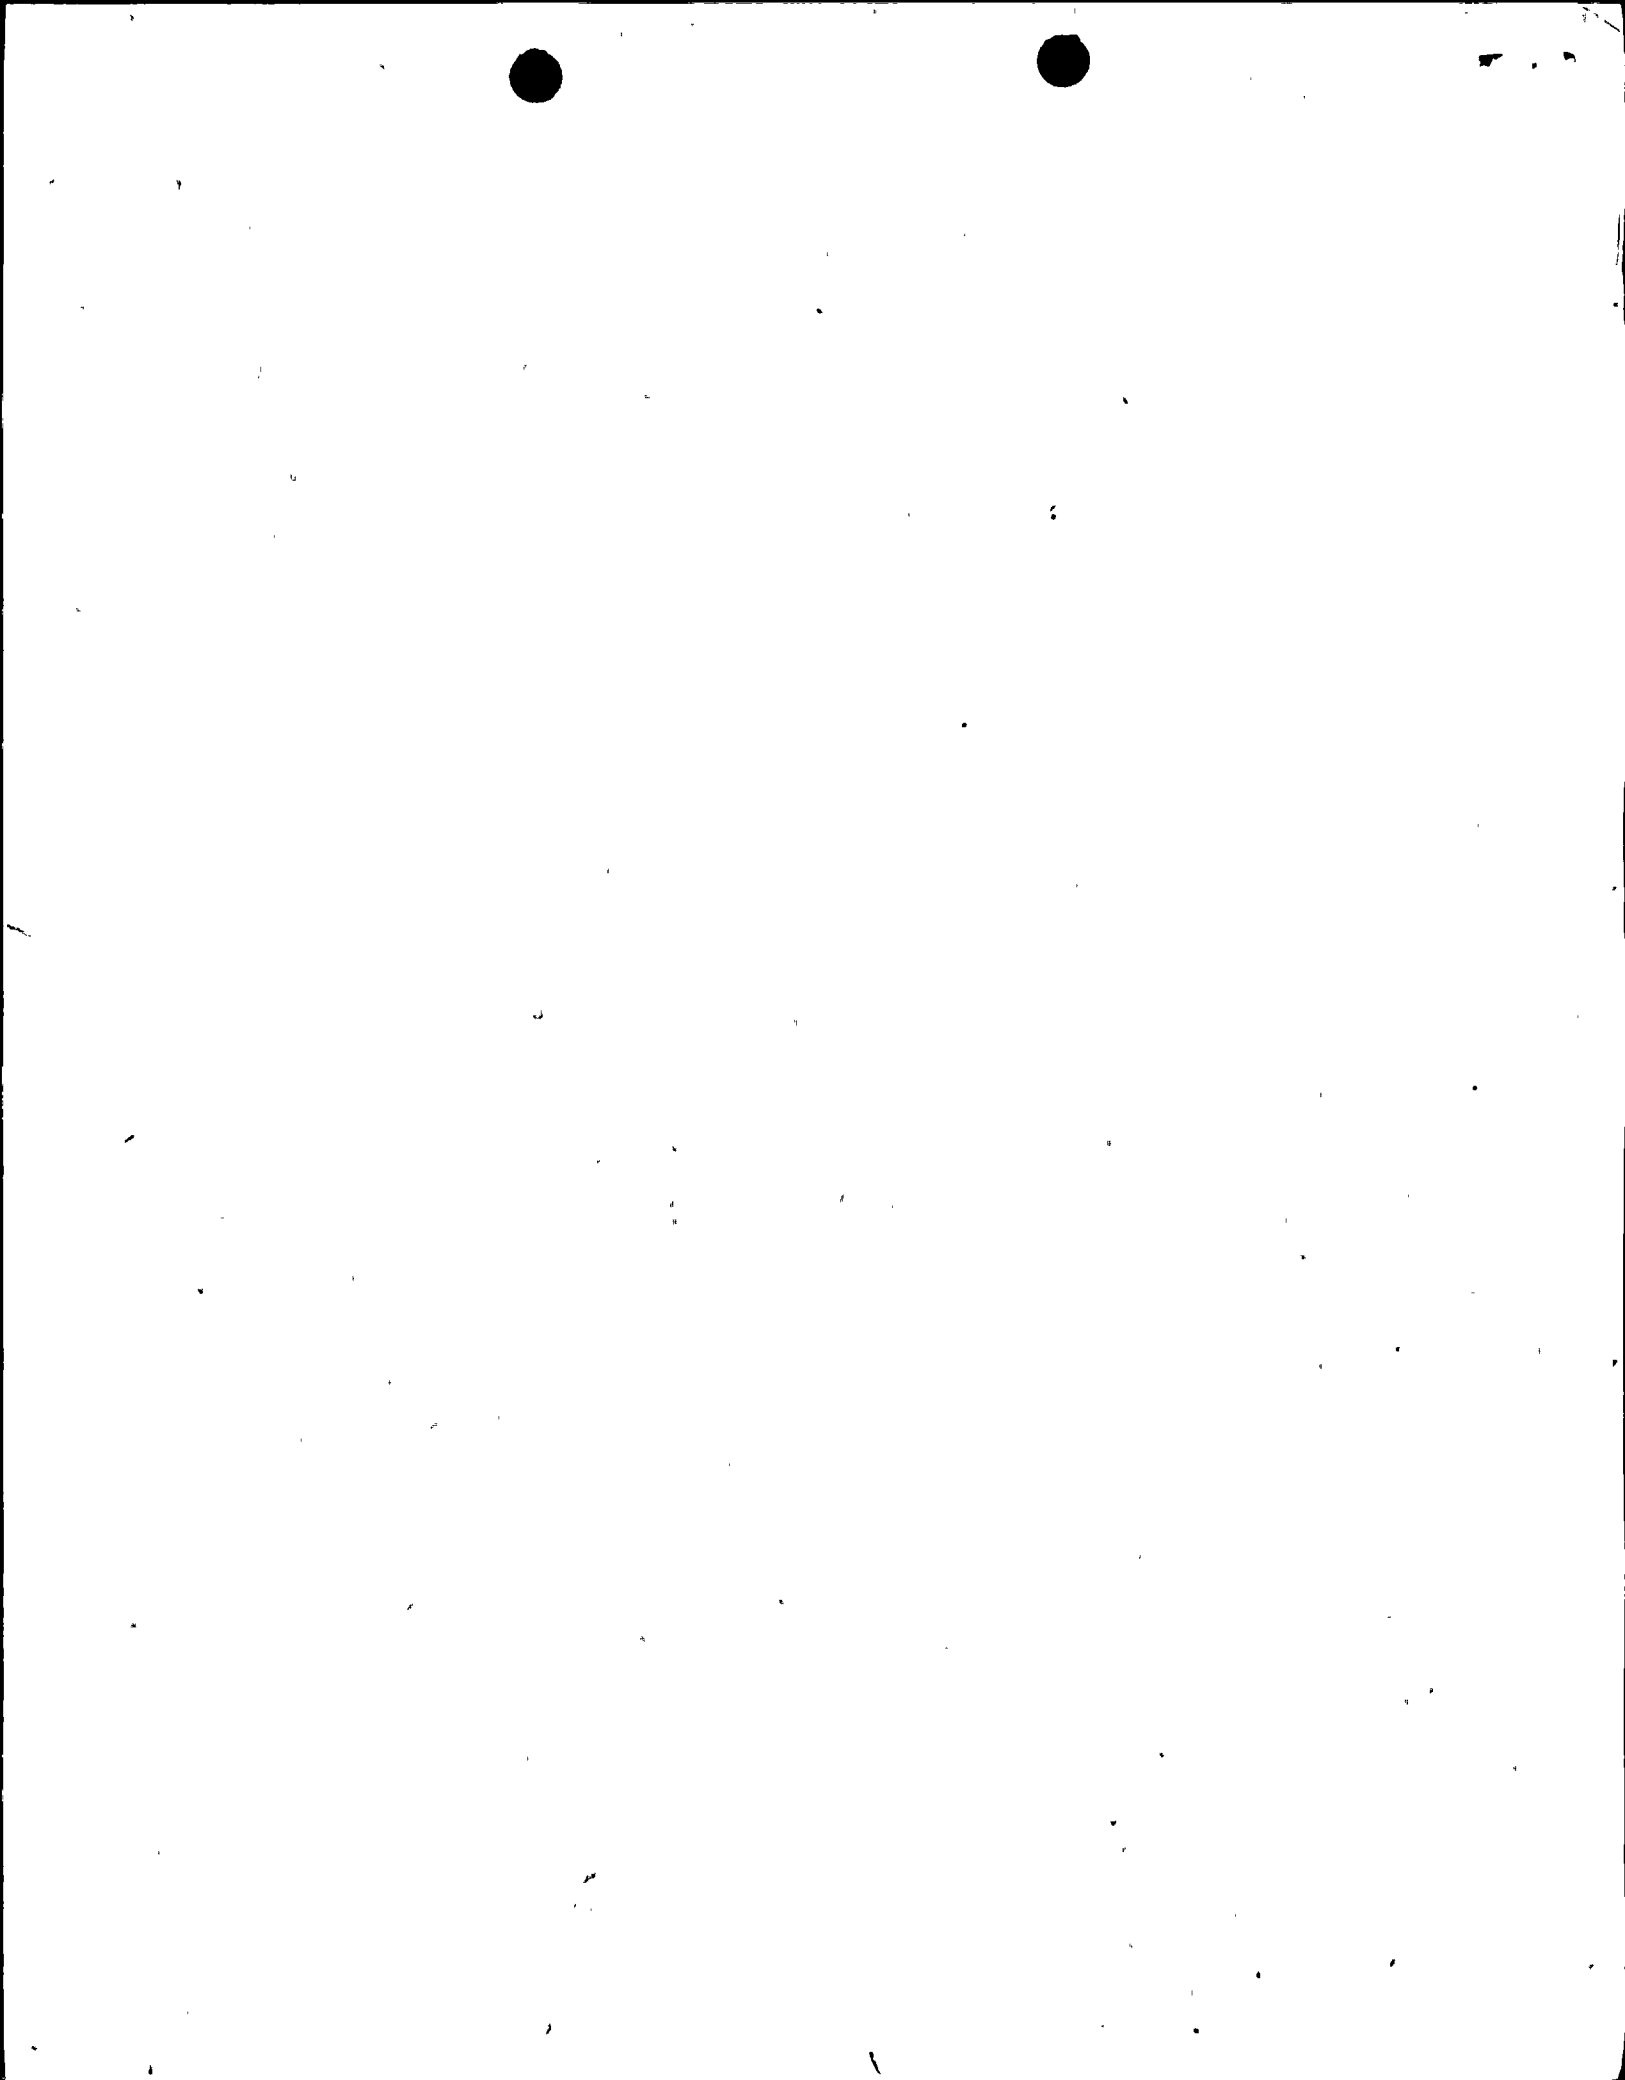



NIAGARA MOHAWK

GENERATION
BUSINESS GROUP

NINE MILE POINT NUCLEAR STATION/LAKE ROAD, P.O. BOX 63, LYCOMING, NEW YORK 13093/TELEPHONE (315) 349-4213
FAX (315) 349-2605

JOHN T. CONWAY
Vice President
Nuclear Engineering

August 8, 1997
NMP1L 1241

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555

RE: Nine Mile Point Unit 1
Docket No. 50-220
DPR-63

Subject: Inservice Inspections (ISI) Summary Report

Gentlemen:

Enclosed is the Nine Mile Point Unit 1 (NMP1) ISI Summary Report for inservice inspections conducted between April 4, 1995 and May 10, 1997 (i.e., the end of NMP1's Spring 1997 refueling outage). This submittal is being made to satisfy the requirements of American Society of Mechanical Engineers Boiler and Pressure Vessel Code Section XI.

Very truly yours,


John T. Conway
Vice President - Nuclear Engineering

AO47/1

JTC/JMT/cmK
Enclosure

- xc: Mr. H. J. Miller, NRC Regional Administrator
- Mr. A. W. Dromerick, Acting Director, Project Directorate I-1, NRR (w/o enclosure)
- Mr. B. S. Norris, Senior Resident Inspector
- Mr. D. S. Hood, Senior Project Manager, NRR (w/o enclosure)
- Records Management

9708190024 970808
PDR ADOCK 05000220
G PDR





7-11-19