

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9802120257 DOC. DATE: 98/02/02 NOTARIZED: NO DOCKET #
FACIL: 50-220 Nine Mile Point Nuclear Station, Unit 1, Niagara Powe 05000220
AUTH. NAME: AUTHORITY AFFILIATION
MUELLER, J.H. Niagara Mohawk Power Corp.
RECIP. NAME RECIPIENT AFFILIATION
Document Control Branch (Document Control Desk)

SUBJECT: Withdraws 960926 application for amend to license DPR-63,
adding TS 3.7.2/4.7.2, "Special Test Exception - Sys Leakage
& Hydrostatic Testing."

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2
TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES		
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL	
	PD1-1 LA		1	1		PD1-1 PD		1	1	
	HOOD, D		1	1						
INTERNAL:	ACRS		1	1		FILE CENTER 01		1	1	
	NRR/DE/ECGB/A		1	1		NRR/DE/EMCB		1	1	
	NRR/DRCH/HICB		1	1		NRR/DSSA/SPLB		1	1	
	NRR/DSSA/SRXB		1	1		NUDOCS-ABSTRACT		1	1	
	OGC/HDS3		1	0						
EXTERNAL:	NOAC		1	1		NRC PDR		1	1	


NOTE TO ALL "RIDS" RECIPIENTS:
PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS
OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL
DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 14 ENCL 0

C
A
T
E
G
O
R
Y

1

D
O
C
U
M
E
N
T

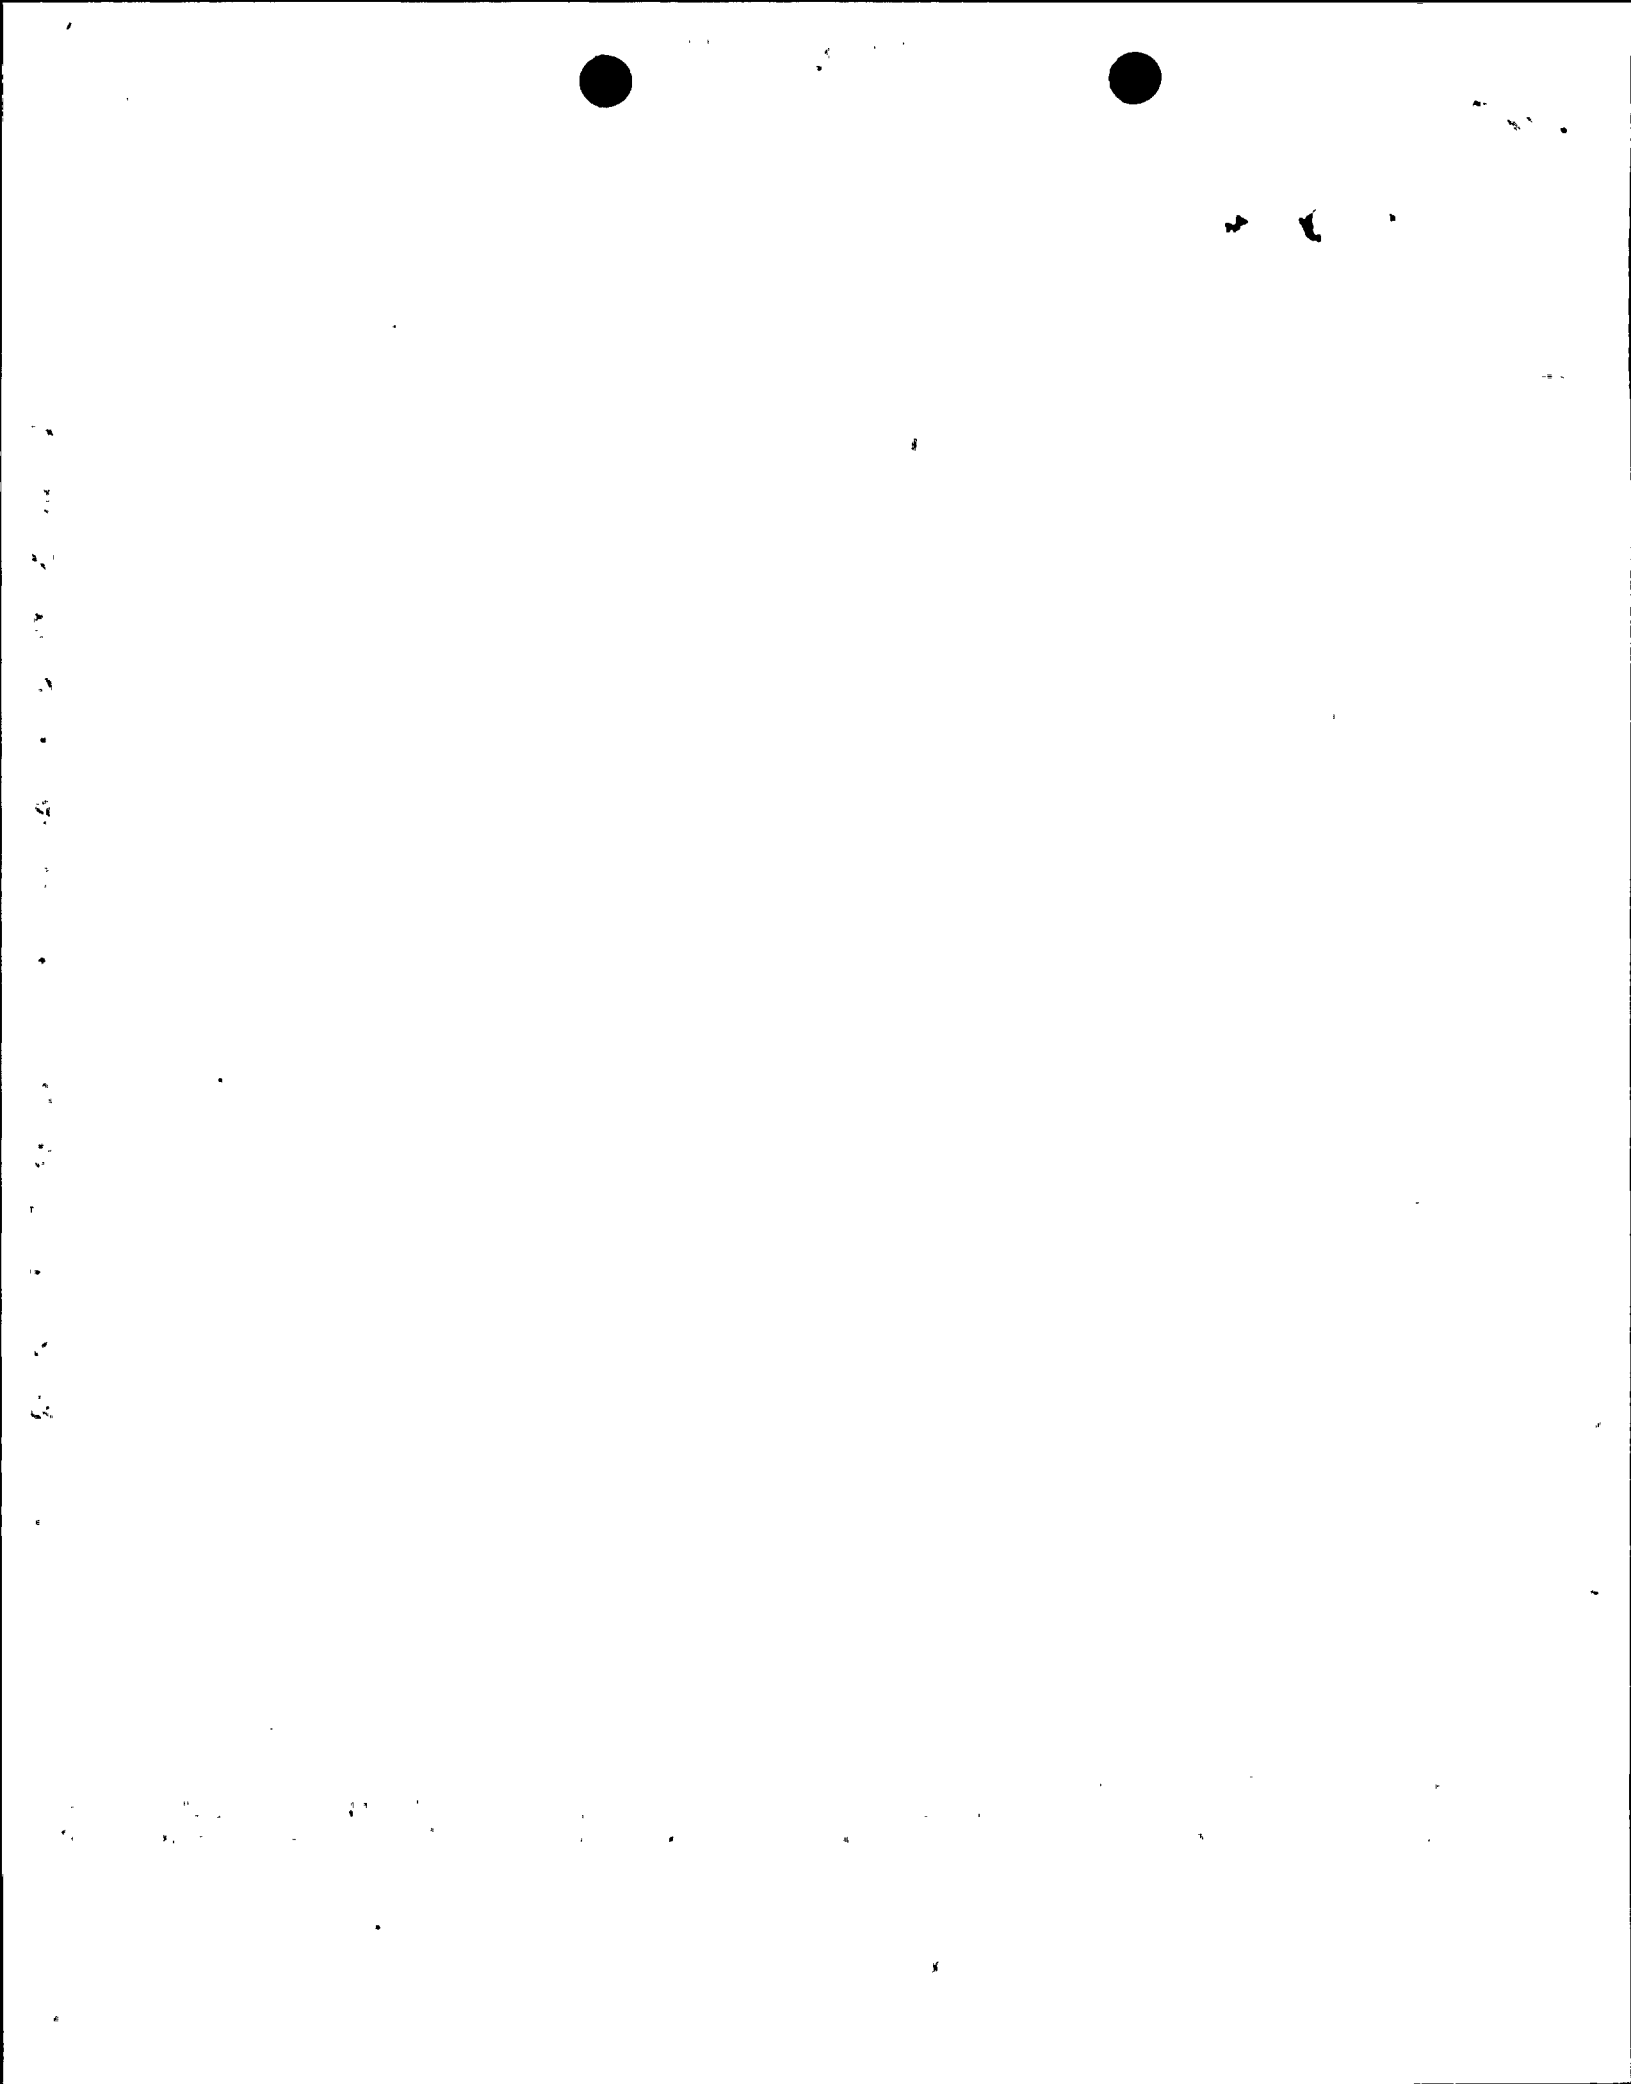



NIAGARA MOHAWK

GENERATION
BUSINESS GROUP

NINE MILE POINT NUCLEAR STATION/LAKE ROAD, P.O. BOX 63, LYCOMING, NEW YORK 13093

February 2, 1998
NMP1L 1285

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555

RE: Nine Mile Point Unit 1
 Docket No. 50-220
 DPR-63

Subject: Technical Specification Amendment Application - System Leakage and Hydrostatic Testing

Gentlemen:

By application for amendment dated September 26, 1996, Niagara Mohawk Power Corporation (NMPC) proposed the addition of Specification 3.7.2/4.7.2, "Special Test Exception - System Leakage and Hydrostatic Testing," to the Nine Mile Point Unit 1 Technical Specifications.

Per discussions held with the NRC on March 17, 1997, NMPC requested that reviews of the application be suspended. The purpose of this letter is to withdraw this application from further consideration by the NRC.

Very truly yours,

John H. Mueller
Chief Nuclear Officer

120083

JHM/JMT/cmK

9802120257 980202
PDR ADOCK 05000220
P PDR



A001/0



xc: Mr. H. J. Miller, Regional Administrator, Region I
Mr. A. W. Dromerick, Acting Director, Project Directorate I-1, NRR
Mr. B. S. Norris, Senior Resident Inspector
Mr. D. S. Hood, Senior Project Manager, NRR
Mr. John P. Spath
 NYSERDA
 286 Washington Avenue Ext
 Albany, NY 12203-6399
Records Management

