

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9803120095 DOC. DATE: 98/03/02 NOTARIZED: NO DOCKET #
FACIL: 50-410 Nine Mile Point Nuclear Station, Unit 2, Niagara Moho 05000410
AUTH. NAME AUTHOR AFFILIATION
CONWAY, J.T. Niagara Mohawk Power Corp.
RECIP. NAME RECIPIENT AFFILIATION
Document Control Branch (Document Control Desk)

SUBJECT: Forwards "Semi-Annual Radioactive Effluent Release Rept from Jul-Dec 1997" & rev 3 to "Process Control Program Manual."

DISTRIBUTION CODE: IE48D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2 + 52
TITLE: 50.36a(a) (2) Semiannual Effluent Release Reports


NOTES:


	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PD1-1 LA HOOD, D	1 1	PD1-1 PD	1 1
INTERNAL:	ACRS	1 1	<u>FILE CENTER 01</u>	1 1
	NRR/DRPM/PERB/A	1 1	NRR/DSSA/SPLB	1 1
	RGN1 DRS/RSB	1 1	RGN1 FILE	1 1
EXTERNAL:	NRC PDR	1 1		

NOTE TO ALL "RIDS" RECIPIENTS:
PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 10 ENCL 10

Er-

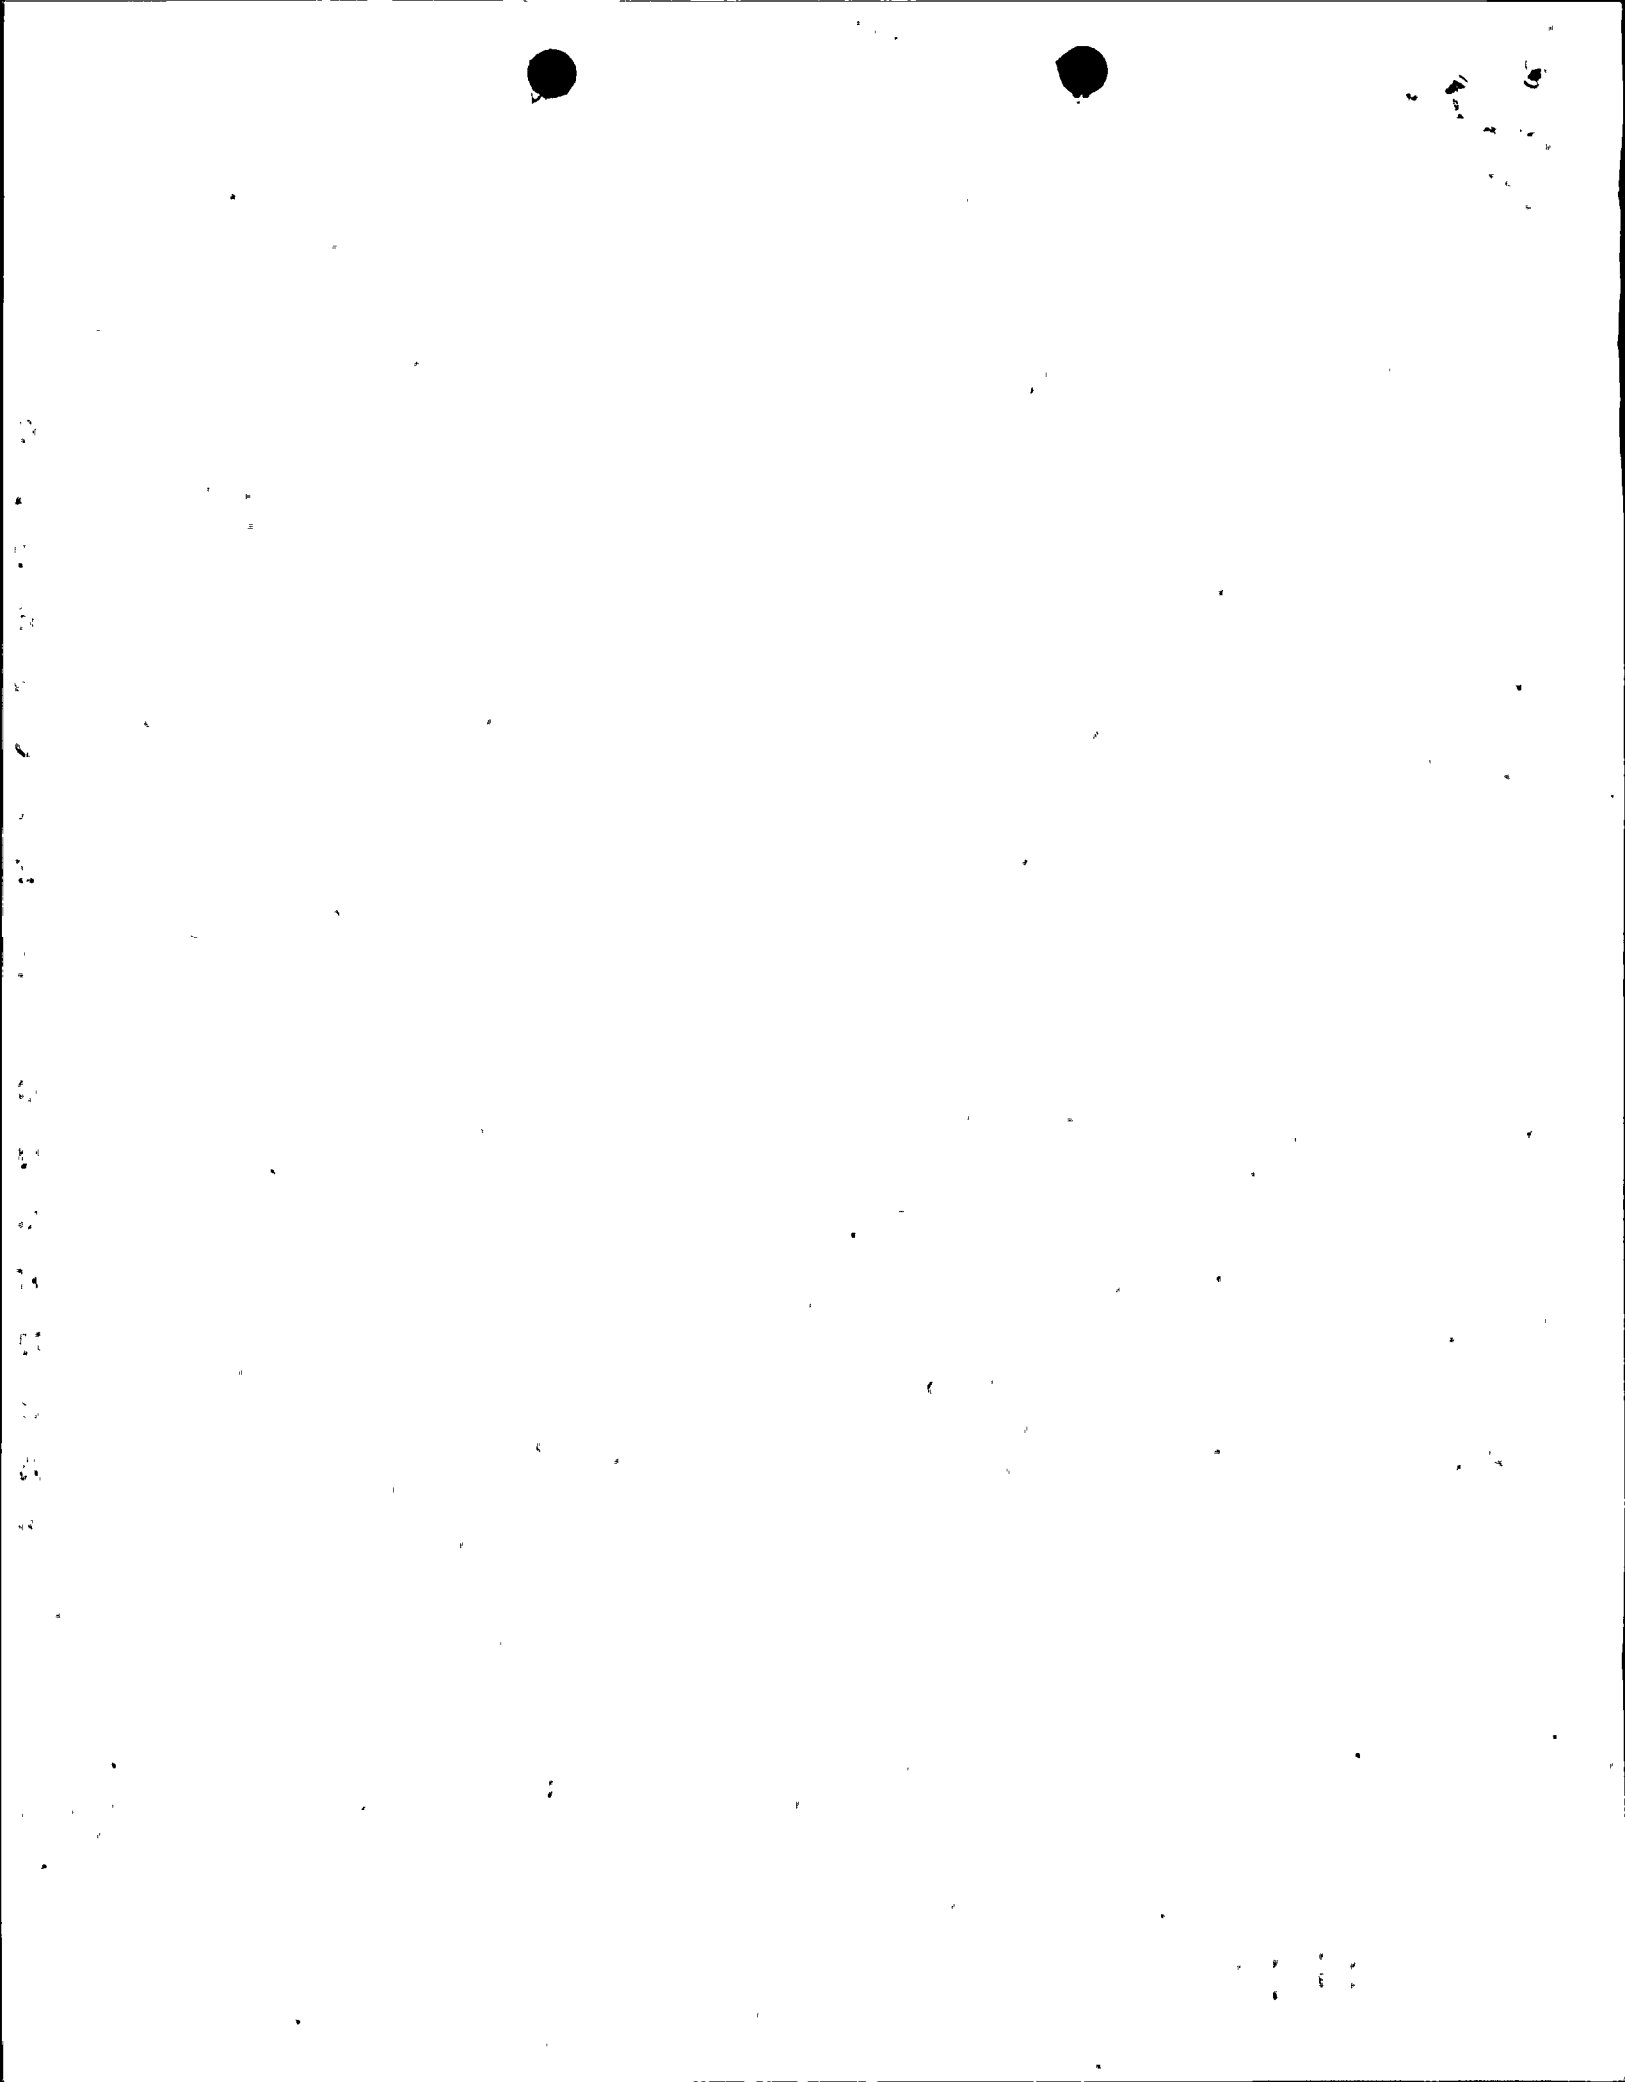



NIAGARA MOHAWK

GENERATION
BUSINESS GROUP

NINE MILE POINT NUCLEAR STATION/LAKE ROAD, P.O. BOX 63, LYCOMING, NEW YORK 13093/TELEPHONE (315) 349-4213
FAX (315) 349-2605

JOHN T. CONWAY
Vice President
Nuclear Engineering

March 2, 1998
NMP2L 1760

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555

RE: Nine Mile Point Unit 2
Docket No. 50-410
NPF-69

Subject: July - December 1997 Semi-Annual Radioactive Effluent Release Report

Gentlemen:

In conformance with the Nine Mile Point Unit 2 (NMP2) Technical Specifications, we are enclosing the Semi-Annual Radioactive Effluent Release Report for the reporting period July - December 1997. Included in this report is a summary of gaseous, liquid, and solid effluents released from the station during the reporting period (Attachments 1 - 6), a summary of revisions to the Offsite Dose Calculation Manual and the Process Control Program during the reporting period (Attachments 7 and 8), and an explanation as to the cause and corrective actions regarding the inoperability of any station liquid and/or gaseous effluent monitoring instrumentation (Attachment 9). Attachments 10 and 11 provide a summary and assessment of radiation doses to members of the public within and outside the site boundary, respectively, from liquid and gaseous effluents as well as direct radiation in accordance with 40CFR190.

The format used for the effluent data is outlined in Appendix B of Regulatory Guide 1.21, Revision 1. Dose assessments were made in accordance with the NMP2 Offsite Dose Calculation Manual. Distribution is in accordance with Regulatory Guide 10.1, 10CFR50.4(b)(1) and the Technical Specifications.

Attachment 12 to this report is an update of actual data for the second quarter 1997 used in the January - June 1997 Semi-Annual Radioactive Effluent Release Report.

Attachment 13 is a copy of Revision 3 of the Process Control Program Manual.

IE481

During the reporting period from July - December 1997, NMP2 did not exceed any 10CFR20, 10CFR50, or Technical Specification limits for gaseous or liquid effluents.

9803120095 980302
PDR ADOCK 05000410
R PDR






42
13
2

Page 2

If you have any questions concerning the attached report, please contact Mr. Anthony M. Salvagno, (315) 349-1456 or Mr. Timothy M. Kurtz, (315) 349-7666, Fuels and Analysis, Nine Mile Point.

Very truly yours,

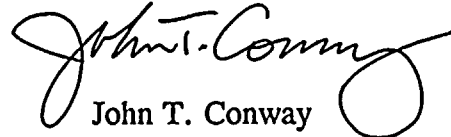

John T. Conway
Vice President - Nuclear Engineering

JTC/AMS/lmc
Attachments

xc: Mr. H. J. Miller, Regional Administrator, Region I
Mr. S. S. Bajwa, Director, Project Directorate I-1, NRR
Mr. B. S. Norris, Senior Resident Inspector
Mr. D. S. Hood, Senior Project Manager, NRR
Records Management



10
11
12