

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9810130020 DOC. DATE: 98/10/02 NOTARIZED: NO DOCKET #
 FACIL: 50-410 Nine Mile Point Nuclear Station, Unit 2, Niagara Moha 05000410
 AUTH. NAME: ABBOTT, R.B. AUTHOR AFFILIATION: Niagara Mohawk Power Corp.
 RECIP. NAME: RECORDS MANAGEMENT BRANCH (DOCUMENT CONTROL DESK)

See Rpt.

SUBJECT: Forwards "ISI Summary Rept for Nine Mile Point Unit 2."
 Submittal being made to satisfy requirements of ASME Boiler
 & Pressure Vessel Code Section XI.

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1 + 200
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	PD1-1 LA		1	1		PD1-1 PD		1	1
	HOOD, D		1	1					
INTERNAL:	ACRS		1	1		AEOD/SPD/RAB		1	1
	<u>FILE CENTER 01</u>		1	1		NRR/DE/ECGB		1	1
	NUDOCS-ABSTRACT		1	1		OGC/HDS3		1	0
	RES/DET/EIB		1	1		RES/DET/EMMEB		1	1
EXTERNAL:	LITCO ANDERSON		1	1		NOAC		1	1
	NRC PDR		1	1					

C
A
T
E
G
O
R
Y


1

D
O
C
U
M
E
N
T

NOTE TO ALL "RIDS" RECIPIENTS:
 PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS
 OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL
 DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 14 ENCL 13

MAZ

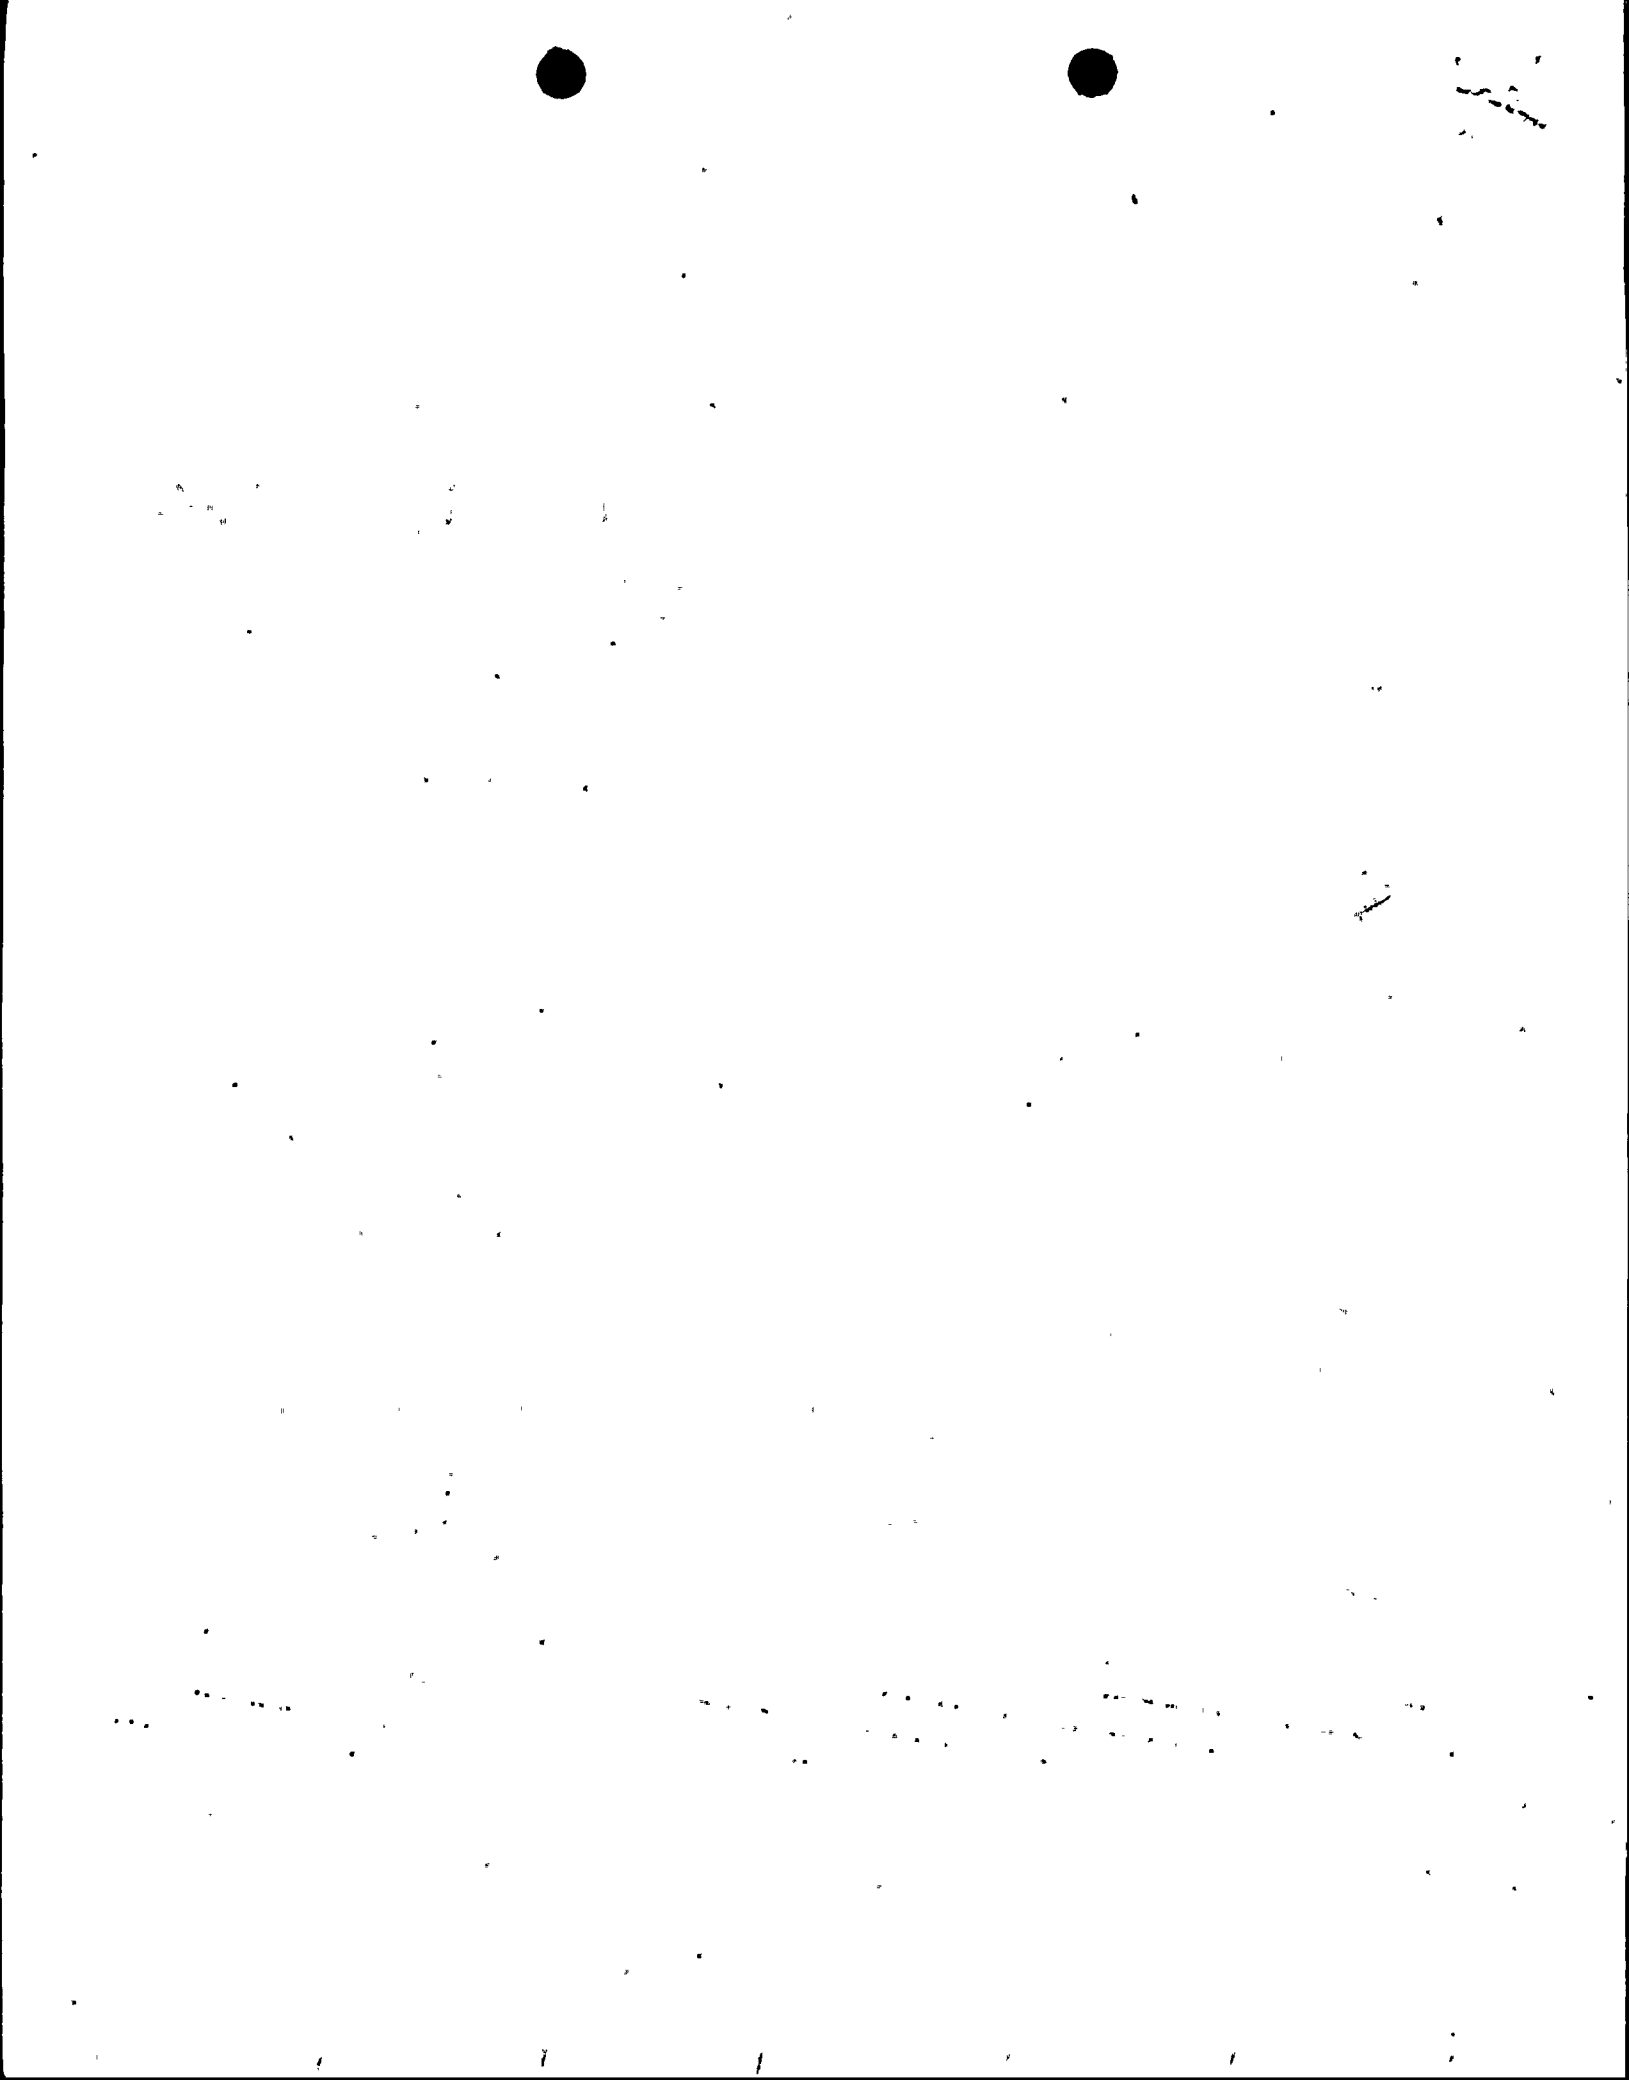

Niagara Mohawk

Richard B. Abbott
Vice President
Nuclear Engineering

Office: (315) 349-1812
Fax: (315) 349-4417

October 2, 1998
NMP2L 1825

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555

RE: Nine Mile Point Unit 2
Docket No. 50-410
NPF-69


Subject: *Inservice Inspections (ISI) Summary Report*

Gentlemen:

Enclosed is the Nine Mile Point Unit 2 (NMP2) ISI Summary Report for inservice inspections conducted from November 3, 1996 through the conclusion of the First Ten Year Interval that was extended to June 24, 1998, to allow completion of pressure testing as documented in the Refueling Outage Five (RFO-05) Summary Report. In addition, this report covers the Second Ten Year Interval from April 5, 1998 through the end of RFO-06, on July 5, 1998. This submittal is being made to satisfy the requirements of American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel Code Section XI.

Niagara Mohawk Power Corporation (NMPC) recognizes that reporting of the results of inspections of ASME Class 3 pressure retaining components or supports is not required by the Code. However, since the results of inspections of Class 3 pressure retaining components and supports were included in previous summary reports following completion of NMP2 RFO-03, NMPC has elected to continue this practice in order to maintain consistency, and those results are included in this report.

Very truly yours,



Richard B. Abbott
Vice President Nuclear Engineering

RBA/KLL/sc
Enclosure

xc: Mr. H. J. Miller, NRC Regional Administrator
Mr. S. S. Bajwa, Director, Project Directorate I-1, NRR (w/o attachment)
Mr. B. S. Norris, Senior Resident Inspector
Mr. D. S. Hood, Senior Project Manager, NRR (w/o attachment)
Records Management

7810130020 7810027
PDR ADOCK 05000410
G PDR

ADP 1/1



11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100

1
2

3
4

5
6