

CATEGORY 2

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9810200288 DOC. DATE: 98/10/09 NOTARIZED: NO DOCKET #
 FACIL: 50-220 Nine Mile Point Nuclear Station, Unit 1, Niagara Powe 05000220
 50-410 Nine Mile Point Nuclear Station, Unit 2, Niagara Moha 05000410
 AUTH. NAME AUTHOR AFFILIATION
 DOERFLEIN, L.T. Region 1 (Post 820201)
 RECIP. NAME RECIPIENT AFFILIATION
 MUELLER, J.H. Niagara Mohawk Power Corp.

SUBJECT: Ack receipt of 980806 ltr informing NRC of steps taken to correct violations noted in insp repts 50-220/98-05 & 50-410/98-05 on 980707.

DISTRIBUTION CODE: IE01D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3
 TITLE: General (50 Dkt) - Insp Rept/Notice of Violation Response


NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	PD1-1 PD		1	1		HOOD, D		1	1
INTERNAL:	ACRS		2	2		AEOD/SPD/RAB		1	1
	AEOD/TTC		1	1		DEDRO		1	1
	<u>FILE CENTER</u>		1	1		NRR/DRCH/HOHB		1	1
	NRR/DRPM/PECB		1	1		NRR/DRPM/PERB		1	1
	NUDOCS-ABSTRACT		1	1		OE DIR		1	1
	OGC/HDS3		1	1		RGN1 FILE 01		1	1
EXTERNAL:	LITCO BRYCE, J H		1	1		NOAC		1	1
	NRC PDR		1	1		NUDOCS FULLTEXT		1	1

NOTE TO ALL "RIDS" RECIPIENTS:
 PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 19 ENCL 19

C
A
T
E
G
O
R
Y
2
D
O
C
U
M
E
N
T

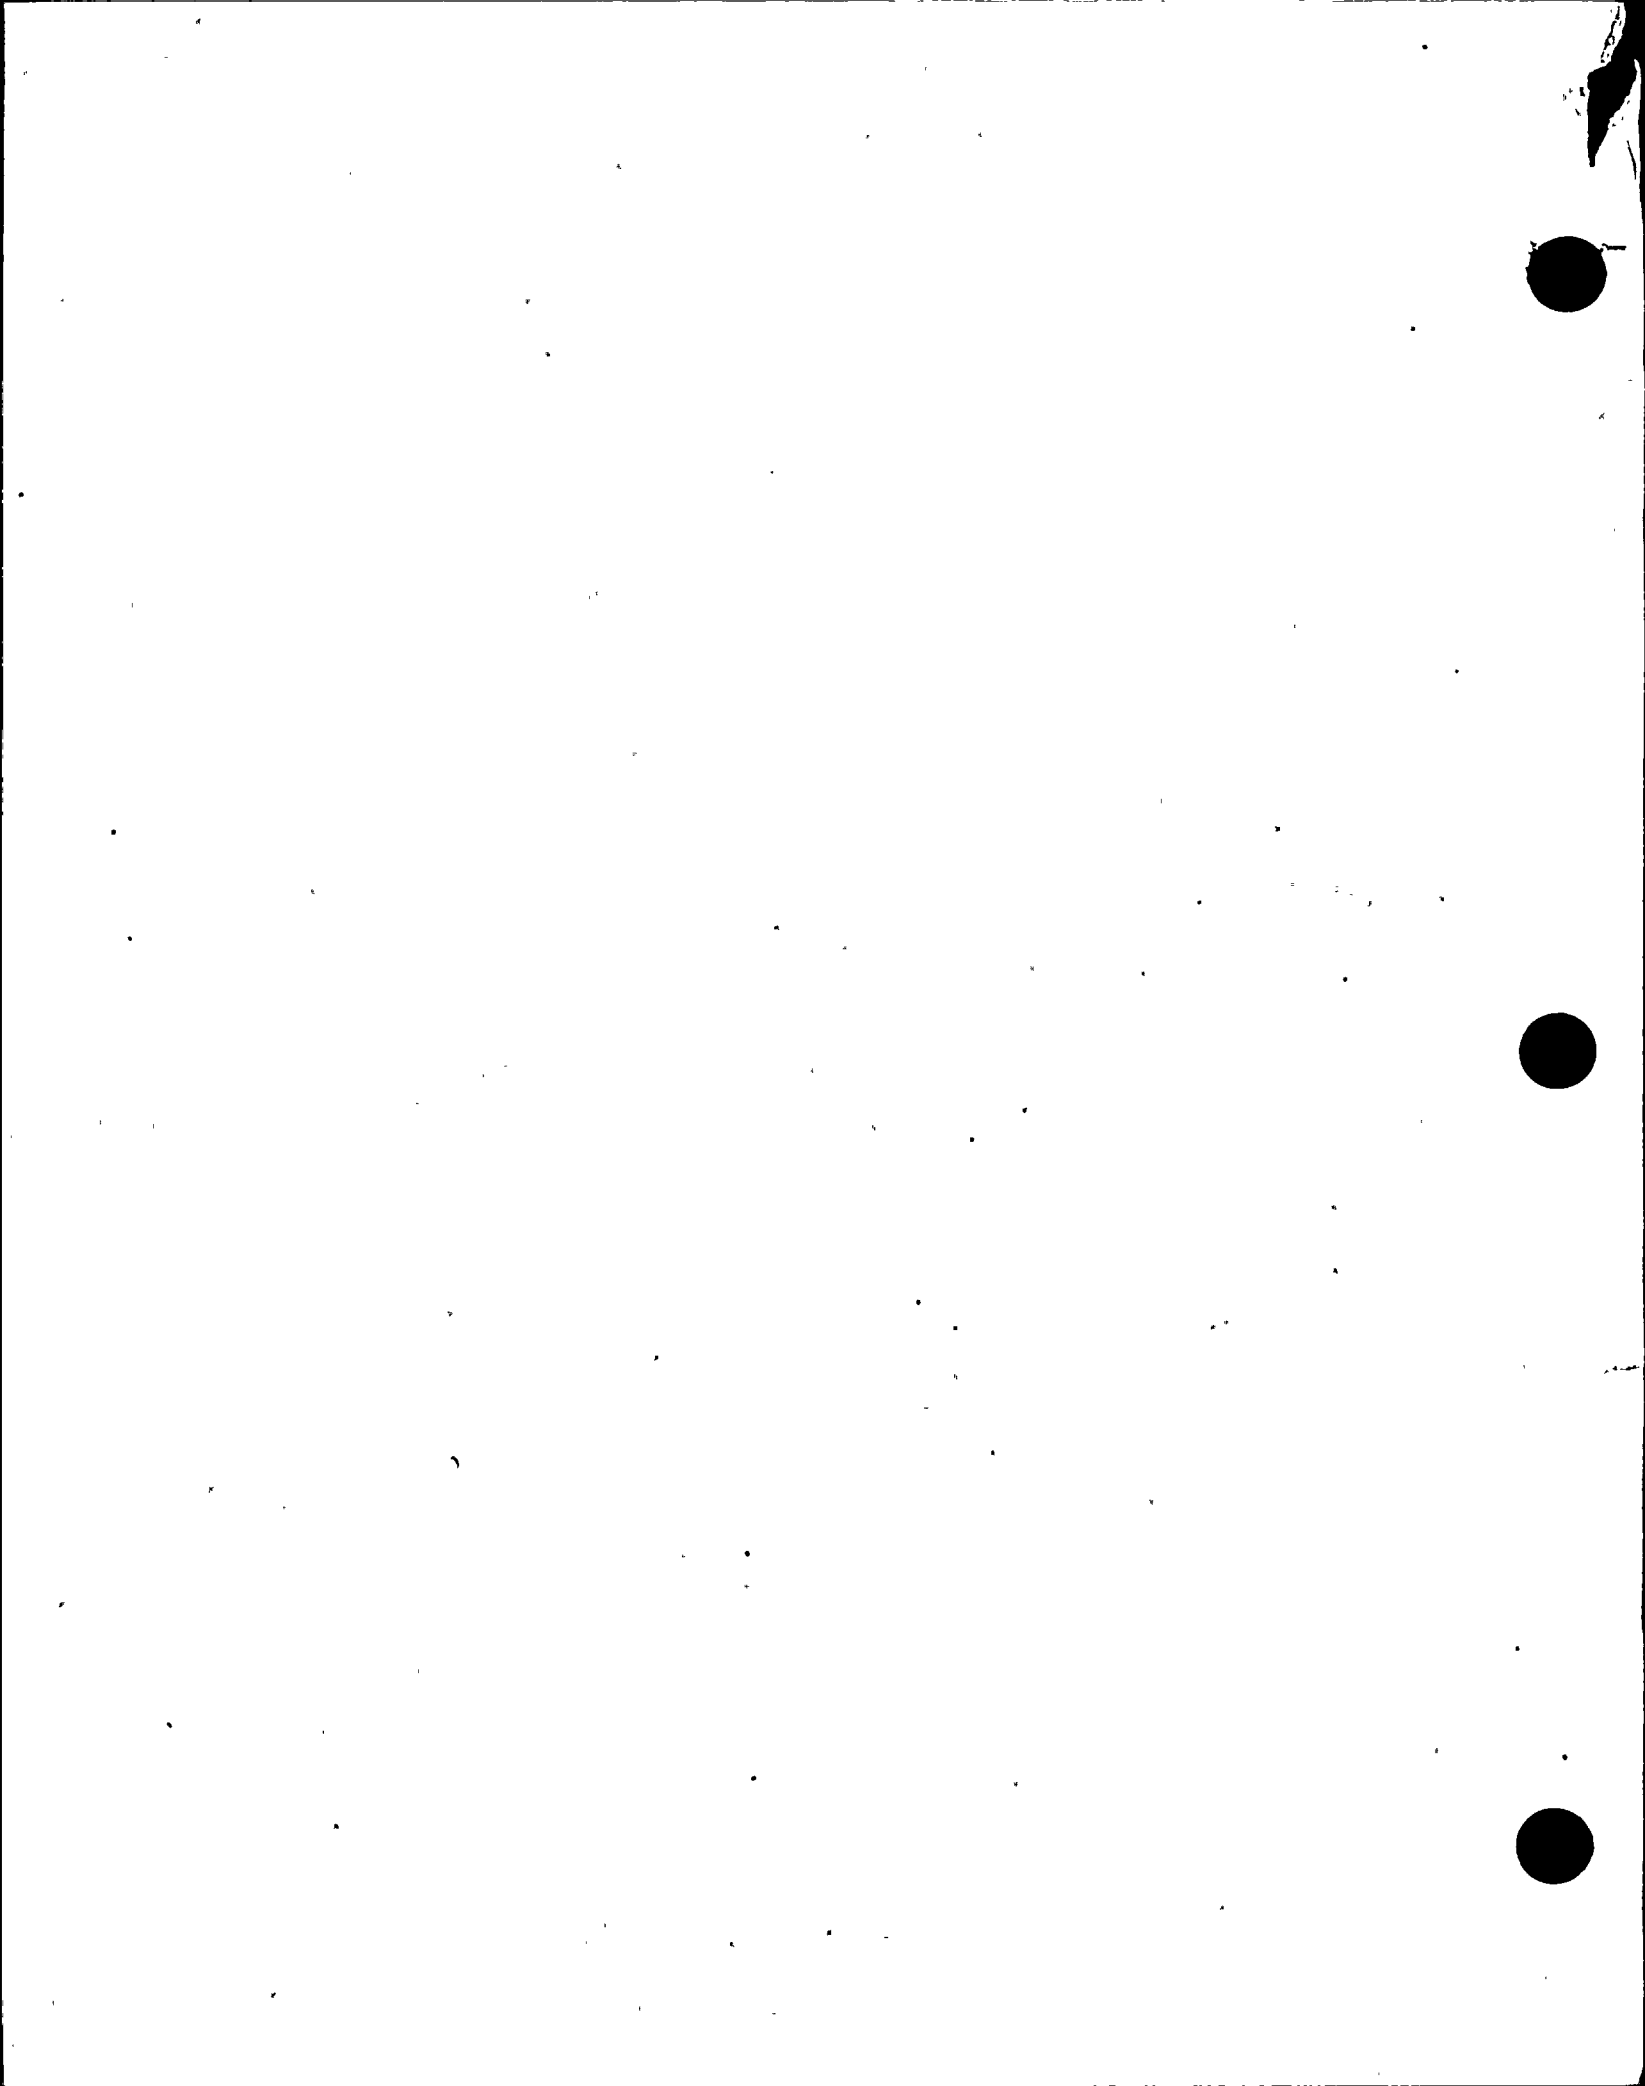

October 9, 1998

Mr. John H. Mueller
Chief Nuclear Officer
Niagara Mohawk Power Corporation
Nine Mile Point Nuclear Station
Operations Building, 2nd Floor
P.O. Box 63
Lycoming, NY 13093

**SUBJECT: NRC INSPECTION REPORT 50-220/98-05; 50-410/98-05
AND NOTICE OF VIOLATION**

Dear Mr. Mueller:

This letter refers to your August 6, 1998 correspondence, in response to our July 7, 1998 letter.

We have conducted a preliminary review of this response in accordance with NRC Inspection Procedures 92901, "Followup - Plant Operations," and 92904, "Followup - Plant Support." Based upon this review, we find your response to the Notice of Violation appropriate.

We will examine the specific corrective and preventive actions documented in your letter during a future inspection of your facility.

We appreciate your cooperation.

Sincerely,

Original Signed by:

Lawrence T. Doerflein, Chief
Projects Branch 1
Division of Reactor Projects


Docket No. 50-220; 50-410

000000

OFFICIAL RECORD COPY

IE:01

9810200288 981009
PDR ADDCK 05000220
G PDR

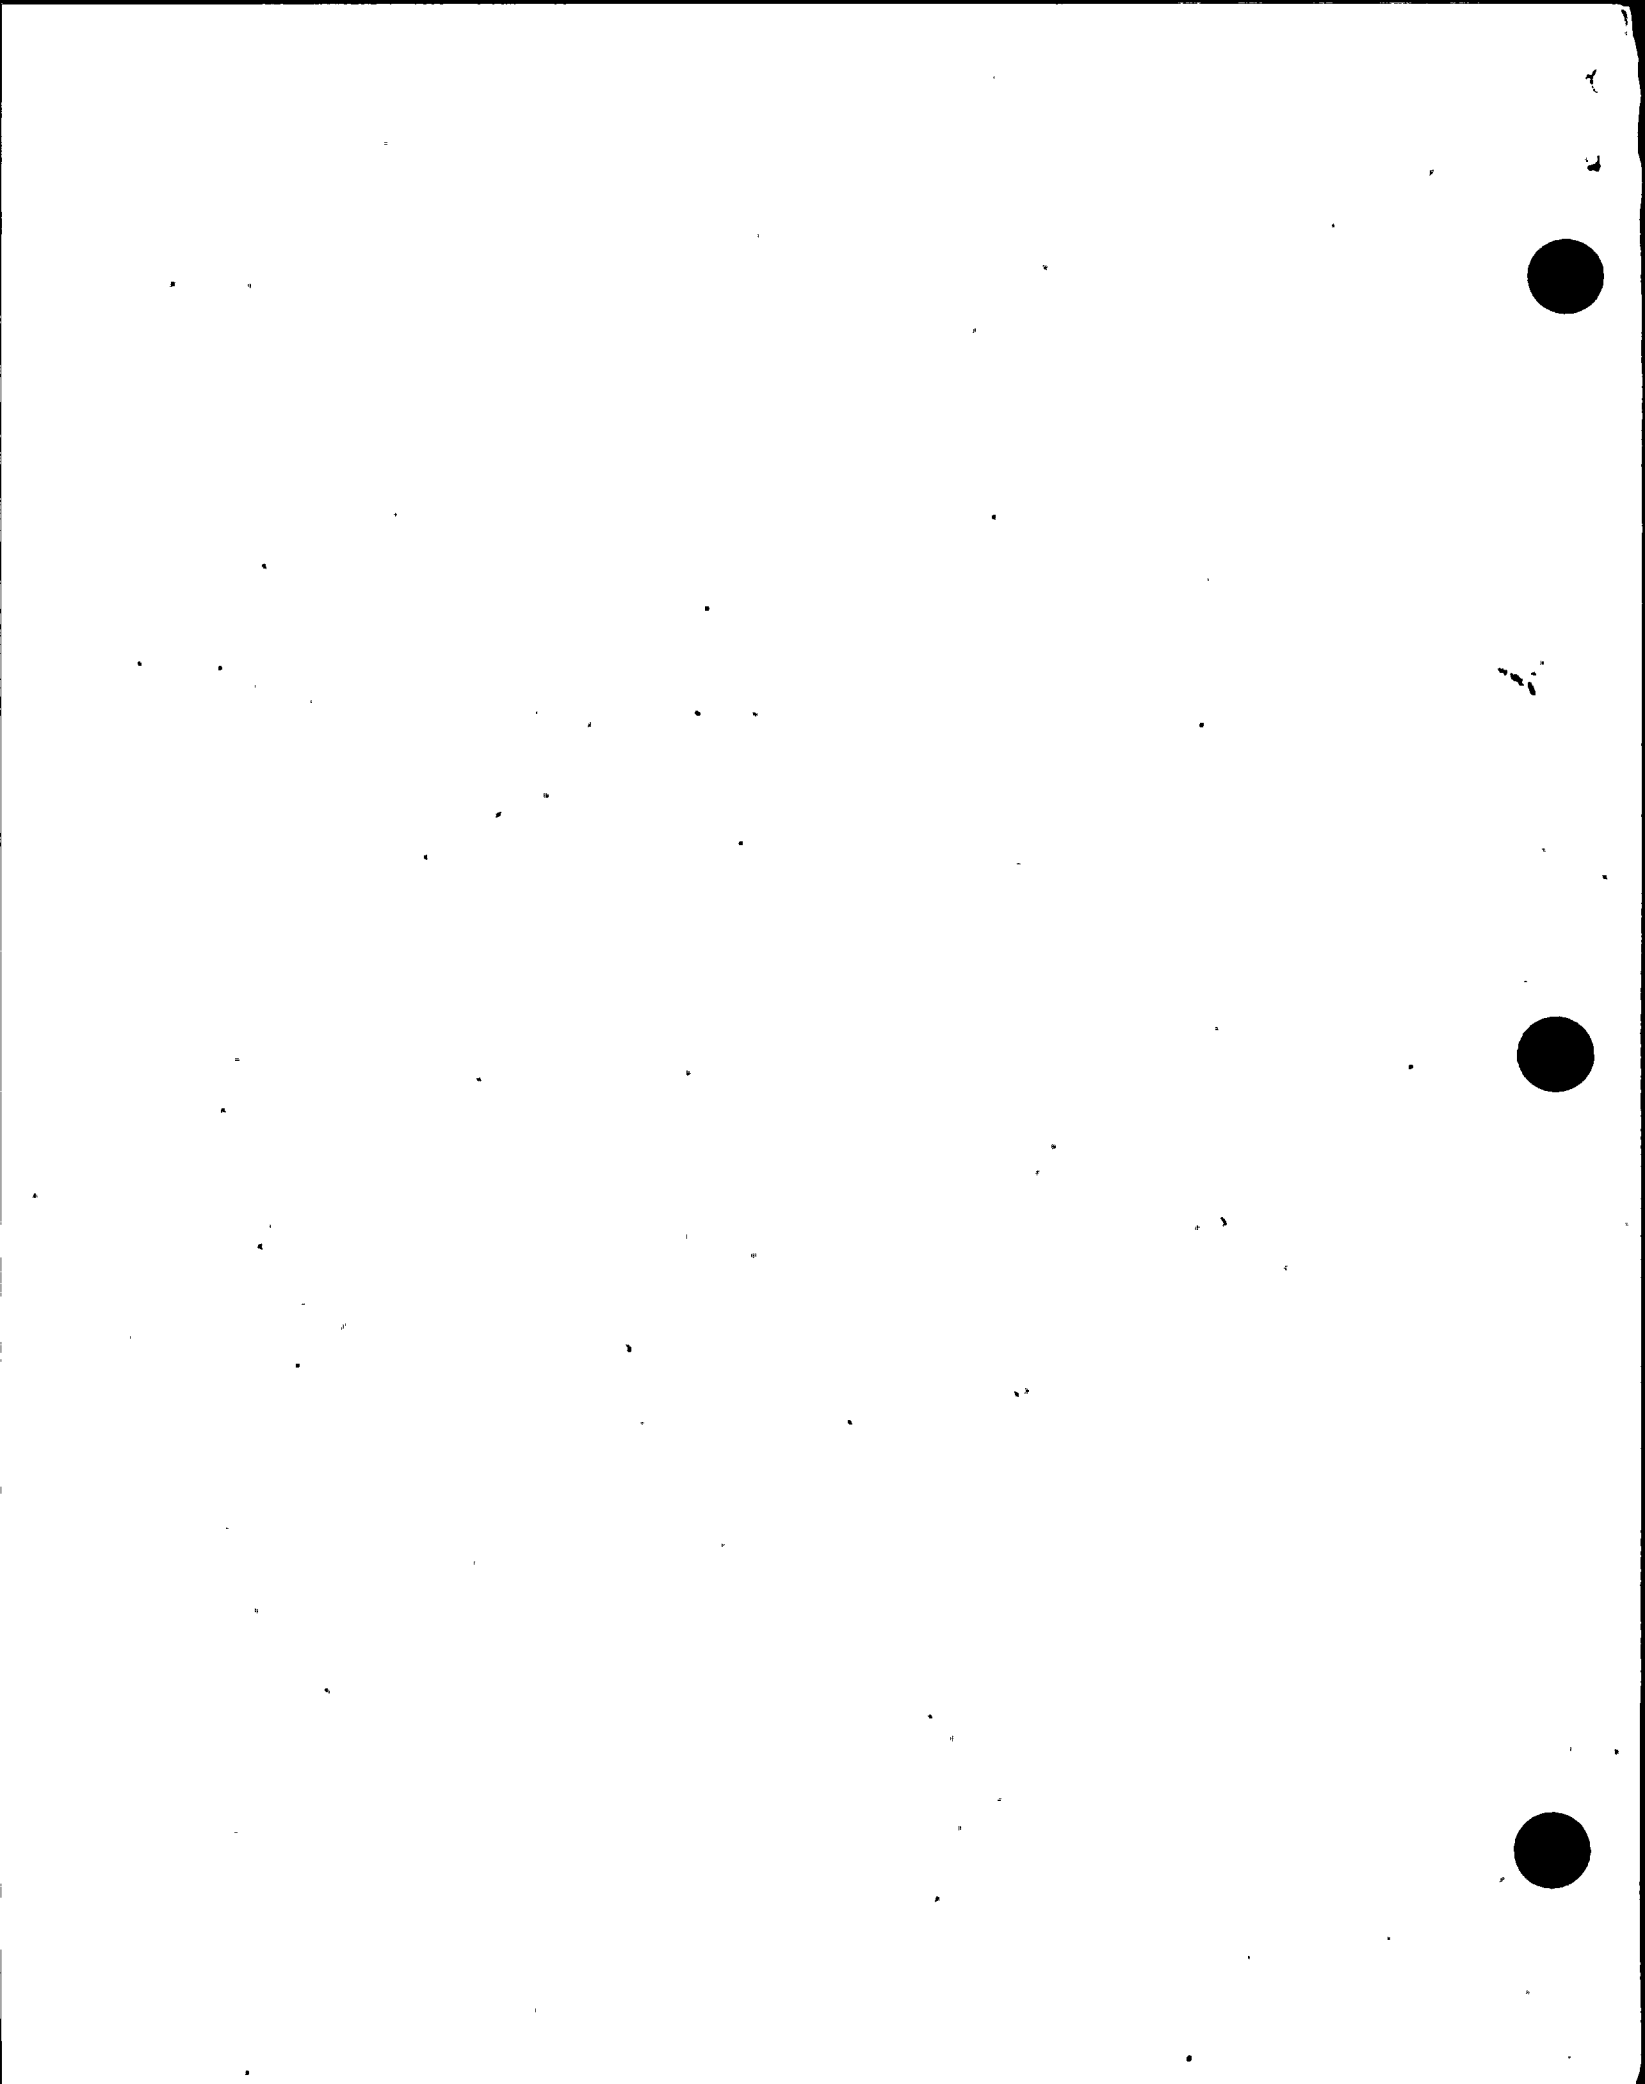

John H. Mueller

2

cc w/copy of Licensee's Response Letter:

G. Wilson, Senior Attorney

M. Wetterhahn, Winston and Strawn

J. Rettberg, New York State Electric and Gas Corporation

C. Donaldson, Esquire, Assistant Attorney General, New York Department of Law

J. Vinqvist, MATS, Inc.

P. Eddy, Electric Division, Department of Public Service, State of New York

**F. Valentino, President, New York State Energy Research
and Development Authority**

**J. Spath, Program Director, New York State Energy Research
and Development Authority**



34



John H. Mueller

3

Distribution w/copy of Licensee's Response Letter:

Region I Docket Room (with concurrences)

Nuclear Safety Information Center (NSIC)

PUBLIC

B. McCabe, RI EDO Coordinator

B. Norris - Nine Mile Point

S. Bajwa, NRR

D. Hood, NRR

M. Campion, RI

L. Doerflein, DRP

B. Cook, DRP

R. Junod, DRP

Inspection Program Branch (IPAS)

DOCDESK

DOCUMENT NAME: A:\RL980505.NMP

To receive a copy of this document, indicate in the box: "C" = Copy without attachment/enclosure "E" = Copy with attachment/enclosure "N" = No copy

OFFICE	RI/DRP		RI/DRP
NAME	WCook <i>W</i>		LDoerflein <i>L</i>
DATE	10/6/98		10/9/98

OFFICIAL RECORD COPY

