

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM
 REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9001050076 DOC. DATE: 89/12/28 NOTARIZED: NO DOCKET #
 FACIL: 50-220 Nine Mile Point Nuclear Station, Unit 1, Niagara Powe 05000220
 50-410 Nine Mile Point Nuclear Station, Unit 2, Niagara Moha 05000410
 AUTH. NAME AUTHOR AFFILIATION
 TERRY, C.D. Niagara Mohawk Power Corp.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Informs of delay in response to Generic Ltr 89-10,
 "Safety-Related Motor-Operated Valve..." for stated reason.

DISTRIBUTION CODE: A064D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: _____
 TITLE: Response to Generic Ltr 89-10, "Safety-Related MOV Testing & Surveillance"

NOTES:

	RECIPIENT		COPIES		
	ID CODE/NAME	LTR	ENCL		
	PDI-1 LA	1	0		
	MARTIN, R.	1	1		
INTERNAL:	ACRS	1	1		
	NRR/DET/ECMB 9H	1	1		
	<u>REG FILE</u>	1	1		
EXTERNAL:	LPDR	1	1		
	NSIC	1	1		
	PDI-1 PD	1	1		
	BENEDICT, R	1	1		
	NRR ROSS, T	1	1		
	NUDOCS-ABSTRACT	1	1		
	NRC PDR	1	1		


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 12 ENCL 1

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S

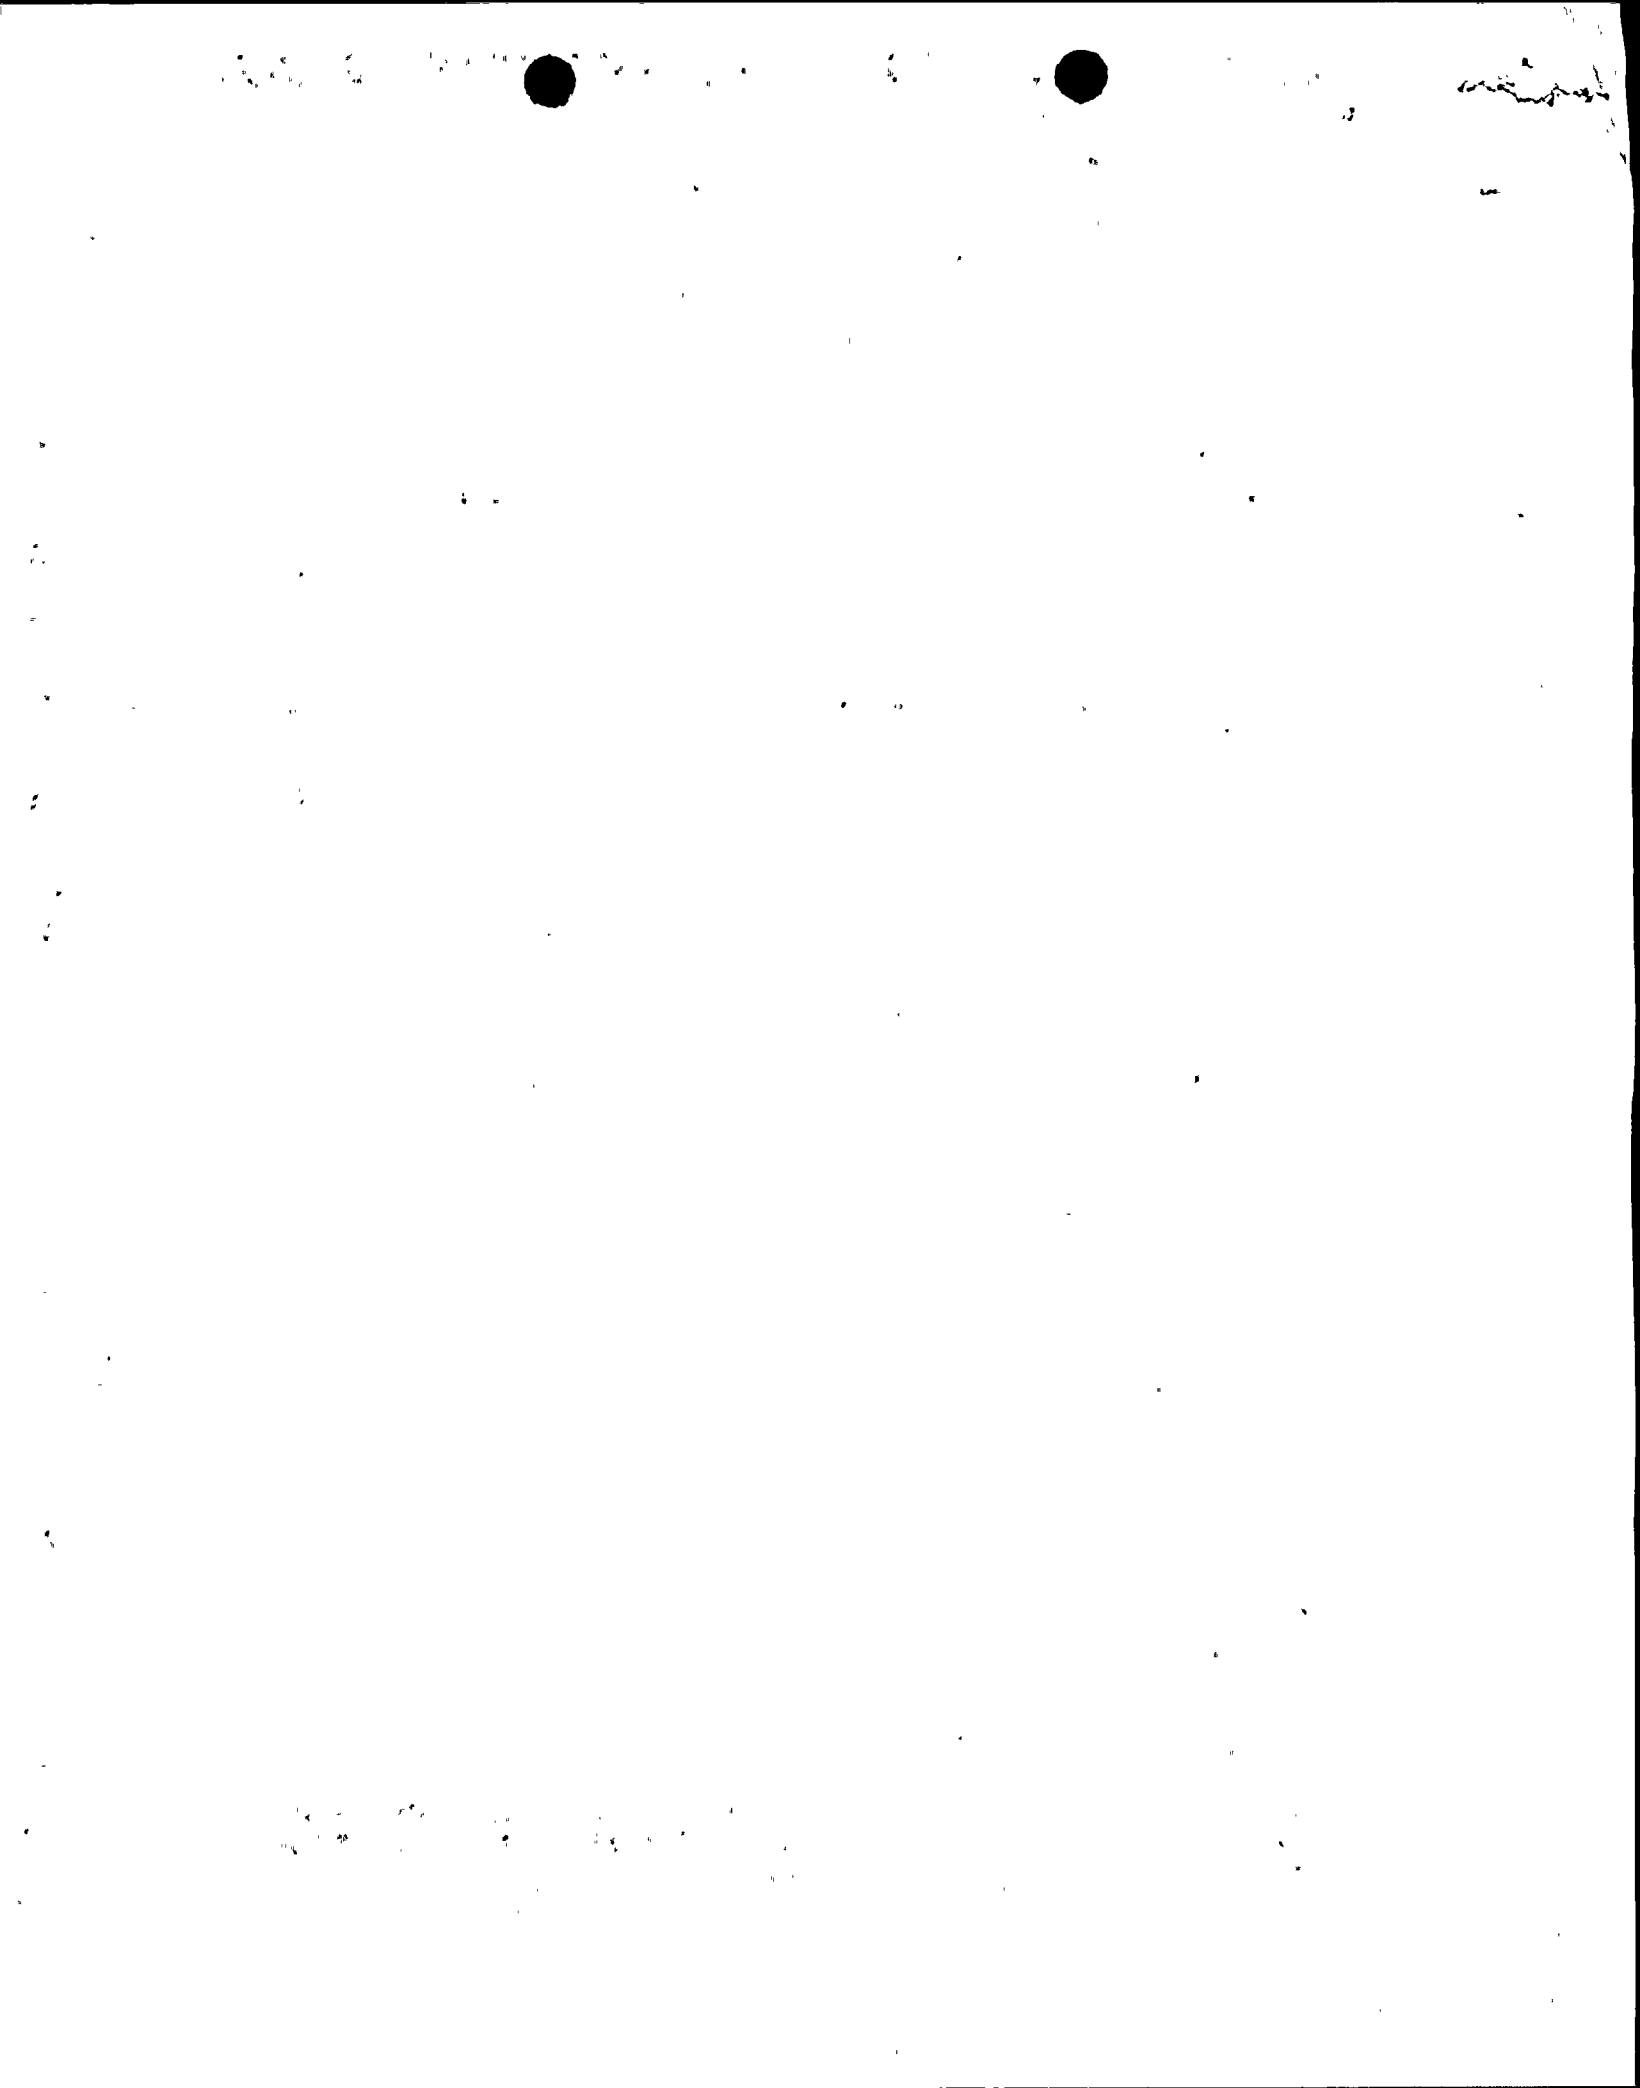

**NY NIAGARA
MOHAWK**

NIAGARA MOHAWK POWER CORPORATION/301 PLAINFIELD ROAD, SYRACUSE, N.Y. 13212/TELEPHONE (315) 474-1511

December 28, 1989
NMPIL 0468

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D.C. 20555

Re: Nine Mile Point Unit 1
Docket No. 50-220
DPR-63

Re: Nine Mile Point Unit 2
Docket No. 50-410
NPF-69

Gentlemen:


This letter responds to Generic Letter 89-10, "Safety-Related Motor-Operated Valve Testing and Surveillance", dated June 28, 1989, which required a reply by December 28, 1989.

The BWR Owner's Group is developing a generic BWR position addressing the requirements of Generic Letter 89-10. The BWR Owner's Group generic program will form a sound technical basis for the development of a plant specific response to the letter. The BWR generic position is scheduled for completion by about November 30, 1990.

Therefore, we will delay our response to Generic Letter 89-10 for both Nine Mile Point Units until the BWR Owner's Group generic program is completed and the Nuclear Regulatory Commission's appraisal of that program is reviewed by Niagara Mohawk. We propose to submit a response six months after issuance of the Nuclear Regulatory Commission's position on the BWR Owner's Group program.

Very truly yours,

NIAGARA MOHAWK POWER CORPORATION


C. D. Terry
Vice President
Nuclear Engineering and Licensing

MJS/mjd
8106G

xc: Regional Administrator, Region I
Mr. R. A. Capra, Director
Mr. R. E. Martin, Project Manager
Mr. W. A. Cook, Resident Inspector
Records Management

9001050076 891228
PDR ADOCK 05000220
P PNU

A06A
40

Handwritten mark or signature in the top right corner.



Several lines of extremely faint, illegible text or markings in the upper middle section of the page.