
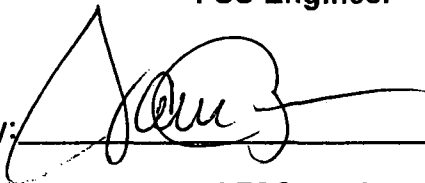


Rancho Seco
Final Status Survey Summary Report
December 1, 2016
IOSB Storage Cell E-2
Survey Unit F8300293

Prepared By:  Date: 12.1.16

FSS Engineer

Reviewed By:  Date: 12.1.16

Lead FSS Engineer

Approved By:  Date: 12/14/16

Manager, Rancho Seco Assets

FINAL STATUS SURVEY F8300293

Survey Unit:

F8300293, Interim Onsite Storage Building (IOSB) Storage Cell E-2

Survey Unit Description:

Operating History: Designed primarily to store packaged radioactive waste containers safely, protected from the elements, and maintain radiological dose as low as reasonably achievable (ALARA), each storage cell possibly stored media of many types, including filters, resins, contaminated chemicals, DAW, activated reactor components, contaminated plant components and other contaminated items.

Site Characterization: Static measurements were made of the interior surfaces of the storage cell, to confirm the absence or presence of plant-derived radionuclides. Static measurements showed a mean gross activity level of 3,095 dpm/100 cm² and a maximum value of 3,565 dpm/100 cm². Based on the levels of gross activity reported, the area was determined to be a Class 3 area.

Survey Unit Design Information:

The Survey Unit Design Parameters are presented in **Table 1** below. The survey unit and measurement locations are depicted on the maps in **Attachment 1**. Static measurement locations were randomly determined and approximately 27% of the area scanned. The instrumentation used for the survey along with the MDC values are listed in **Table 2-1 Attachment 2**.

FINAL STATUS SURVEY F8300293

Table 1, Survey Unit Design Parameters

Evaluation Input Values		Comments
Survey Package:	F830	Storage Cell E-2
Survey Unit:	029	
Class	3	
SU Area (m ²)	28	
Evaluator:	JR	
DCGL _w :	43,000	Gross Activity DCGL
Area Factor	N/A	Class 3
Design DCGL _{emc} (dpm/100cm ²):	N/A	Class 3
DCGL _{emc} :	N/A	Class 3
LBGR:	21,500	Default = 50% DCGL
Sigma:	197	Scoping Survey Data
Type I error:	0.05	
Type II error:	0.05	
Predominant Nuclide	Cs-137	
Sample Area (m ²)	N/A	
Total Instrument Efficiency:	0.129	
Total Area Scanned (m ²):	7.51	
Scan Coverage (%)	27%	Class 3
Material Type:	N/A	Choosing 'N/A' sets material background to "0"
Calculated Values		Comments
Z _{1-α} :	1.645	
Z _{1-β} :	1.645	
Sign p:	0.99865	
Calculated Relative Shift:	109.1	
Relative Shift Used:	3.0	Uses 3.0 if Relative Shift >3
N-Value:	11	
N-Value+20%:	14	

FINAL STATUS SURVEY F8300293

Survey Results:

A total of 15 direct measurements were made in F8300293. The results of the static measurements are shown in **Table 2**. All of the static measurements were less than the DCGL. None of the scan measurements indicated areas of elevated activity. Swipe data did not indicate elevated activity levels above the MDA.

Table 2, Static Measurement Results

Number	Sample #	Beta (cpm)	Beta (dpm)
1	F8300293X00001	298	2,258
2	F8300293X00002	269	2,038
3	F8300293X00003	233	1,765
4	F8300293X00004	249	1,886
5	F8300293X00005	282	2,136
6	F8300293X00006	220	1,667
7	F8300293X00007	283	2,144
8	F8300293X00008	250	1,894
9	F8300293X00009	307	2,326
10	F8300293X00010	275	2,083
11	F8300293X00011	278	2,106
12	F8300293X00012	277	2,098
13	F8300293X00013	267	2,023
14	F8300293X00014	289	2,189
15	F8300293X00015	253	1,917

Table 3 contains the statistical summary of the static measurement data for the Storage Cell E-2

Table 3, Beta Summary Statistics

<i>Beta Static E-2</i>	
Mean	2,035
Median	2,083
Standard Deviation	180
Minimum	1,667
Maximum	2,326
Count	15

FINAL STATUS SURVEY F8300293

Survey Unit Data Assessment:

The survey design required 14 static measurements for the Sign Test. A total of 15 static measurements were collected. The critical value and the results of the Sign Test are presented in **Table 4**. The sample mean and median values were less than the DCGL.

Table 4, Data Assessment Results

Static Data Values		Comments
Number of Samples:	15	
Median:	2,083	
Mean:	2,035	
Static Data Standard Deviation:	180	
Maximum:	2,326	
Sign Test Results		Comments
Adjusted N Value:	14	
S+ Value:	15	
Critical Value:	10	
Criteria Satisfaction		Comments
Sufficient samples collected:	Pass	
Maximum value <DCGL _w :	Pass	
Median value <DCGL _w :	Pass	
Mean value <DCGL _w :	Pass	
Maximum value <DCGL _{emc} :	N/A	
Sign test results:	Pass	
Final Status		Comments
The survey unit passes all conditions:	Pass	

Survey Unit Investigations and Results:

No investigations were required for either direct or scan measurements and no investigation results are reported.

ALARA Statement:

As stated in Chapter 4 of the LTP, as long as the residual activity within the survey unit is less than the DCGL, the ALARA criterion has been met.

Changes in Initial Survey Unit Assumptions:

The survey unit was designed as a Class 3 survey and the sample results are consistent with that classification. The variability of the survey results was less than the characterization data used for survey design. No potential areas of elevated activity were detected.

FINAL STATUS SURVEY F8300293

Conclusion:

The FSS of this survey unit was properly designed as a Class 3 survey based on the results of the scoping survey. The required number of direct measurements was made and the scan coverage met the requirement of Table 5-6 of the LTP. All of the static measurements were less than the DCGL. No investigations were required.

The static measurement data support rejection of the null hypothesis, providing high confidence that the survey unit satisfied the release criteria and that the data quality objectives were met.


It is concluded that survey unit F8300293 meets the release criteria of 10CFR20.1402.

Attachment 1

Maps

December 1, 2016

Survey Unit F8300293

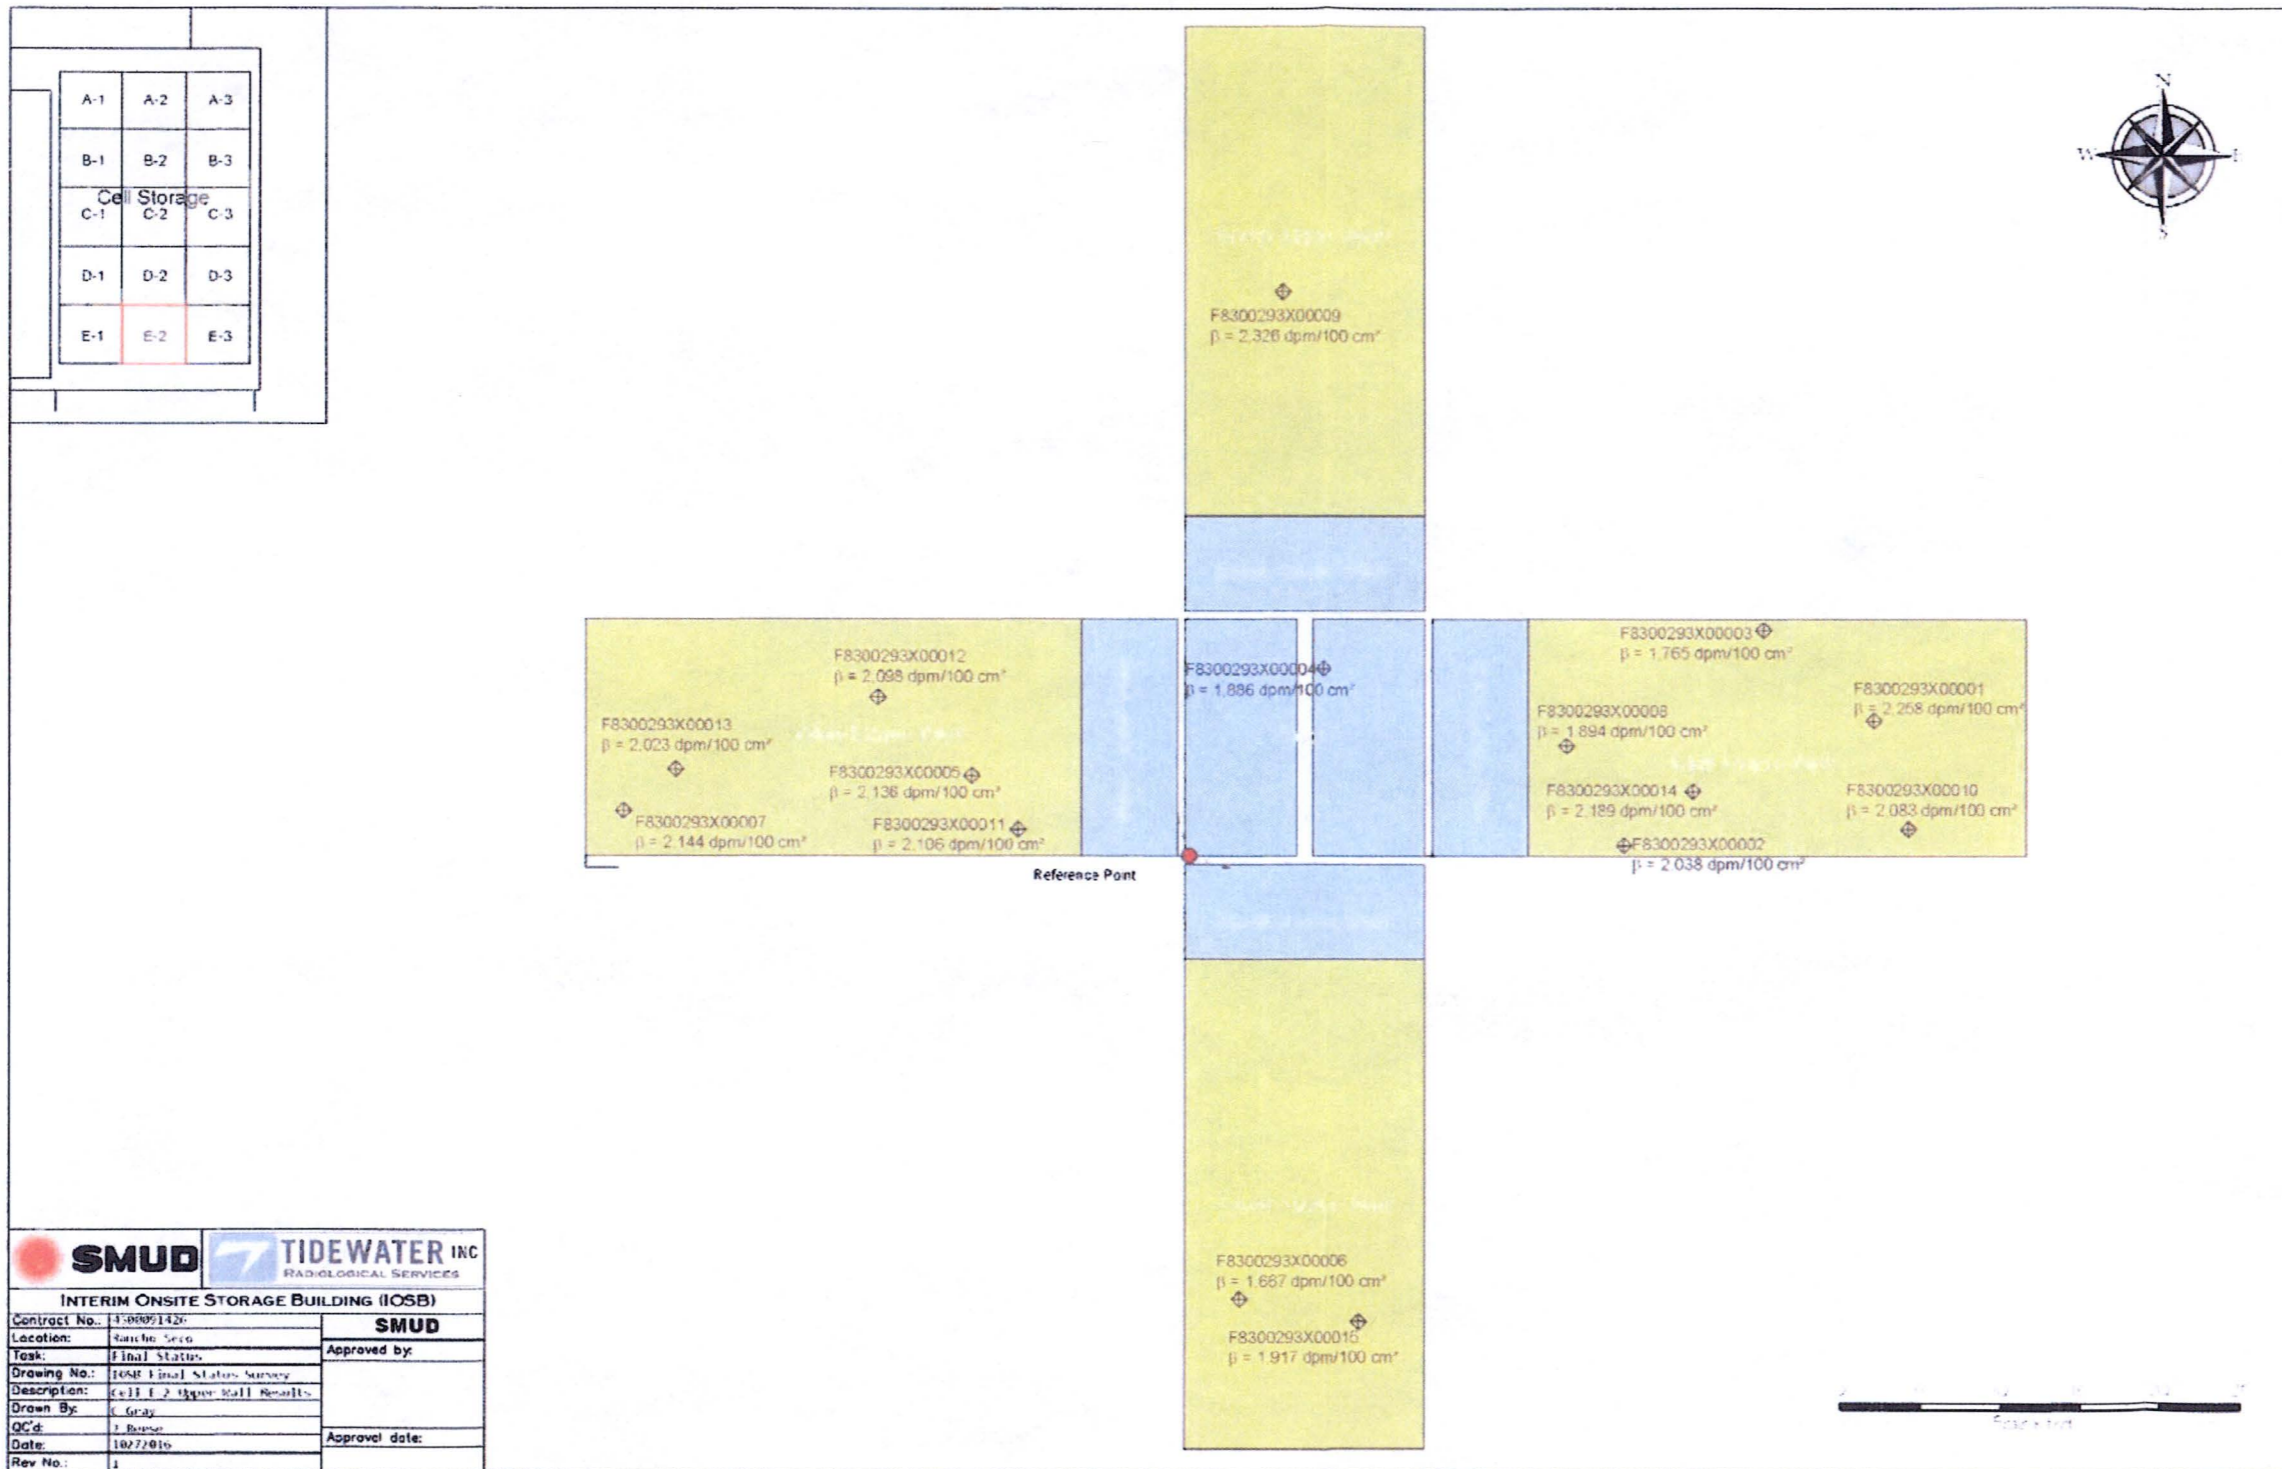

INTERIM ONSITE STORAGE BUILDING (IOSB)	
Contract No.: 15-00891420	SMUD
Location: Rancho Seco	Approved by:
Task: Final Status	
Drawing No.: 1648 Final Status Survey	
Description: Cell 1-2 Upper Wall Results	
Drawn By: J. Gray	
QC'd: J. Berman	Approval date:
Date: 10/22/16	
Rev No.: 1	

Attachment 2
Instrumentation
December 1, 2016
Survey Unit F8300293

Table 2-1. Survey Unit Instrumentation

Measurement Type	Instrument Type	Minimum Detectable Activity ^a	Detector Efficiencies	Calibration Due Date ^b
Beta Static Measurement	Ludlum Model 2350-1	Beta – 704 dpm/100 cm ²	13.2%	317897/331972 2/10/17
	Ludlum Model 44-116 B Detector			
Swipe Measurements	Ludlum Model 2929	Alpha – 3 dpm/100 cm ²	36.9%	166716/170380 11/3/16
	Ludlum Model 44-10-1	Beta – 76 dpm/100 cm ²	42.8%	

^a Minimum detectable activities for the count rate instrumentation were calculated in accordance with NUREG-1507, "Minimum Detectable Concentrations with Typical Radiation Survey Instruments for Various Contaminants and Field Conditions" (U.S. NRC, 1997).

^b Detectors are required to be calibrated once every 12 months. Calibration due date indicates the date by which the detector must be calibrated again.

cm² = square centimeters
 cpm = counts per minute
 dpm = disintegrations per minute

Static Measurement MDA

Variables

Beta Survey Type
PR331972 Detector Number
374 Background count rate (cpm)
1 Count Time (min)
0.132 Efficiency
100 Area of Detector (cm²)

Constants

60 sec/min
2.54 cm/in

Assumptions

Background count time and sample count time are equivalent

Calculate Static MDA

Static MDA = $3 + 4.65(B_r * t)^{0.5} / t * E * A / 100$ (NUREG 1507)

Where: B_r Background Countrate
 t Count Time (min)
 E Efficiency
 A Area of detector (cm²)

Static MDA 704 dpm/100 cm²

Attachment 3
Investigation
October 11, 2016
Survey Unit F8300293

(none required)

Attachment 4

Data Assessment

December 1, 2016

Survey Unit F8300293

