

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8503040309 DOC. DATE: 85/02/28 NOTARIZED: NO DOCKET #  
 FACIL: 50-275 Diablo Canyon Nuclear Power Plant, Unit 1, Pacific Gas ~~05000275~~  
 50-323 Diablo Canyon Nuclear Power Plant, Unit 2, Pacific Gas 05000323  
 AUTH. NAME AUTHOR AFFILIATION  
 SHIFFER, J.D. Pacific Gas & Electric Co.  
 RECIP. NAME RECIPIENT AFFILIATION  
 KNIGHTON, G. Licensing Branch 3

SUBJECT: Informs that technical support ctr (TSC) & emergency operations facility (EOF) now functional, per util 840430 commitment & Suppl 1 to NUREG-0737. TSC & EOF serve Units 1 & 2. Unit 2 SPDS installed & will be operable by 850308.

DISTRIBUTION CODE: A003D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1  
 TITLE: OR/Licensing Submittal: Suppl 1 to NUREG-0737 (Generic Ltr 82-33)

NOTES: J Hanchett 1cy PDR Documents. 05000275  
 OL: 09/22/81.  
 J Hanchett: 1cy PDR Documents. 05000323

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	NRR LB3 BC	7		
INTERNAL:	ADM/LFMB	1	IE/DEPER/EPB	3
	NRR PAULSON, W	1	NRR/DHFS/HFEB	5
	NRR/DHFS/PSRB	1	NRR/DL/ORAB	1
	NRR/DL/ORBS	5	NRR/DSI/CPB	1
	NRR/DSI/ICSB	1	NRR/DSI/METB	1
	NRR/DSI/RAB	1	NRR/DSI/RSB	1
	<del>REG FILES</del>	1	RGNS	1
	RGN2/DRSS/EPRPB	1		
EXTERNAL:	LPDR	2	NRC PDR	1
	NSIC	1		
NOTES:		1		



PACIFIC GAS AND ELECTRIC COMPANY

PG&E + 77 BEALE STREET • SAN FRANCISCO, CALIFORNIA 94106 • (415) 781-4211 • TWX 910-372-6587

JAMES D. SHIFFER  
VICE PRESIDENT  
NUCLEAR POWER GENERATION

February 28, 1985

PGandE Letter No.: DCL-85-087

Mr. George W. Knighton, Chief  
Licensing Branch No. 3  
Division of Licensing  
Office of Nuclear Reactor Regulation  
U. S. Nuclear Regulatory Commission  
Washington, D.C. 20555

Re: Docket No. 50-323  
Diablo Canyon Unit 2  
Operability of EOF and TSC


Dear Mr. Knighton:

On April 30, 1984 (Letter No. DCL-84-165), PGandE supplied an update to the tentative schedules for NUREG-0737, Supplement 1 items. Among those updated schedules were Unit 2 schedules for the Technical Support Center (TSC) and the Emergency Operations Facility (EOF).

The TSC and EOF for Unit 2 are now functional. It should be noted that the TSC is one facility which serves both Units 1 and 2. The same is true for the EOF. The Unit 2 Safety Parameter Display System (SPDS) has been installed and is undergoing testing and adjustment. The SPDS is scheduled to be operable by March 8, 1985. PGandE will inform you when the SPDS is fully operable.

Kindly acknowledge receipt of this material on the enclosed copy of this letter and return it in the enclosed addressed envelope.

Sincerely,

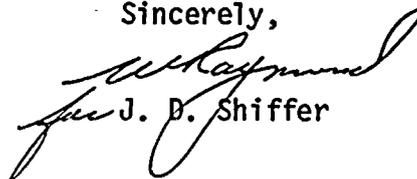  
for J. D. Shiffer

cc: R. T. Dodds  
J. B. Martin  
H. E. Schierling  
Service List

8503040309 850228  
PDR ADDCK 05000275  
F PDR

Aug 3  
/10

