

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8711300125 DOC. DATE: 87/11/23 NOTARIZED: NO DOCKET #  
 FACIL: 50-323 Diablo Canyon Nuclear Power Plant, Unit 2, Pacific Ga 05000323  
 AUTH. NAME AUTHOR AFFILIATION  
 SHIFFER, J. D. Pacific Gas & Electric Co.  
 RECIP. NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)

SUBJECT: Forwards Rev 3 to "Inservice Insp & Testing Program Plan, First 10-Yr Insp Interval, Diablo Canyon Power Plant Unit 2," incorporating listed items, including revised inservice insp boundary drawings & sys pressure test summary.


*SEE REPTS. REVISED 12.14.87 D.E.H.*

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: \_\_\_\_\_  
 TITLE: OR Submittal: Inservice Inspection/Testing

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD5 LA	1 0	PD5 PD	5 <i>2*</i>
	TRAMMELL, C	1 1*		
INTERNAL:	ACRS	10 <i>1*</i>	AEOD/DOA	1 <i>1</i>
	AEOD/DSP/TPAB	1 <i>1</i>	ARM/DAF/LFMB	1 <i>1</i>
	NRR/DEST/MEB	1 <i>1</i>	NRR/DEST/MTB	1 <i>1</i>
	NRR/PMAS/ILRB	1 <i>1</i>	DGC/HDS2	1 <i>1</i>
	<u>REG FILE</u> 01	1 1*	RES/DE/EIB	1 <i>1</i>
EXTERNAL:	LPDR	2 2*	NRC PDR	1 1*
	NSIC	1 1*		

*Limited Dist  
 \* - w/Encl*



PACIFIC GAS AND ELECTRIC COMPANY

PG&E + 77 BEALE STREET • SAN FRANCISCO, CALIFORNIA 94106 • (415) 781-4211 • TWX 910-372-6587

JAMES D. SHIFFER  
VICE PRESIDENT  
NUCLEAR POWER GENERATION

November 23, 1987

PG&E Letter No.: DCL-87-282

U. S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington D.C. 20555

Re: Docket No. 50-323, OL-DPR-82  
Diablo Canyon Unit 2  
Inservice Inspection and Testing Program Plan, Revision 3

Gentlemen:

Enclosed is Revision 3 of the Diablo Canyon Unit 2 Inservice Inspection and Testing Program Plan. Revision 3 is a complete reissue and supersedes all previous revisions. Technical changes from Revision 2 are identified by change bars in the margin.

Revision 3 incorporates the following technical changes: revised ISI boundary drawings, system pressure test summary and IST description to reflect Code Class 2 upgrade of containment penetration piping associated with Code Class 3 and non-safety-related systems; deletion and revision of various relief requests; and revision of Appendix B. These changes are committed to in PG&E letters DCL-86-101, DCL-87-012, DCL-87-079, DCL-87-095, and DCL-87-161. In addition, pipe hanger totals have been updated to reflect changes made as part of the snubber reduction program.

Kindly acknowledge receipt of this material on the enclosed copy of this letter and return it in the enclosed addressed envelope.

Sincerely,

Enclosure


cc w/encs: B. Brown, EG&G Idaho  
J. B. Martin  
P. P. Narbut  
C. M. Trammell (2)  
G. D. Horn, State of California (Controlled Copy No. 66)  
C. Tahnk, Regional Manager, HSB (Controlled Copy No. 20)  
NRC Library (Controlled Copy No. 61)

cc w/o encs: M. M. Mendonca  
B. Norton  
B. H. Vogler  
CPUC  
Diablo Distribution

*Corrected by  
Aoa?  
11*

1755S/0052K/JHA/469

8711300125



REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8711300125      DOC. DATE: 87/11/23      NOTARIZED: NO      DOCKET #  
 FACIL: 50-323 Diablo Canyon Nuclear Power Plant, Unit 2, Pacific Ga      05000323  
 AUTH. NAME      AUTHOR AFFILIATION  
 SHIFFER, J. D.      Pacific Gas & Electric Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Forwards Rev 3 to inservice insp (ISI) & testing program plan, incorporating revised ISI boundary drawings, sys pressure test summary & IST description to reflect Code Class 2 upgrade of containment penetration piping.

DISTRIBUTION CODE: A047D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 3+200  
 TITLE: OR Submittal: Inservice Inspection/Testing

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL		RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	
	PD5 LA	1	0	PD5 PD	5	5
	TRAMMELL, C	1	1			
INTERNAL:	ACRS	10	10	AEOD/DOA	1	1
	AEOD/DSP/TPAB	1	1	ARM/DAF/LFMB	1	0
	NRR/DEST/MEB	1	1	NRR/DEST/MTB	1	1
	NRR/PMAS/ILRB	1	1	OGC/HDS2	1	0
	<u>REG FILE</u> 01	1	1	RES/DE/EIB	1	1
EXTERNAL:	LPDR	2	2	NRC PDR	1	1
	NSIC	1	1			

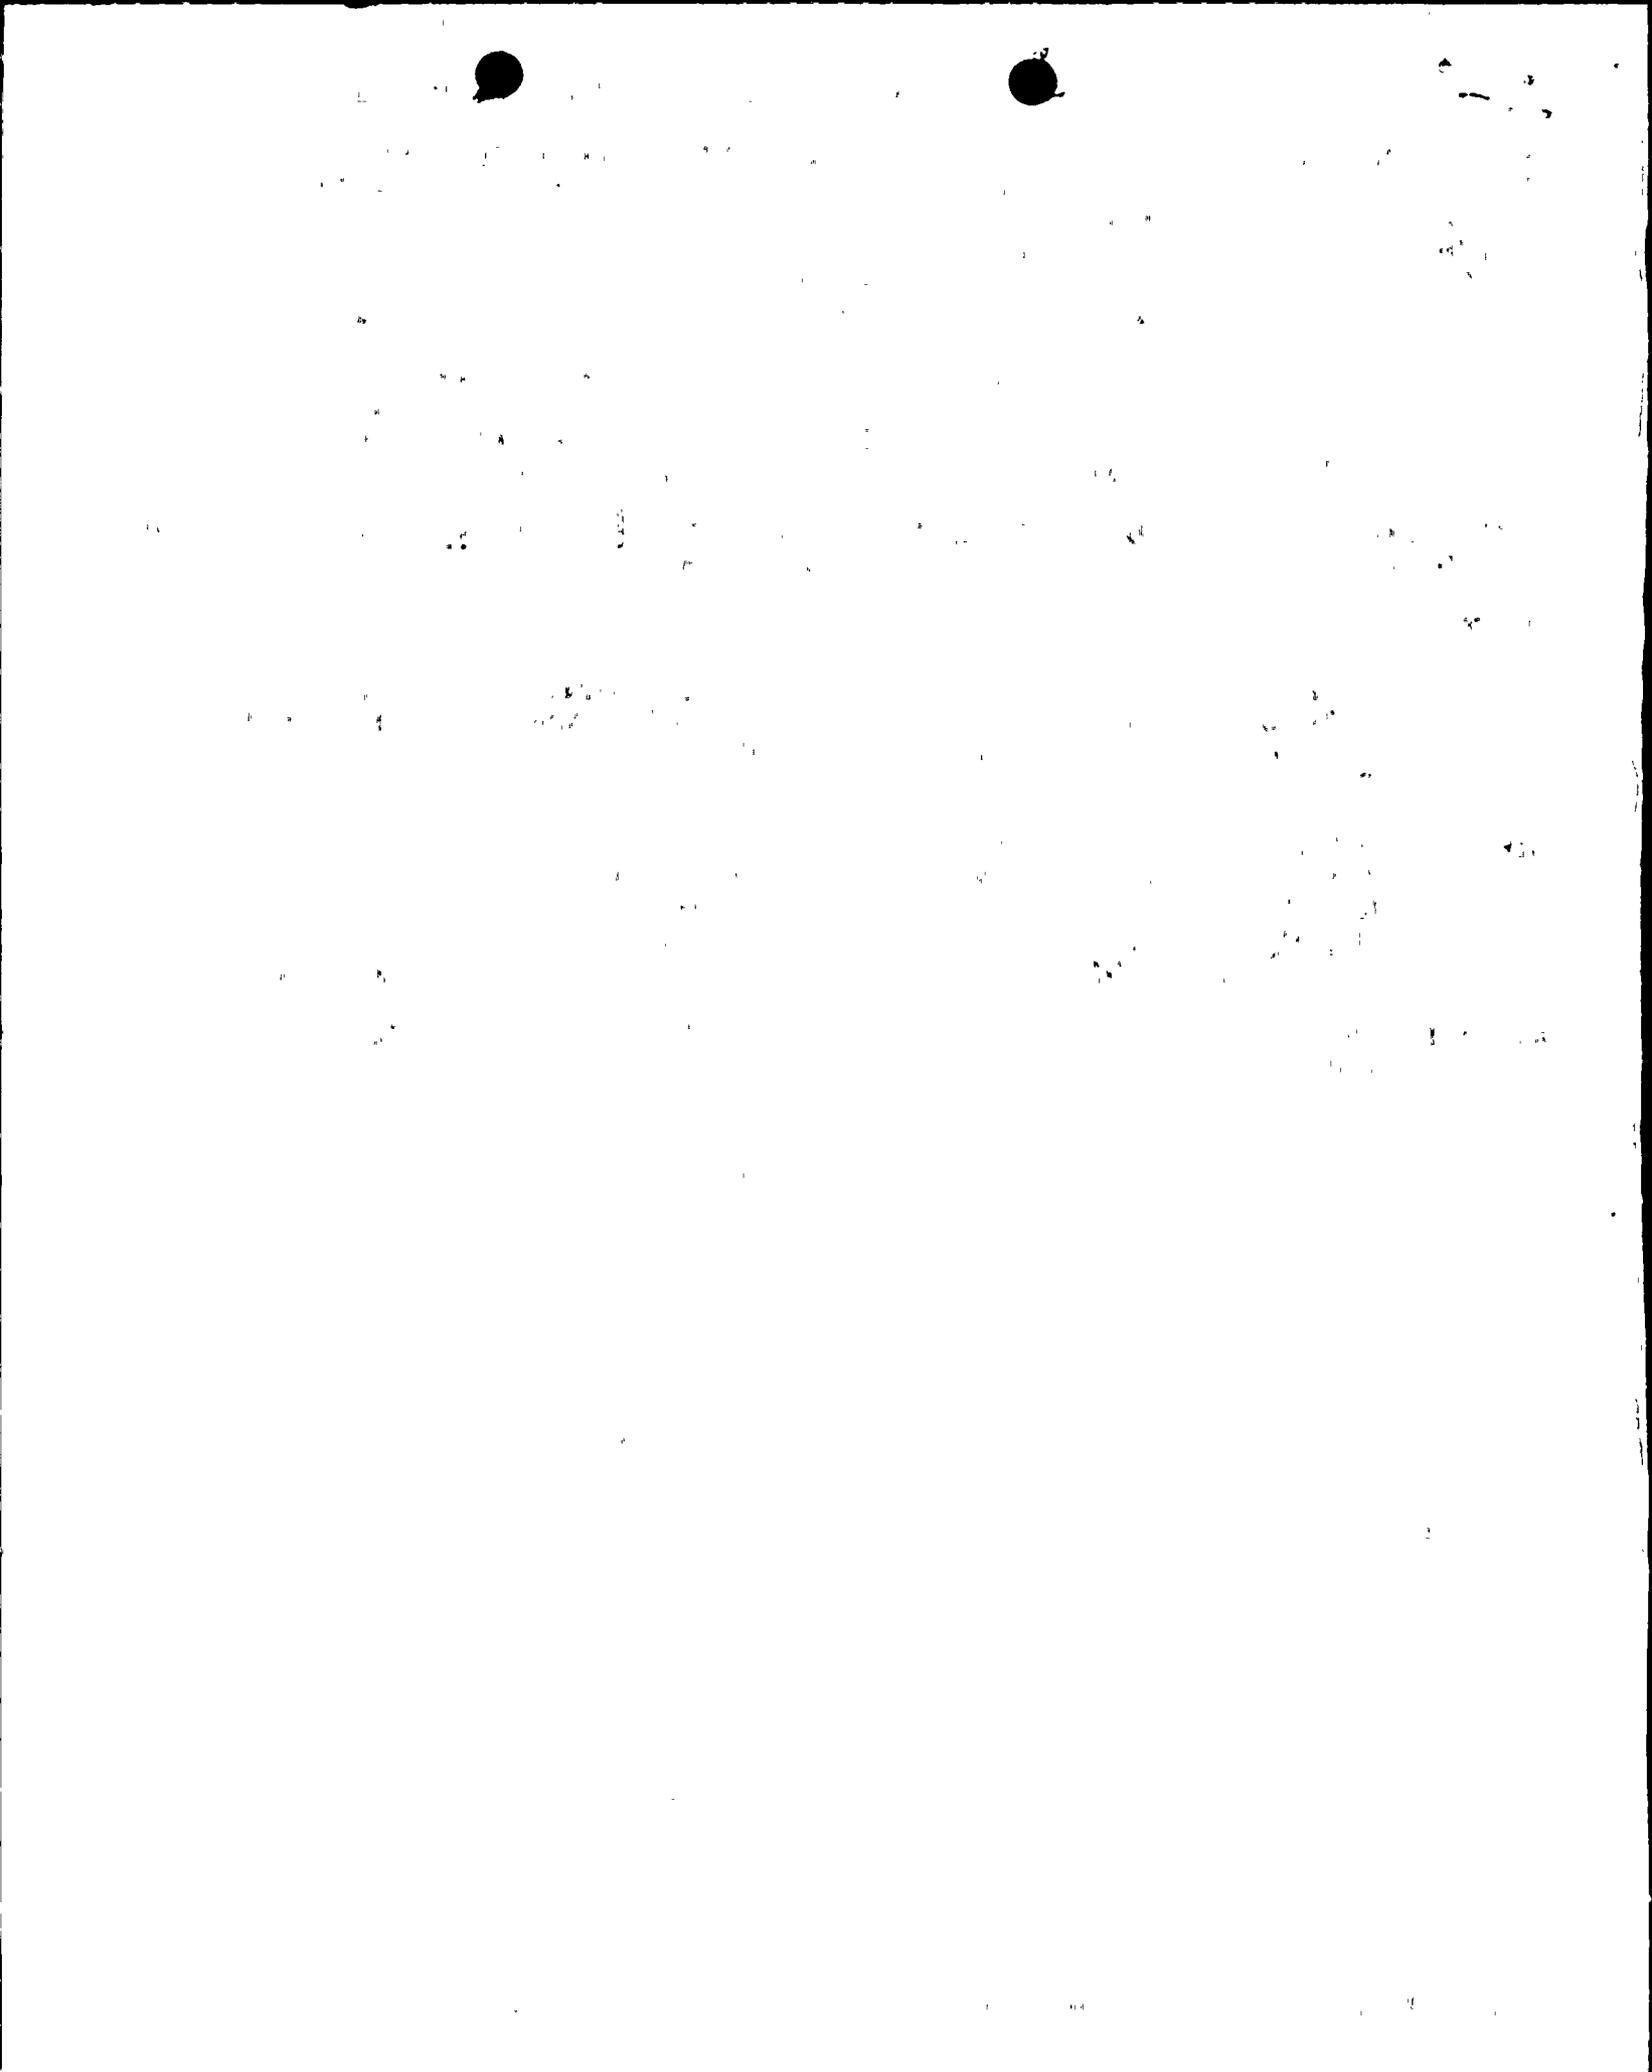

PACIFIC GAS AND ELECTRIC COMPANY

PG&E + 77 BEALE STREET • SAN FRANCISCO, CALIFORNIA 94106 • (415) 781-4211 • TWX 910-372-6587

November 23, 1987

JAMES D. SHIFFER  
VICE PRESIDENT  
NUCLEAR POWER GENERATION

PG&E Letter No.: DCL-87-282

U. S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington D.C. 20555

Re: Docket No. 50-323, OL-DPR-82  
Diablo Canyon Unit 2  
Inservice Inspection and Testing Program Plan, Revision 3

Gentlemen:

Enclosed is Revision 3 of the Diablo Canyon Unit 2 Inservice Inspection and Testing Program Plan. Revision 3 is a complete reissue and supersedes all previous revisions. Technical changes from Revision 2 are identified by change bars in the margin.

Revision 3 incorporates the following technical changes: revised ISI boundary drawings, system pressure test summary and IST description to reflect Code Class 2 upgrade of containment penetration piping associated with Code Class 3 and non-safety-related systems; deletion and revision of various relief requests; and revision of Appendix B. These changes are committed to in PG&E letters DCL-86-101, DCL-87-012, DCL-87-079, DCL-87-095, and DCL-87-161. In addition, pipe hanger totals have been updated to reflect changes made as part of the snubber reduction program.

Kindly acknowledge receipt of this material on the enclosed copy of this letter and return it in the enclosed addressed envelope.

8711300125 871123  
PDR ADOCK 05000323  
Q PDR

Sincerely,


Enclosure

cc w/encs: B. Brown, EG&G Idaho  
J. B. Martin  
P. P. Narbut  
C. M. Trammell (2)  
G. D. Horn, State of California (Controlled Copy No. 66)  
C. Tahnk, Regional Manager, HSB (Controlled Copy No. 20)  
NRC Library (Controlled Copy No. 61)

cc w/o encs: M. M. Mendonca  
B. Norton  
B. H. Vogler  
CPUC  
Diablo Distribution


1755S/0052K/JHA/469

A047  
111



ENCLOSURE

Diablo Canyon Unit 2  
Inservice Inspection and Testing Program Plan  
Revision 3



NUCLEAR PLANT OPERATIONS  
Diablo Canyon Power Plant  
ISI/NDE Department  
420.9

Change to Diablo Canyon Unit 2  
Inspection and Testing  
Program Plan

Date: November 23, 1987

Diablo Canyon Unit 2 ISI and IST Program Plan Receipt Acknowledgement

\* NRC DOCUMENT CONTROL DESK

You have been issued a Controlled Copy of the Diablo Canyon ISI and IST Program Plan. Here is the next sequential revision to the Plan. Please revise your controlled copy as follows:

CHANGE INSTRUCTIONS

Revision 3 is a complete reissue. It contains numerous editorial and typographical corrections plus technical changes as detailed on the "ISI/IST Program Plan Changes" page. Change bars were added only to the substantive and technical changes.

All previous issues plus revisions of the Unit 2 Program Plan are obsolete. Remove all internals, except tabs, from the Program Plan binder and replace with Revision 3. Do the same for any other uncontrolled copies within your purview. The tab printed "List of NDE Calibration Standards" should be marked to read "Appendices."

---

For questions or assistance please phone the Document Control office, PGandE extension 691-4500, Pacific Bell phone (805) 595-4500.

---

After revising your copy of the Program Plan in accordance with these instructions, place the attached change description in the front of the manual behind the controlled copy numbered title page.

Please acknowledge receipt of this revision by signing below and returning this form to:

DOCUMENT CONTROL CENTER  
DIABLO CANYON POWER PLANT  
P.O. BOX 56  
AVILA BEACH, CA. 83424

Date: \_\_\_\_\_ Receipt of Controlled Copy N/A Revision # 3 of the Diablo Canyon Unit 2 ISI and IST Program Plan is hereby acknowledged.

\_\_\_\_\_  
RECIPIENT SIGNATURE

8711300125

REGULATORY DOCKET FILE COPY

THE UNIVERSITY OF CHICAGO



11

11

NUCLEAR PLANT OPERATIONS  
Diablo Canyon Power Plant  
ISI/NDE Department  
420.9

Change to Diablo Canyon Unit 2  
Inspection and Testing  
Program Plan

Date: November 23, 1987

Diablo Canyon Unit 2 ISI and IST Program Plan Receipt Acknowledgement

M NRE DOCUMENT CONTROL DESK

You have been issued a Controlled Copy of the Diablo Canyon ISI and IST Program Plan. Here is the next sequential revision to the Plan. Please revise your controlled copy as follows:

CHANGE INSTRUCTIONS

Revision 3 is a complete reissue. It contains numerous editorial and typographical corrections plus technical changes as detailed on the "ISI/IST Program Plan Changes" page. Change bars were added only to the substantive and technical changes.

All previous issues plus revisions of the Unit 2 Program Plan are obsolete. Remove all internals, except tabs, from the Program Plan binder and replace with Revision 3. Do the same for any other uncontrolled copies within your purview. The tab printed "List of NDE Calibration Standards" should be marked to read Appendices.

---

For questions or assistance please phone the Document Control office, PGandE extension 691-4500, Pacific Bell phone (805) 595-4500.

---

After revising your copy of the Program Plan in accordance with these instructions, place the attached change description in the front of the manual behind the controlled copy numbered title page.

Please acknowledge receipt of this revision by signing below and returning this form to:

Pacific Gas and Electric Company  
Nuclear Regulatory Affairs Department  
333 Market Street/A6-87

ATTN: Correspondence Control

Date: \_\_\_\_\_ Receipt of Controlled Copy N/A Revision # 3 of the Diablo Canyon Unit 2 ISI and IST Program Plan is hereby acknowledged.

\_\_\_\_\_  
RECIPIENT SIGNATURE

