

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8903170093 DOC. DATE: 89/03/07 NOTARIZED: NO DOCKET #
 FACIL: 50-323 Diablo Canyon Nuclear Power Plant, Unit 2, Pacific Ga 05000323
 AUTH. NAME AUTHOR AFFILIATION
 SHIFFER, J.D. Pacific Gas & Electric Co.
 RECIPIENT NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Forwards "Diablo Canyon Unit 2 Inservice Insp Rept."

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+70
 TITLE: OR Submittal: Inservice Inspection/Testing/Relief from ASME Code

NOTES: *See Reports*

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL	ID CODE/NAME		LTR	ENCL
	PD5 LA		1	0	PD5 PD		5	5
	ROOD, H		1	1				
INTERNAL:	ACRS		6	6	AEOD/DSP/TPAB		1	1
	ARM/DAF/LFMB		1	0	NRR/DEST/MEB 9H		1	1
	NRR/DEST/MTB 9H		1	1	NIDQCS ABSTRACT		1	1
	OGC/HDS2		1	0	<u>REG FILE</u> 01		1	1
	RES/DSIR/EIB		1	1				
EXTERNAL:	EG&G BROWN, B		1	1	EG&G ROCKHOLD, H		1	1
	LPDR		1	1	NL 007 HEMMING		1	1
	NRC PDR		1	1	NSIC		1	1


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 27 ENCL 24

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S

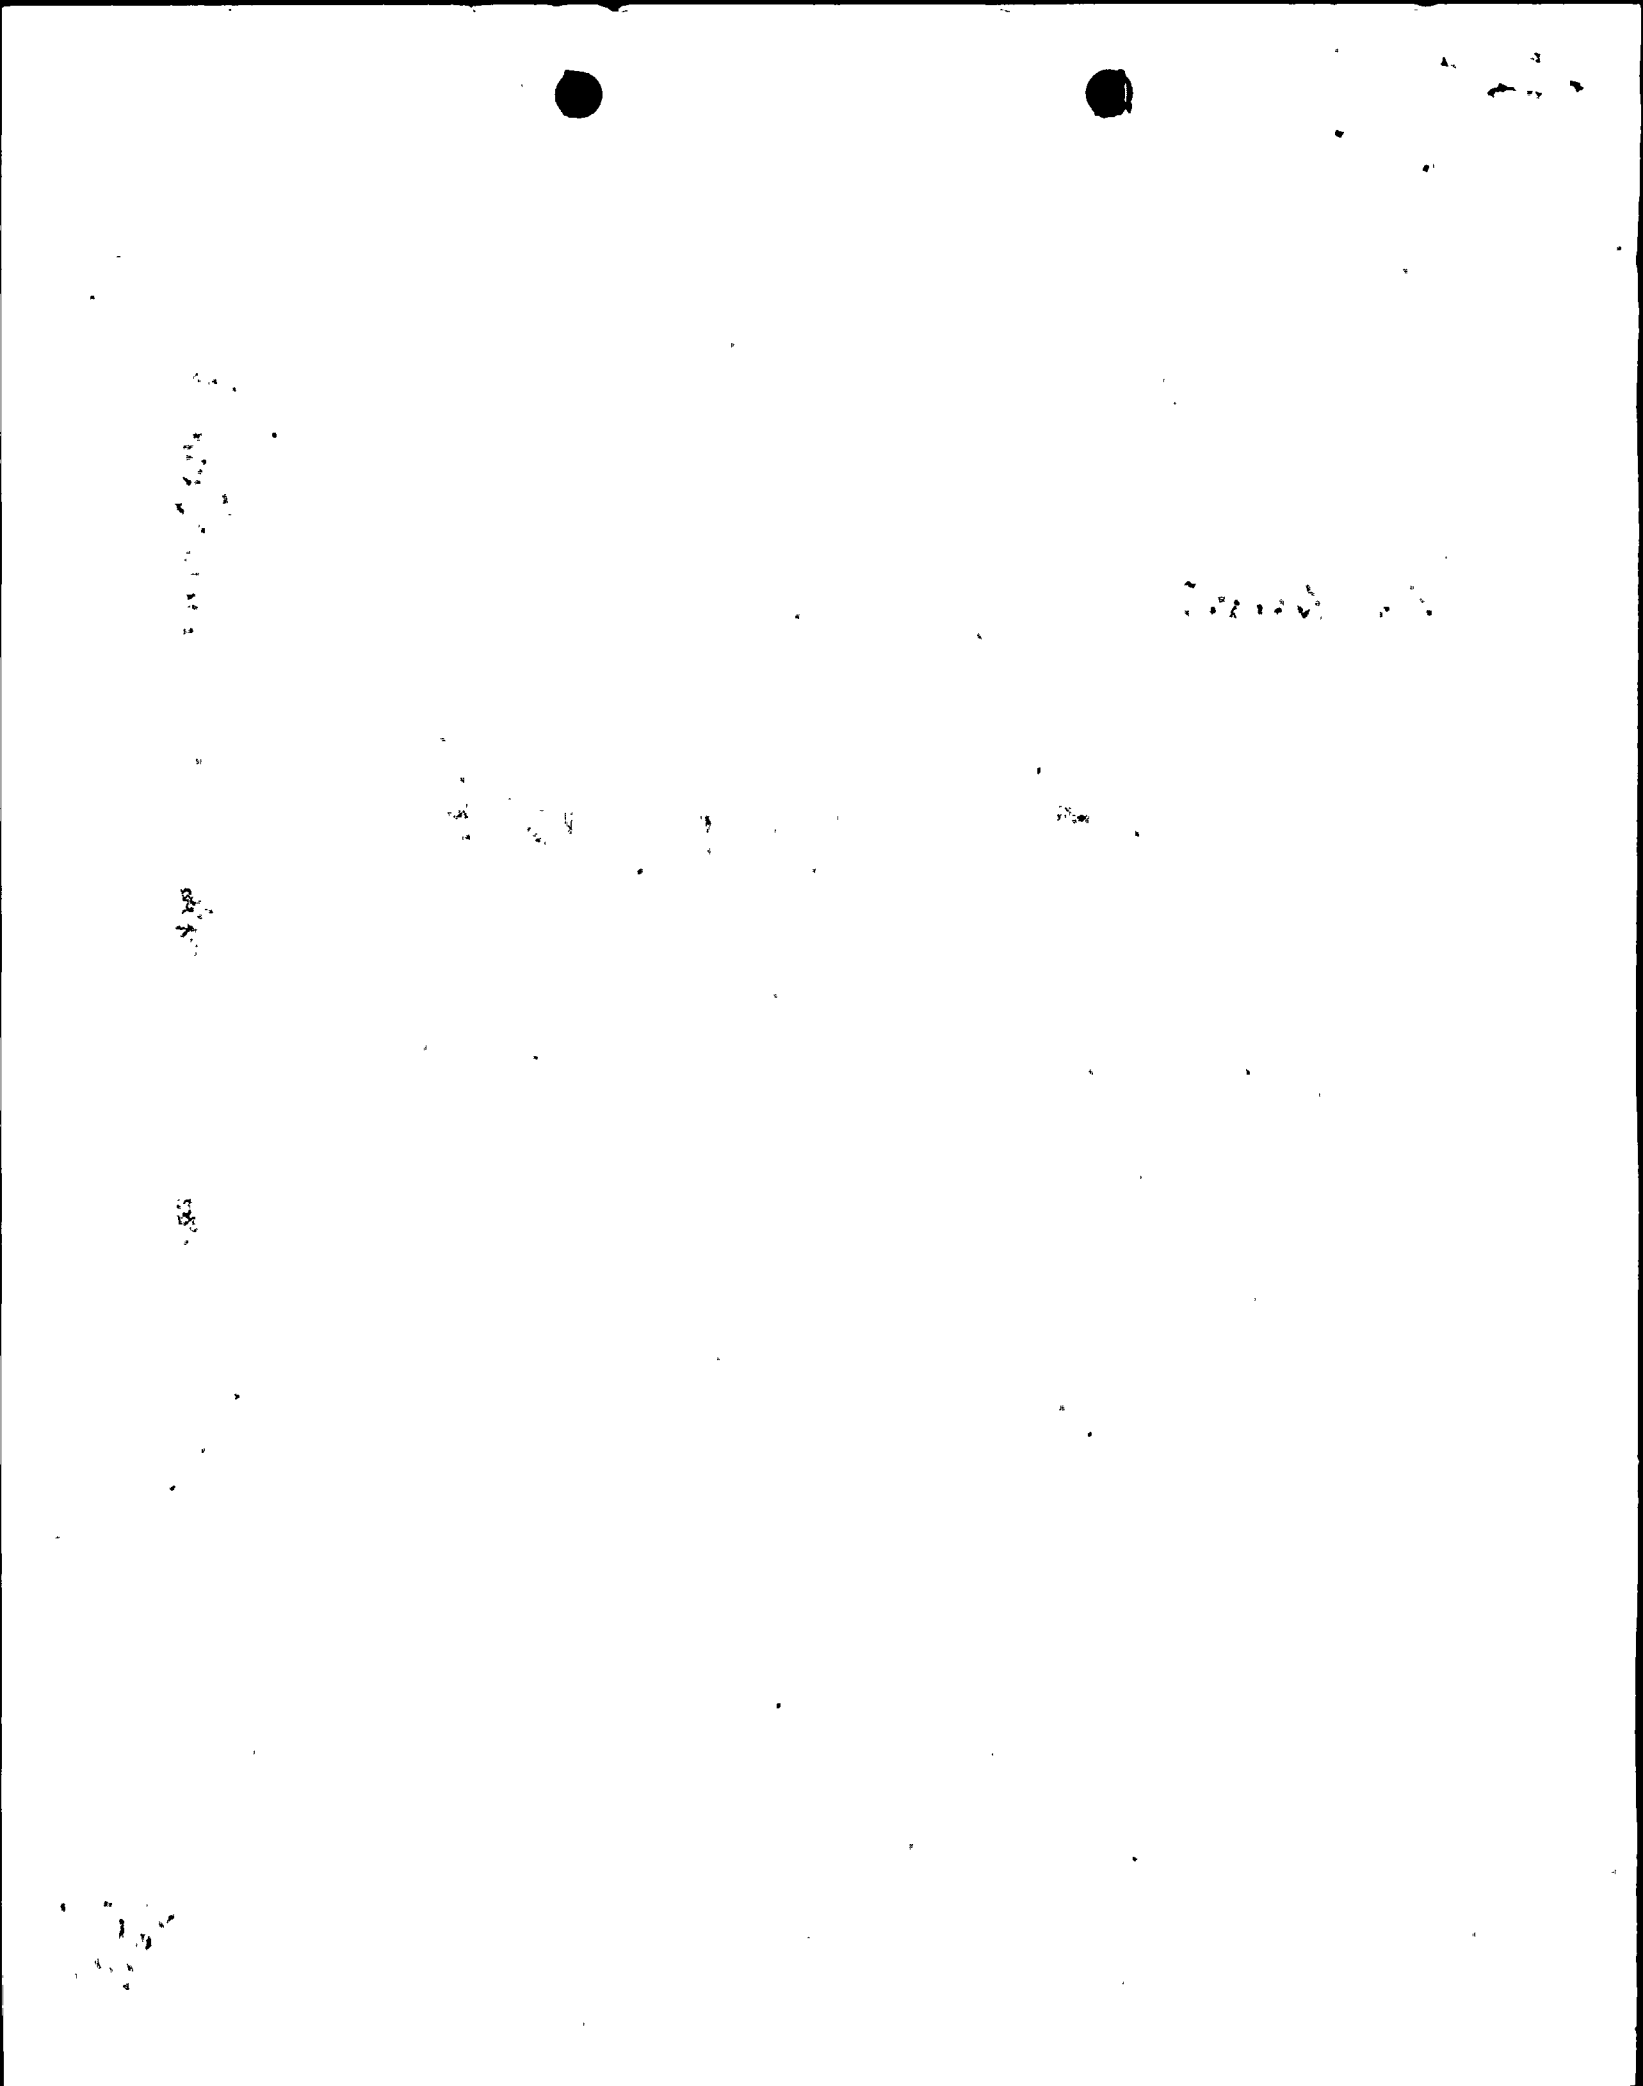

Racific Gas and Electric Company

77 Beale Street
San Francisco, CA 94106
415/972-7000
TWX 910-372-6587

James D. Shiffer
Vice President
Nuclear Power Generation

March 7, 1989

PG&E Letter No. DCL-89-057



U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Re: Docket No. 50-323, OL-DPR-82
Diablo Canyon Unit 2
Inservice Inspection Report

Gentlemen:

In accordance with ASME Section XI, paragraph IWA-6220, enclosed is the Diablo Canyon Unit 2 Inservice Inspection Report which provides the results of inservice inspection of Class 1 and 2 components and their supports conducted during the Unit 2 second refueling outage.

Kindly acknowledge receipt of this material on the enclosed copy of this letter and return it in the enclosed addressed envelope.

Sincerely,

A handwritten signature in cursive script, appearing to read 'J. D. Shiffer'.

J. D. Shiffer


cc: C. Tahnk, Regional Manager, Hartford Steam Boiler
G. D. Horn, State of California Division of Industrial Safety
J. B. Martin
P. P. Narbut
M. M. Mendonca (w/o enc.)
B. Norton (w/o enc.)
B. H. Vogler (w/o enc.)
CPUC (w/o enc.)
Diablo Distribution (w/o enc.)

Enclosure

2524S/0067K/JHA/469

8903170093 890307
PDR ADOCK 05000323
Q PDC

A047
11



ENCLOSURE

DIABLO CANYON POWER PLANT UNIT 2
SECOND REFUELING OUTAGE INSERVICE INSPECTION (ISI) REPORT

8903170093

2524S/0067K

