

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9403150447 DOC. DATE: 94/03/04 NOTARIZED: NO DOCKET #
 FACIL: 50-275 Diablo Canyon Nuclear Power Plant, Unit 1, Pacific Ga 05000275
 AUTH. NAME AUTHOR AFFILIATION
 RUEGER, G.M. Pacific Gas & Electric Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk) *see Reports*

SUBJECT: Forwards, "Inservice Insp Program Plan, First Ten-Year Insp Interval, Rev 8," for Unit 1.

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 37 249
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES		
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL	
	PDV LA		1	0		PDV PD		1	1	
	PETERSON, S		2	2						
INTERNAL:	ACRS		6	6		AEOD/DSP/ROAB		1	1	
	NRR/DE/EMEB		1	1		NRR/EMCB		1	1	
	NUDOCS-ABSTRACT		1	1		OC/LEDGB		1	0	
	OGC/HDS1		1	0		<u>REG FILE</u> 01		1	1	
	RES/DSIR/EIB		1	1						
EXTERNAL:	EG&G BROWN, B		1	1		EG&G RANSOME, C		1	1	
	NRC PDR		1	1		NSIC		1	1	


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 22 ENCL 19

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S



Pacific Gas and Electric Company

77 Beale Street, Room 1451
P.O. Box 770000
San Francisco, CA 94177
415/973-4684
Fax 415/973-2313

Gregory M. Rueger
Senior Vice President and
General Manager
Nuclear Power Generation

March 4, 1994

PG&E Letter No. DCL-94-046



U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Re: Docket No. 50-275, OL-DPR-80
Diablo Canyon Unit 1
Inservice Inspection Program Plan, Revision 8

Gentlemen:

Enclosed for your information is Revision 8 of the Diablo Canyon Power Plant, Unit 1 Inservice Inspection Program Plan. A summary of the changes is also enclosed.

Sincerely,


A handwritten signature in cursive script, appearing to read 'Greg Rueger'.

Gregory M. Rueger


Enclosure

cc: Mary H. Miller (w/o Enc.)
Kenneth E. Perkins (w/o Enc.)
Sheri R. Peterson
Diablo Distribution (w/o Enc.)

6316S/JHA/469

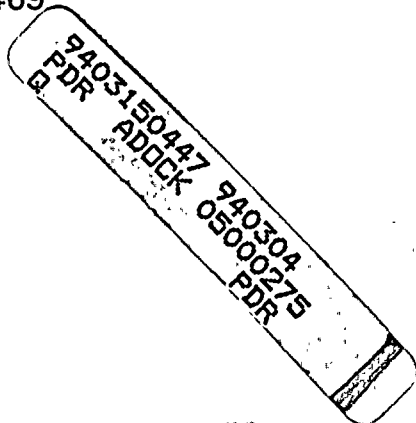

110014



A047

ENCLOSURE

**DIABLO CANYON POWER PLANT
UNIT 1 INSERVICE INSPECTION PROGRAM PLAN, REVISION 8**

SUMMARY OF CHANGES

Configuration Control

This revision updates the list of items being inspected to reflect the current configuration of the facility. A listing of NRC-approved Code Cases that are being invoked is also included. Code Cases are also referenced in appropriate sections to indicate allowed alternatives to ASME Section XI requirements.

Addition of New Relief Requests

This revision incorporates the following new relief requests that were granted in an NRC Safety Evaluation Report (SER) dated September 21, 1992: Nondestructive Examination (NDE) Relief Requests Nos. NDE-006A, NDE-008A, NDE-008B, and NDE-008C; and System Pressure Test Relief Request Nos. 10, 11A, 11B, and 12.

Changes to Existing Relief Requests

This revision incorporates several changes to existing relief requests. In all cases, these changes reflect items that are being withdrawn from the relief request and, as such, these changes do not require NRC review and approval.

- NDE-006: Relief for NDE of stabilizer separator girth welds was withdrawn because the stabilizer separator has been eliminated from the plant design.
- NDE-007: Relief for NDE of boron injection tank (BIT) circumferential welds was withdrawn because the BIT has been eliminated from the plant design.
- NDE-008, NDE-008A, NDE-008B, and NDE-008C: Many welds were withdrawn from these relief requests because PG&E has determined that relief is not required. PG&E originally reported all weld inspection limitations as a relief request, but subsequent guidance indicates that these limitations are within Code allowances and, therefore, relief is not required.
 - a. The following welds were withdrawn because PG&E inspected at least 90 percent of the welds (Code Case N-460 allows a 10 percent reduction in coverage for welds exams):

NDE-008: WIB-RC-2-5, WIB-RC-2-6SE, WIB-RC-2-10, WIB-RC-2-14, WIB-RC-2-9, WIB-401, WIB-442, WIB-383, WIB-68, WIB-124, WIB-289, WIB-319, WIB-16, WIB-83, WIB-361, WIC-27, WIC-1357E, WIC-348, WIC-353



NDE-008B: WIB-57, WIB-236, WIB-77, WIB-338, WIB-48, WIB-168,
WIB-214

NDE-008C: WIC-177

- b. The following welds were withdrawn because PG&E performed a 1-1/2 V scan from one side of the weld (the Code permits using a full or 1-1/2 V scan from one side of a weld if it is not possible to use a 1/2 V scan in both directions normal to the weld):

NDE-008: WIB-RC-3-5SE, WIB-RC-4-5SE, WIB-RC-3-12,
WIB-RC-3-6SE, WIB-RC-4-12, WIB-RC-4-6SE,
WIB-RC-2-18BC, WIB-RC-3-13, WIB-RC-4-13, WIB-408,
WIB-417, WIB-64, WIB-415B, WIB-416A, WIB-432B,
WIB-433A, WIB-422, WIB-444, WIB-71SE,
WIB-RC-2-12, WIB-1, WIB-5, WIB-82, WIB-175,
WIB-151, WIB-267, WIB-276, WIB-321, WIB-RC-2-11,
WIB-248, WIB-171, WIC-9-1, WICG-101A1-4, WIC-184,
WIC-249

NDE-008A: WIB-RC-1-5SE

NDE-008B: WIB-419, WIB-66, WIB-RC-2-4, WIB-39, WIB-157,
WIB-322

- System Pressure Test Relief Request No. 8 - Request for relief for the following lines has been withdrawn because relief was denied in NRC SER dated October 25, 1989: Lines 327, 986, 1161, 1679, 3000, 3001, 3242, 3729, 3935, 3941, and 4353.



