

CATEGORY 1

2nd copy

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9705160069 DOC. DATE: 97/04/30 NOTARIZED: YES DOCKET #
 FACIL: 50-275 Diablo Canyon Nuclear Power Plant, Unit 1, Pacific Ga 05000275
 50-323 Diablo Canyon Nuclear Power Plant, Unit 2, Pacific Ga 05000323
 AUTH. NAME AUTHOR AFFILIATION
 RUEGER, G.M. Pacific Gas & Electric Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Forwards Rev 11A to "UFSAR for DCP, Units 1 & 2."
 Discrepancies addressed in Rev 11A primarily involve
 submitted areas.

DISTRIBUTION CODE: A053D COPIES RECEIVED: LTR 1 ENCL 8 SIZE: 2+950
 TITLE: OR Submittal: Updated FSAR (50.71) and Amendments

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PD4-2 PD	1 0	BLOOM, S	1 1
INTERNAL:	AGRS	1 1	AEOD/DOA/IRB	1 1
	FILE CENTER 01	2 2	RGN4	1 1
EXTERNAL:	IHS	1 1	NOAC	1 1
	NRC PDR	1 1		


C
A
T
E
G
O
R
Y

1

D
O
C
U
M
E
N
T

NOTE TO ALL "RIDS" RECIPIENTS:
 PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS
 OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL
 DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 10 ENCL 9

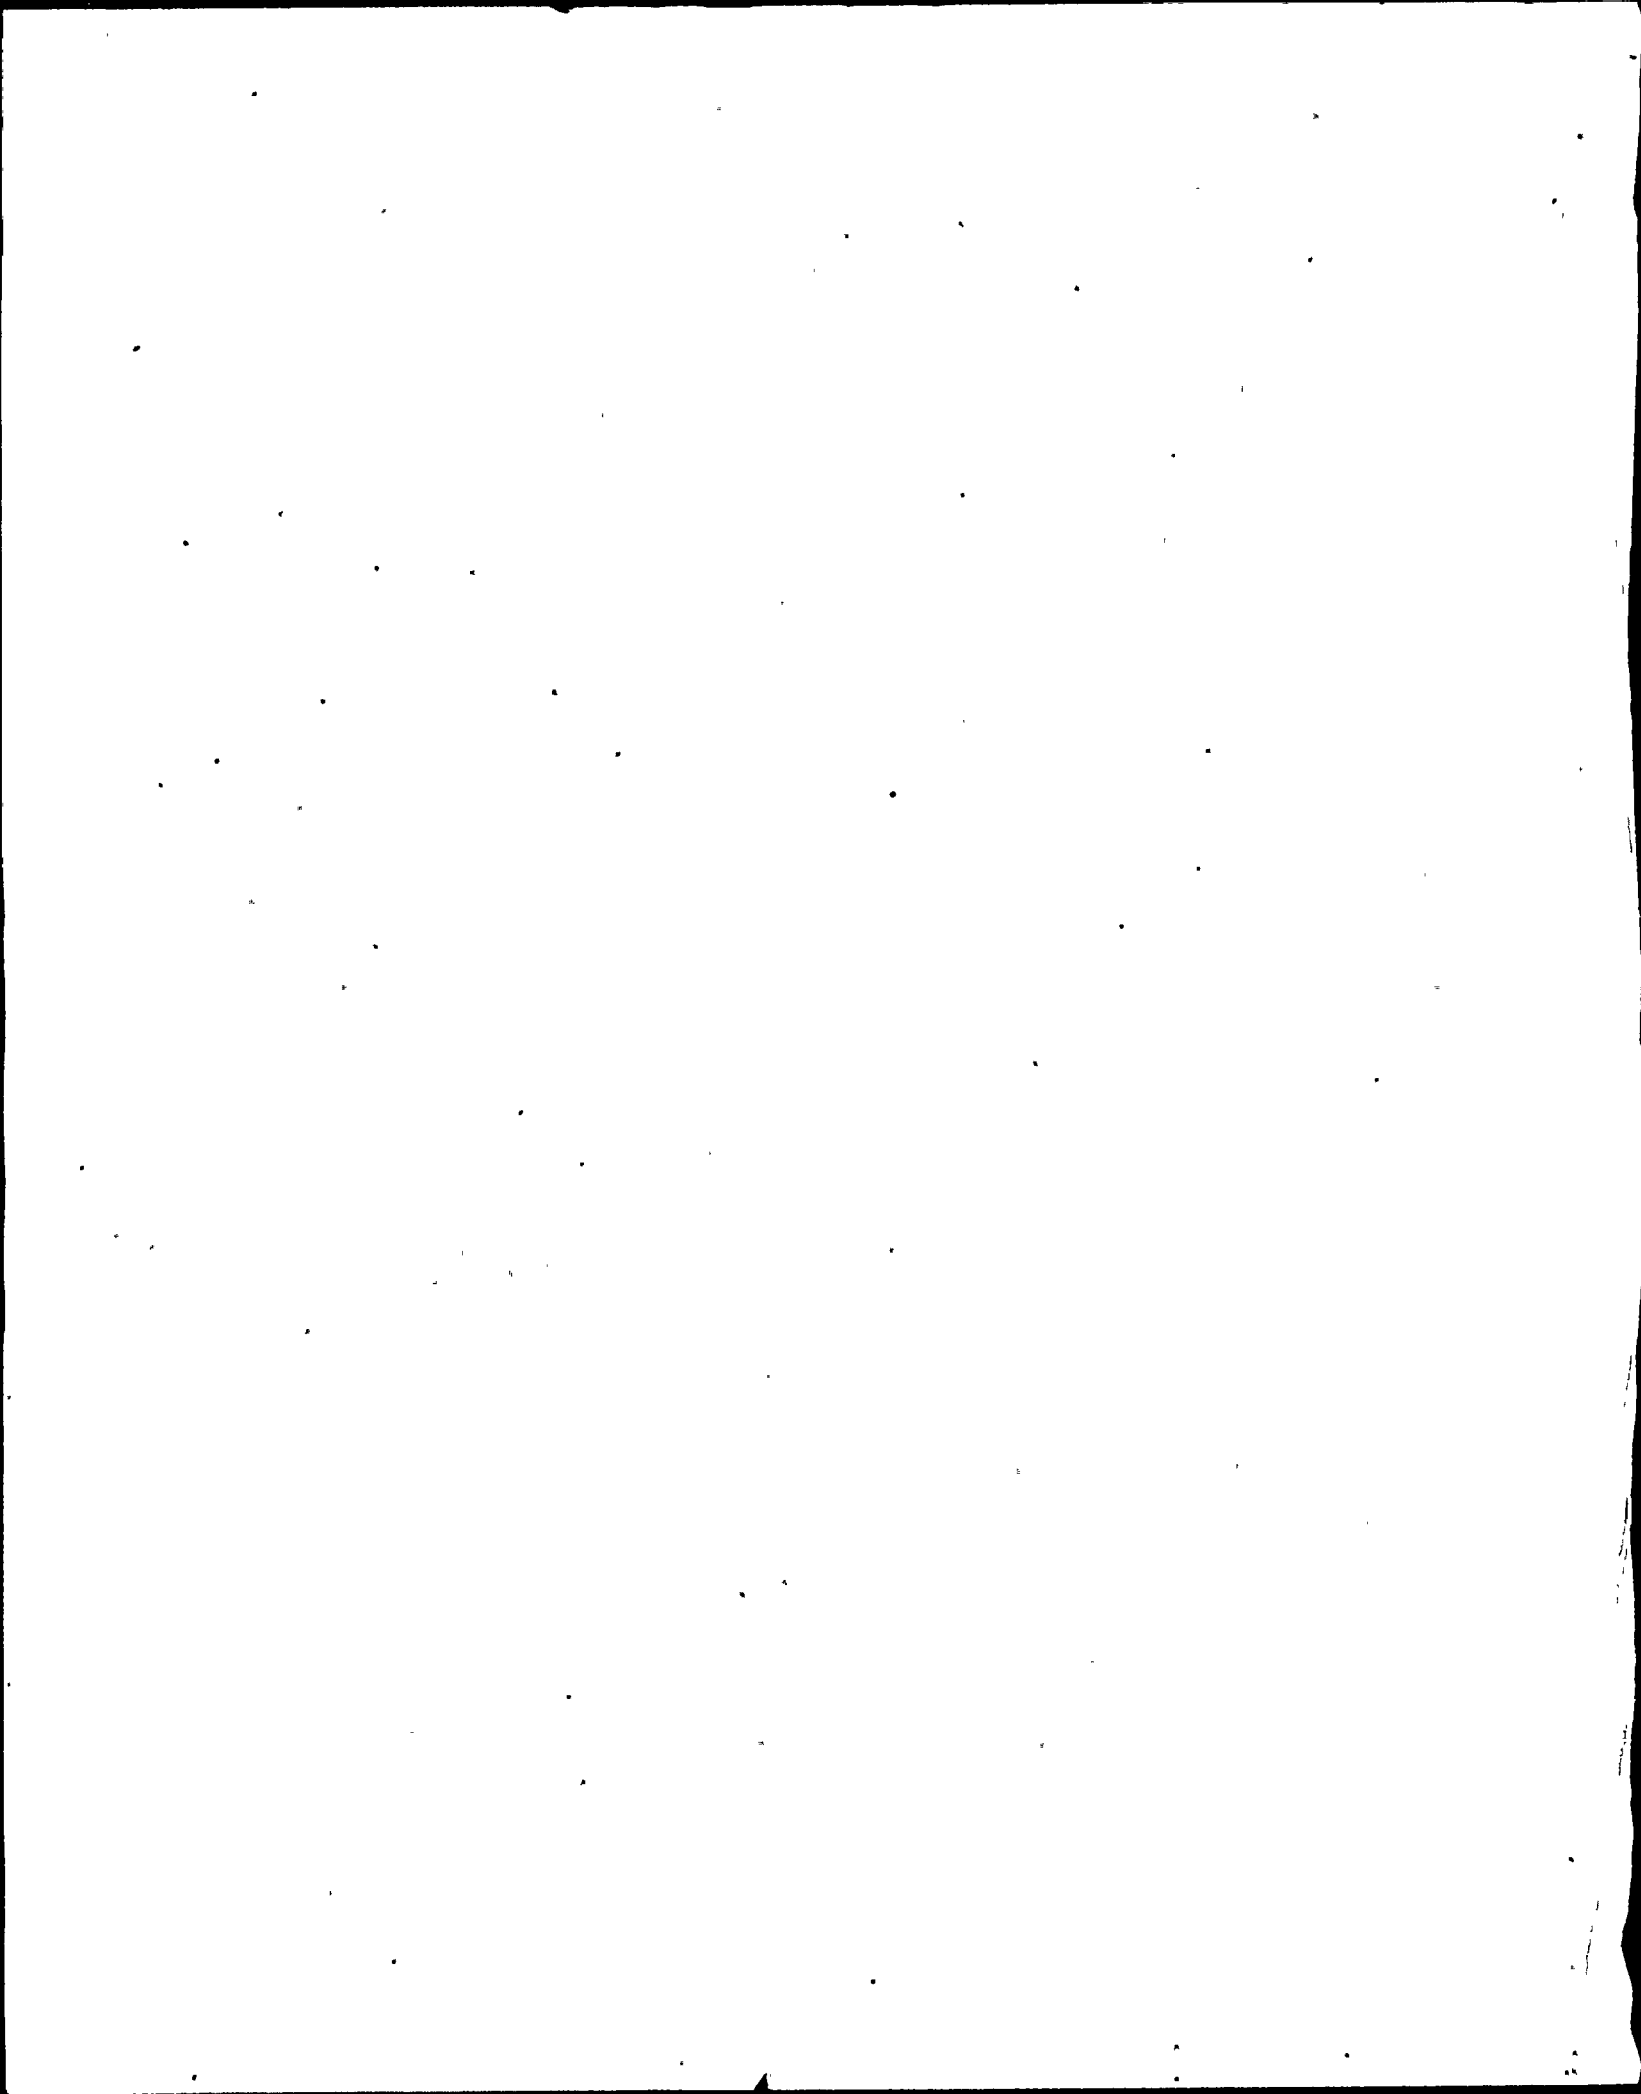

Pacific Gas and Electric Company

245 Market Street, Room 937-N9B
San Francisco, CA 94105
Mailing Address
Mail Code N9B
P.O. Box 770000
San Francisco, CA 94177
415/973-4684 Fax 415/973-2313

Gregory M. Rueger
Senior Vice President and
General Manager
Nuclear Power Generation

April 30, 1997

PG&E Letter DCL-97-075



U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Docket No. 50-275, OL-DPR-80
Docket No. 50-323, OL-DPR-82
Diablo Canyon Units 1 and 2
Final Safety Analysis Report Update, Revision 11A

Dear Commissioners and Staff:

On November 25, 1996, PG&E submitted Revision 11 of the Diablo Canyon Final Safety Analysis Report (FSAR) Update pursuant to 10 CFR 50.71(e) and 10 CFR 50.4(b)(6). Revision 11 addressed a number of documentation discrepancies in the FSAR Update that had been identified by PG&E based on a prior review in early 1996. However, some discrepancies of low safety significance remained uncorrected in Revision 11 due to time and resource limitations. In submitting Revision 11, PG&E stated that a supplemental revision to the FSAR Update would be submitted by April 30, 1997, to address these remaining discrepancies. This supplemental revision, designated as Revision 11A, is provided in the enclosure.

The discrepancies addressed in Revision 11A primarily involve the following areas:

- Flood and hydrologic engineering descriptions and evaluations in Chapters 2 and 3 have been revised and updated.
- Seismic design and equipment qualification information in Chapter 3 have been revised.
- Instrument accuracy values in Tables 7.5-1 through 7.5-5 have been revised to be consistent with design calculations of record.


In addition, Revision 11A also includes changes that reflect facility modifications completed since issuance of Revision 11 as well as other miscellaneous changes, the most significant of which are:

150073



9705160069 970430
PDR ADOCK 05000275
K PDR


118
AUG 3

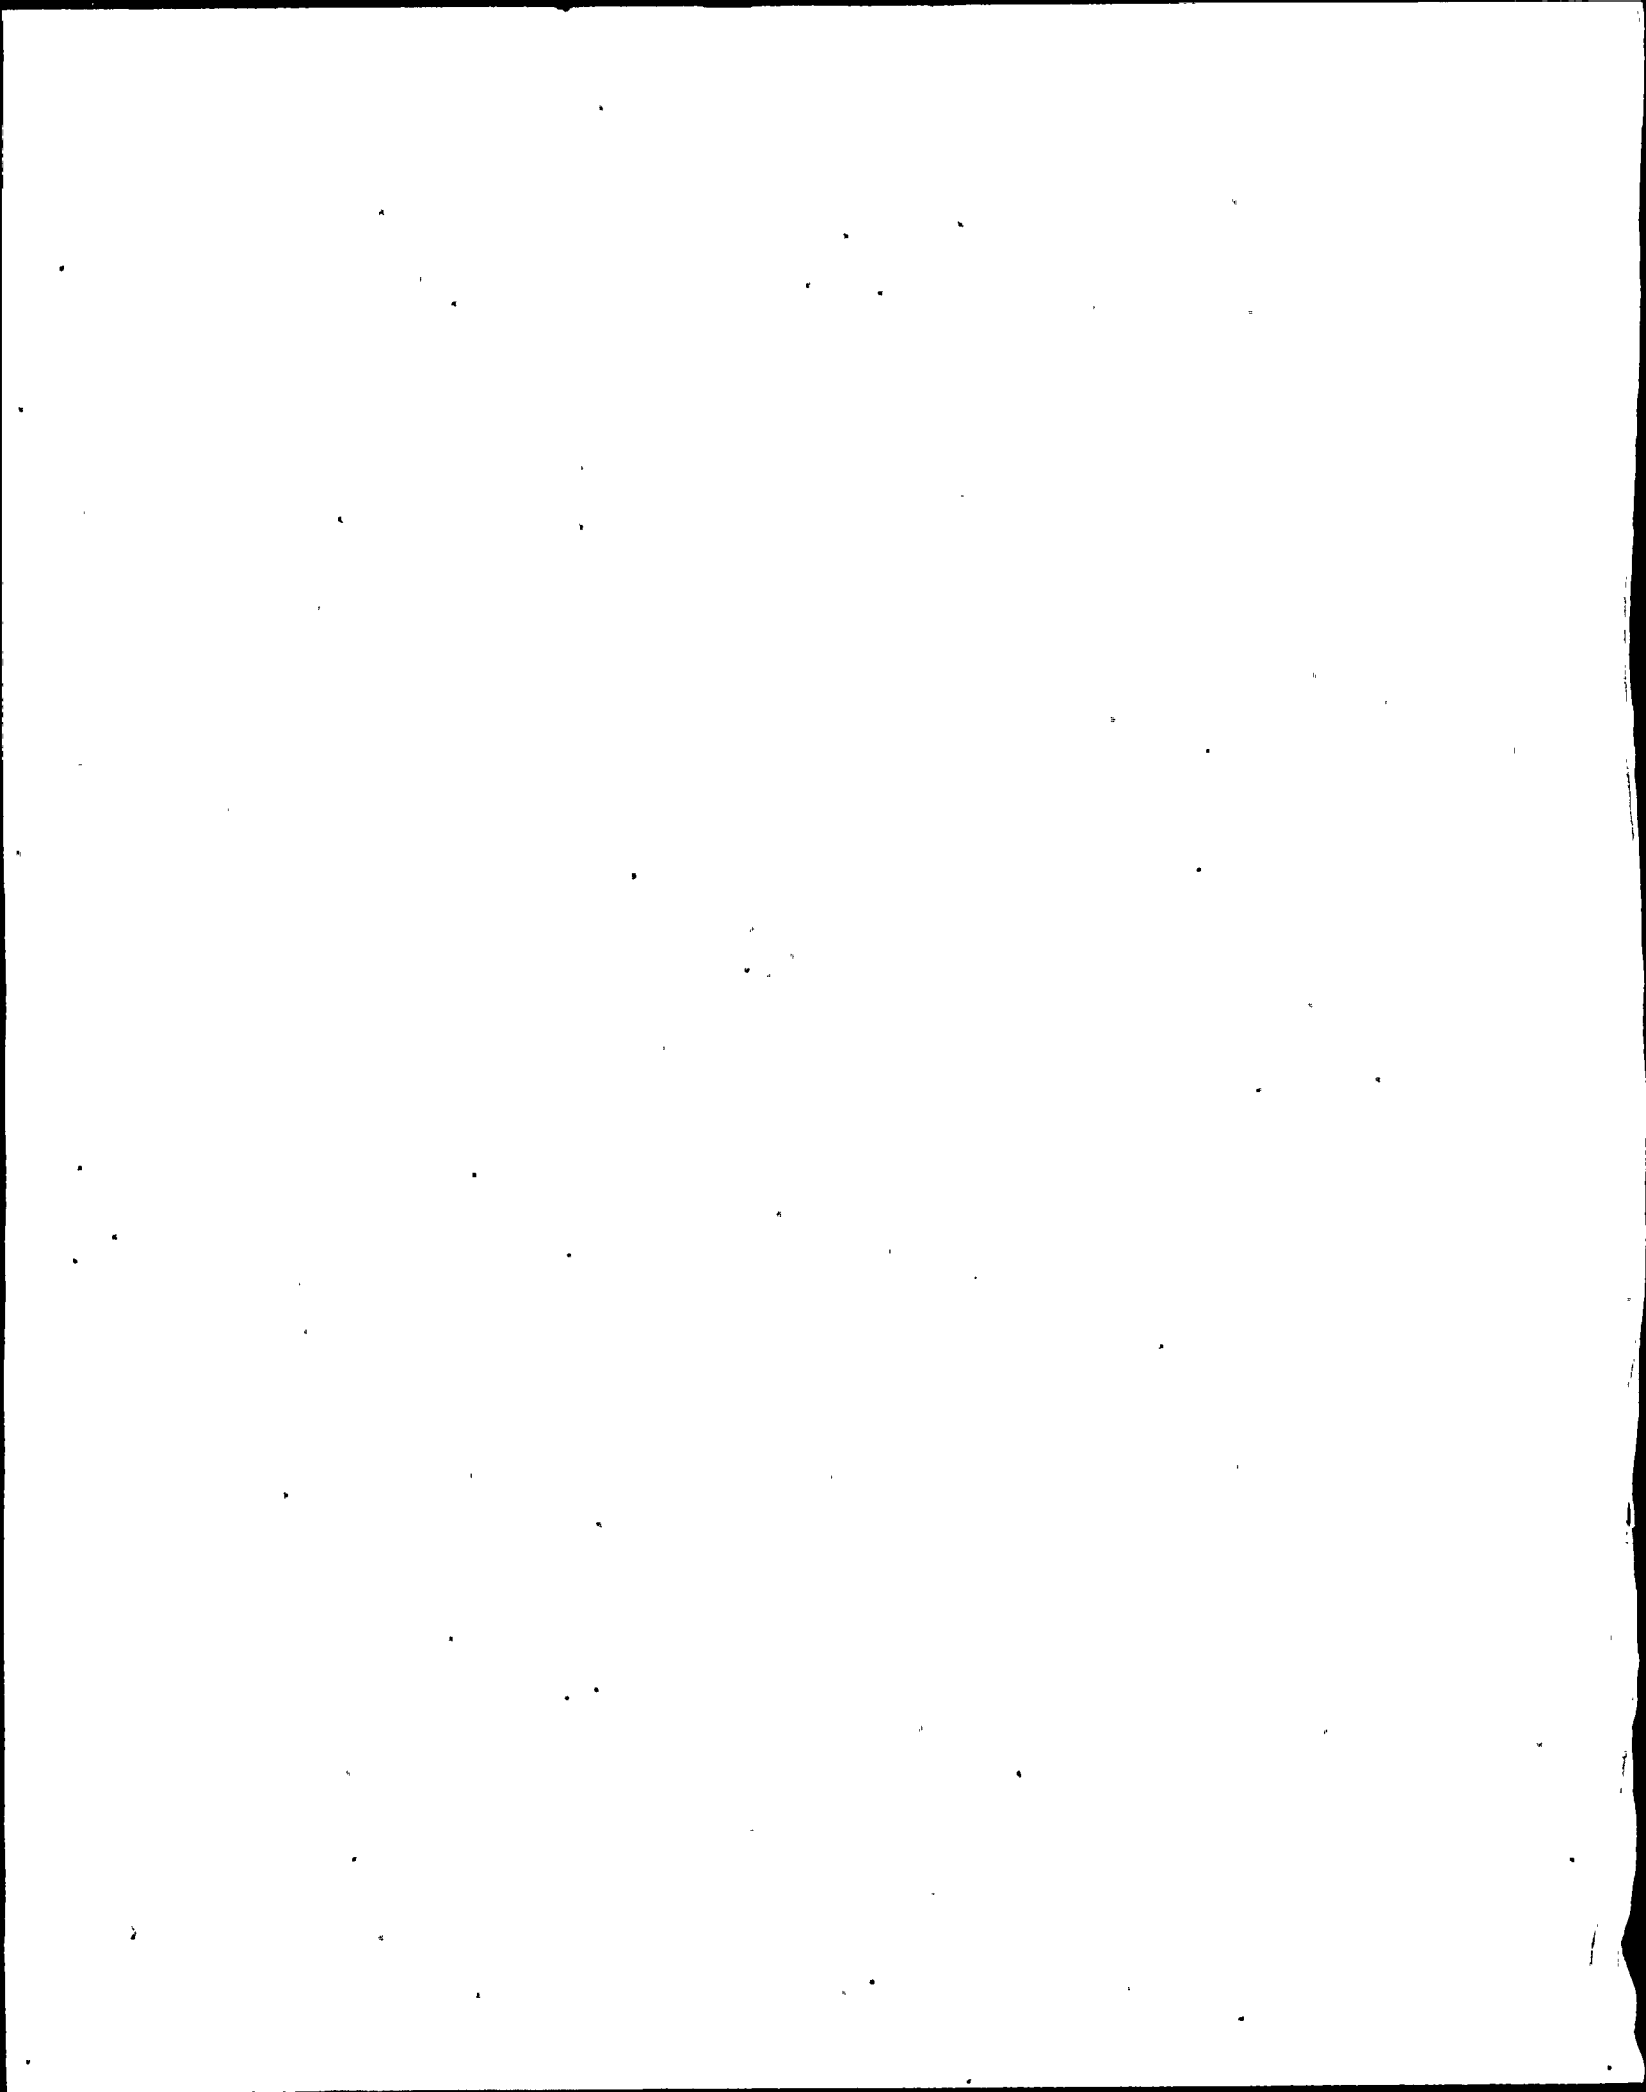

- Revisions to Section 6.3 related to the changeover from injection mode to recirculation after a loss of coolant accident.
- Revisions to Section 7.5 to describe modifications to the Emergency Response Facility Data System, the Safety Parameter Display System, and the Plant Process Computer.
- Revisions to Sections 8.3 and 9.5 to reflect the replacement of the 40,000-gallon underground fuel oil storage tanks with 50,000-gallon tanks.
- Revisions to Chapters 13 and 17 to reflect organizational changes and relocation of certain administrative requirements from the Technical Specifications as allowed by license amendments.

In accordance with NRC requirements, the materials comprising Revision 11A are formatted as replacement pages for Revision 11. In addition, the enclosed materials include several Revision 11 sheets to replace existing pages that had formatting or printing errors. Instructions are included in the enclosure for replacing the affected pages.

Sincerely,




Gregory M. Rueger

Subscribed and sworn to before me
this 30th day of April 1997

Attorneys for Pacific Gas and
Electric Company
Bruce R. Worthington
Richard F. Locke




Notary Public

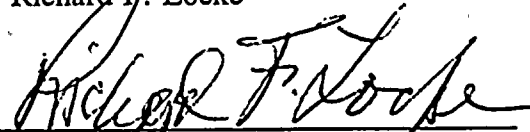

Richard F. Locke

Enclosure

- c: Steven D. Bloom (w/enc)
Ellis W. Merschoff (w/enc)
Kenneth E. Perkins
Michael D. Tschiltz (w/enc)
Diablo Distribution

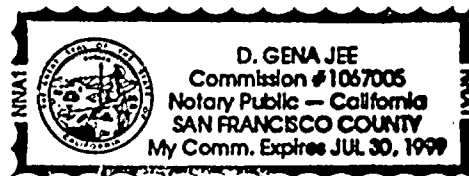

W. H. ... (Phone) JUL 20, 1999
SAN FRANCISCO COUNTY
National Public - Customs
C... .. 1087002
... .. J... ..

NOTICE OF CONTROLLED DOCUMENT TRANSMITTAL

Date: April 30, 1997

To: U.S. Nuclear Regulatory Commission
Document Control Desk

From: Nuclear Safety Assessment and Licensing
Licensing and Design Basis Management

Subject: Transmittal of Changes to a Controlled Document
Final Safety Analysis Report Update, Revision 11A
Diablo Canyon Power Plant, Units 1 and 2

Please insert the enclosed replacement sections, pages, tables, and figures in Copy No. 1 of the FSAR Update currently in your possession.

Kindly acknowledge receipt of the Revision 11A update package and compliance with the document revision instructions by signing and returning the controlled document transmittal notice to:

David W. Ogden
Pacific Gas and Electric Company
Mail Code N9B
PO Box 770000
San Francisco, CA 94177

I HAVE RECEIVED THE REVISION 11A UPDATE PACKAGE
AND HAVE COMPLIED WITH THE TRANSMITTAL NOTICE
INSTRUCTIONS FOR THE FSAR UPDATE, COPY NO. 1.

Signature of Document Holder

Date

