


- STATION POWER 1.0
- GREASE OIL 6.0
- VENTILATION & AIR CONDITIONING 7.0
- LIQUID RADWASTE 10.0
- CONDENSATE 11.0
- FEEDWATER 12.0
- PLANT COMPUTER 13.0
- HYDROGEN & NITROGEN 14.0
- DIESEL GENERATOR 15.0
- TURBINE STEAM SUPPLY 16.0
- COMPONENT COOLING WATER 17.0
- CIRCULATING WATER 18.0
- REACTOR COOLANT 19.0
- EXTRACTION STEAM 20.0
- GAS RADWASTE 21.0
- CHEMICAL & VOLUME CONTROL 24.0
- CONTAINMENT SPRAY 25.0
- TURBINE GENERATOR 26.0
- SPENT FUEL PIT COOLING 27.0
- FUEL HANDLING EQUIP. 29.0
- REACTOR CONTROL & PROTECTION 30.0
- HEAT TRACING 31.0
- LIGHTING & SECURITY 32.0
- PIPE HANGERS ALL SYSTEMS

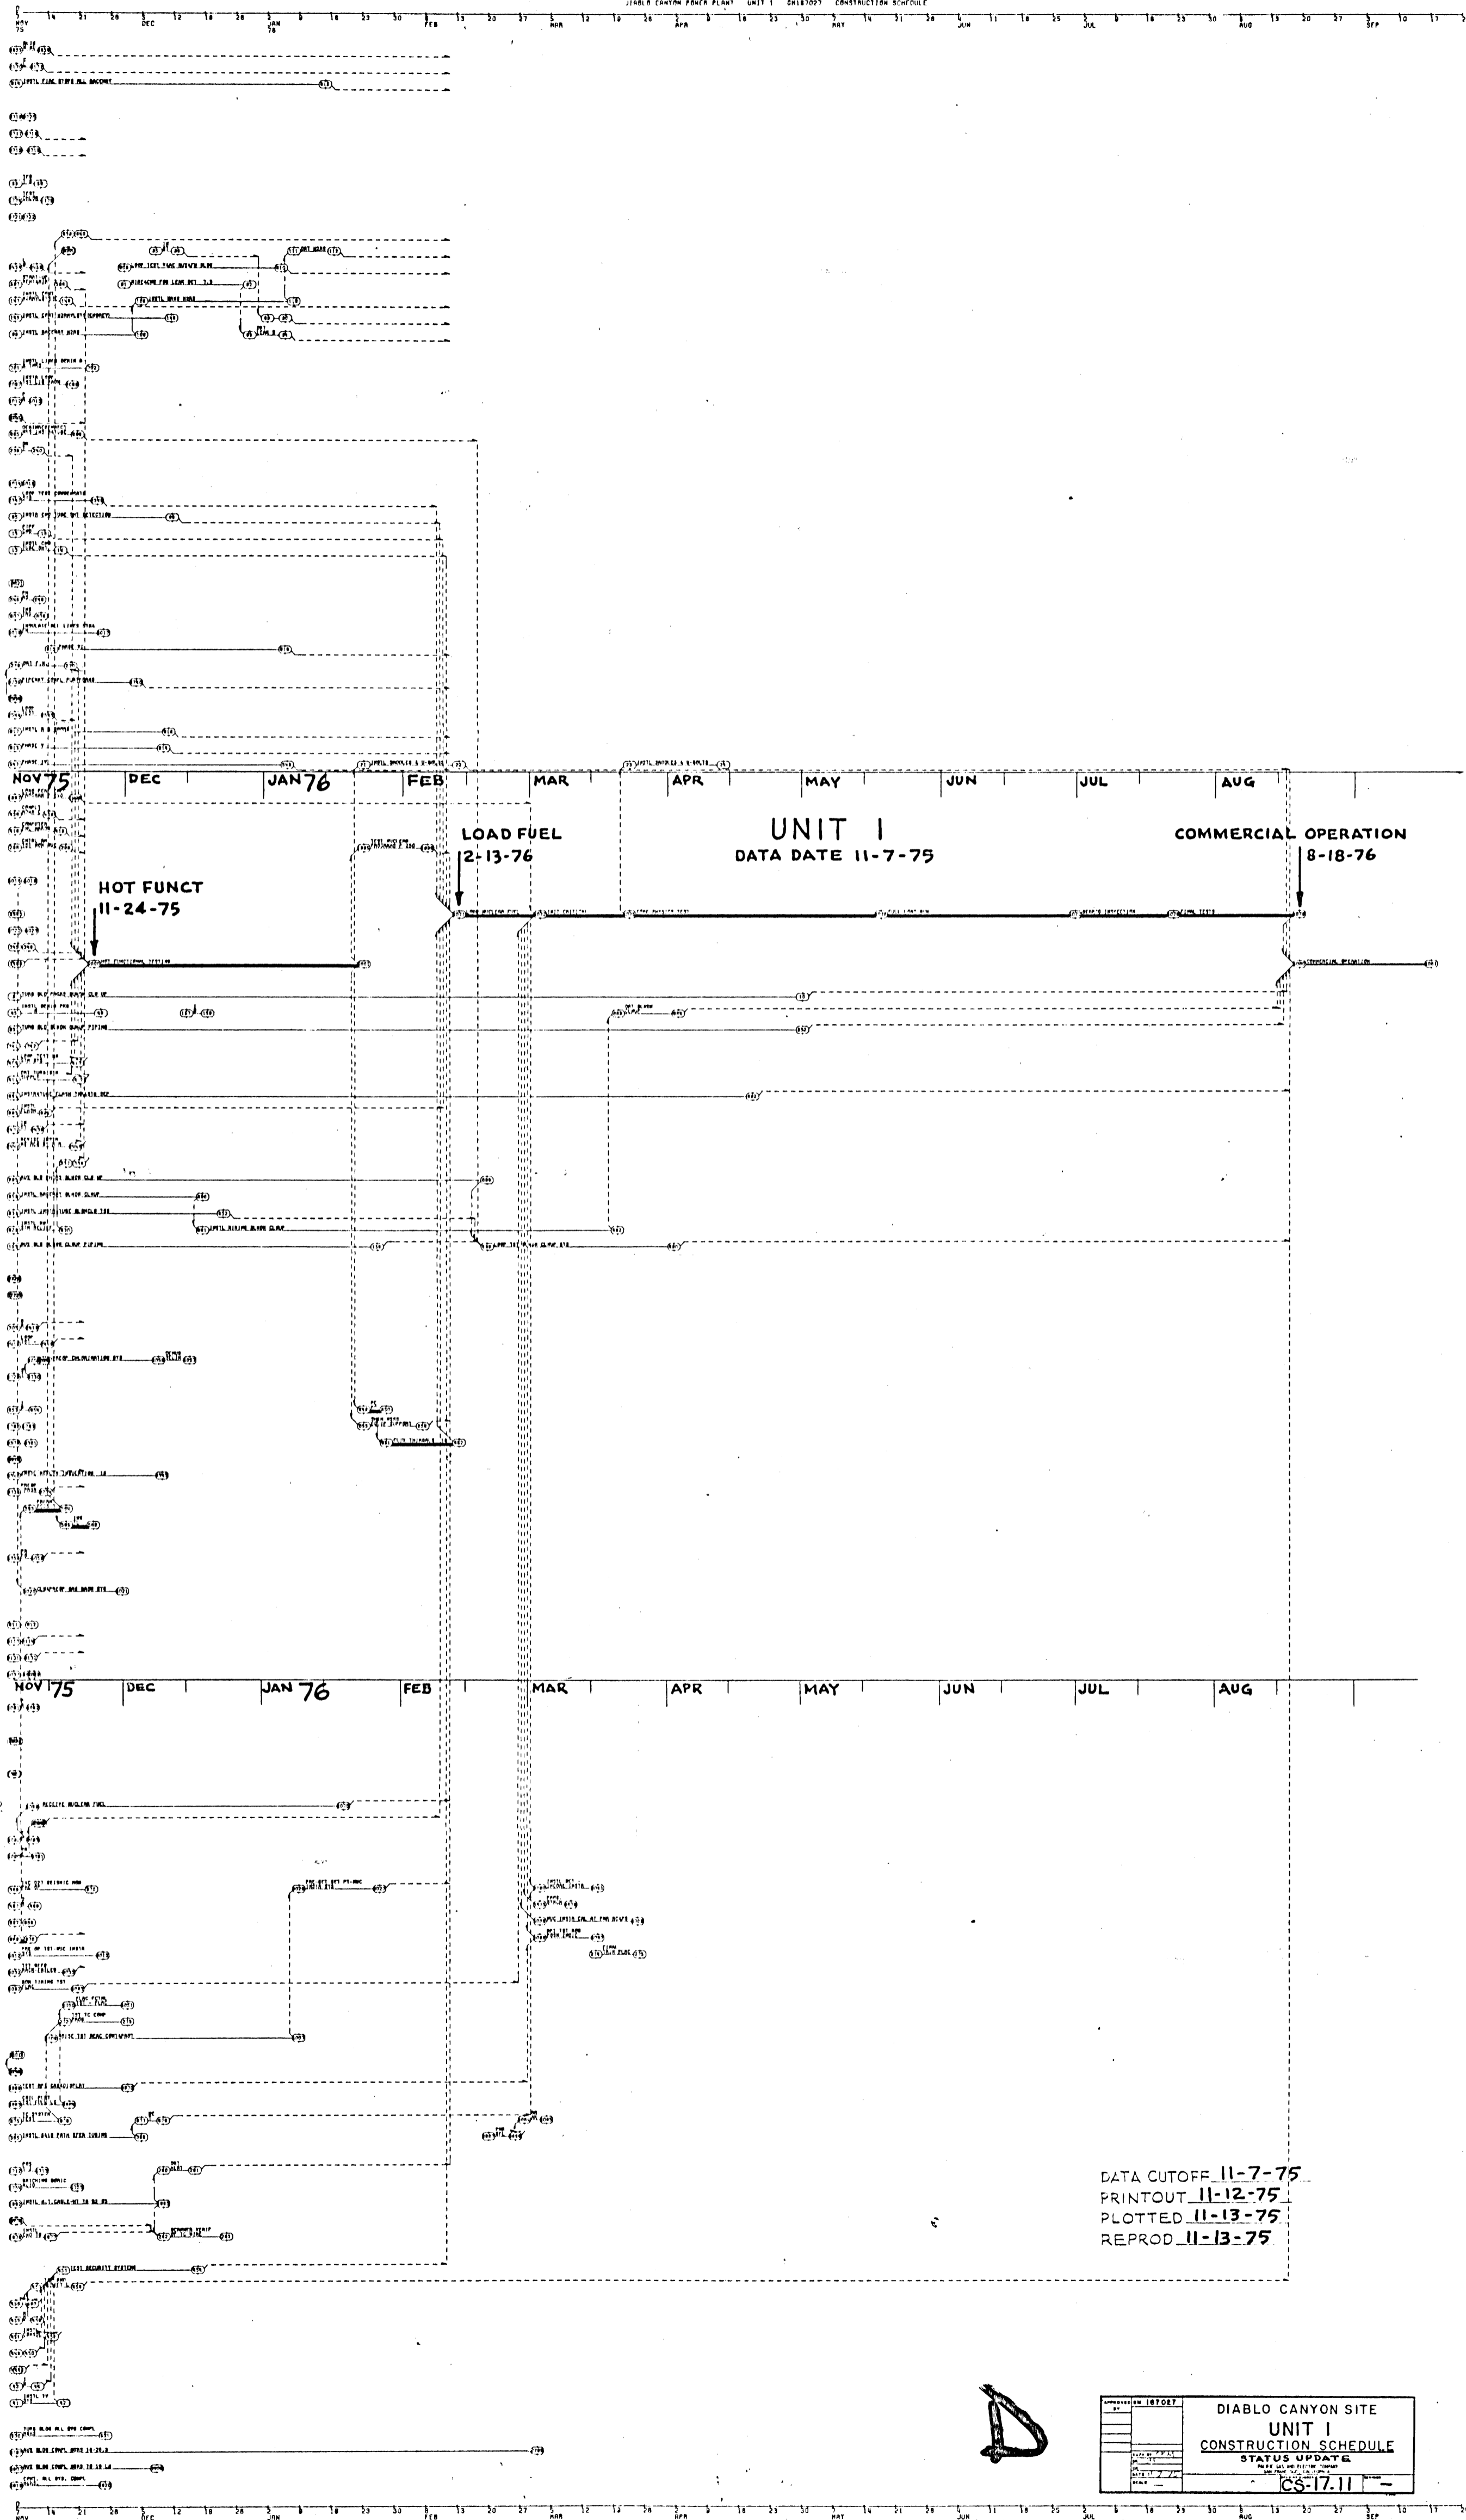

DATA CUTOFF 11-7-75  
 PRINTOUT 11-12-75  
 PLOTTED 11-13-75  
 REPROD 11-13-75

APPROVED BY (187027)	DIABLO CANYON SITE
	UNIT 1
	CONSTRUCTION SCHEDULE
	STATUS UPDATE
	DATE 11-13-75
	CS-17.11