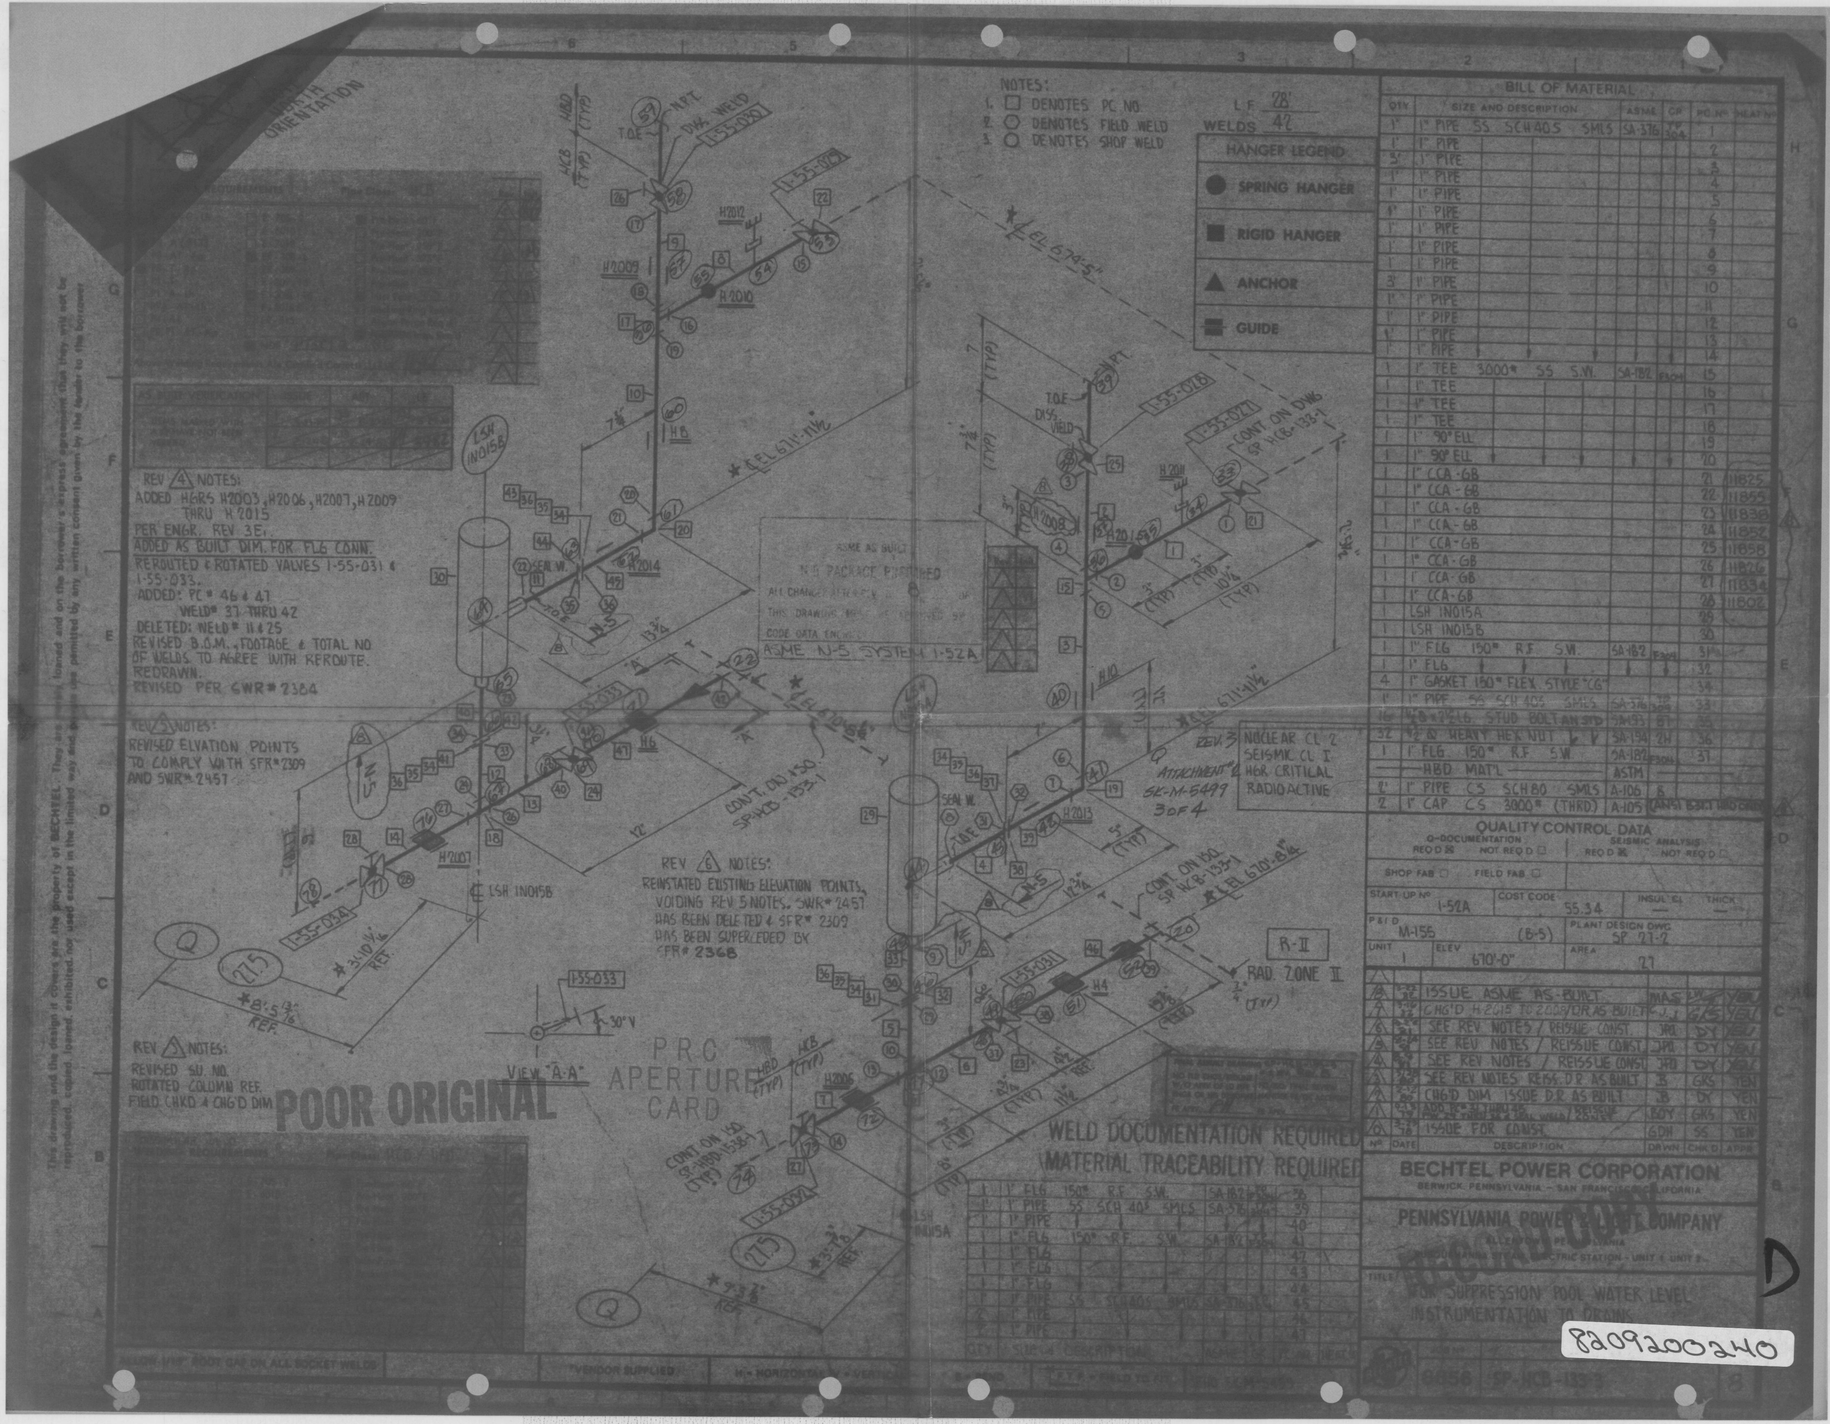
NOTES:
1. DENOTES PC NO.
2. DENOTES FIELD WELD
3. DENOTES SHOP WELD
L.F. 28'
WELDS 42
HANGER LEGEND
SPRING HANGER
RIGID HANGER
ANCHOR
GUIDE
BILL OF MATERIAL
QUALITY CONTROL DATA
REV 4 NOTES:
ADDED HGRS H2003, H2006, H2007, H2009 THRU H2015
PER ENGR. REV 3E1.
ADDED AS BUILT DIM. FOR FLG CONN.
REROUTED & ROTATED VALVES 1-55-031 & 1-55-033.
ADDED: PC # 46 & 47
WELD # 37 THRU 42
DELETED: WELD # 11 & 25
REVISED B.O.M., FOOTAGE & TOTAL NO OF WELDS TO AGREE WITH REROUTE.
REDRAWN.
REVISED PER SWR # 2384
REV 5 NOTES:
REVISED ELVATION POINTS TO COMPLY WITH SFR # 2309 AND SWR # 2457
REV 6 NOTES:
REINSTATED EXISTING ELEVATION POINTS, VOIDING REV 5 NOTES. SWR # 2457 HAS BEEN DELETED & SFR # 2309 HAS BEEN SUPERCEDED BY SFR # 2368
REV 3 NOTES:
REVISED SU. NO.
ROTATED COLUMN REF.
FIELD CHKD & CHG'D DIM
ASME AS BUILT
N-5 PACKAGE PROCESSED
ASME N-5 SYSTEM 1-52A
NUCLEAR CL 2
SEISMIC CL I
HGR CRITICAL
RADIOACTIVE
ATTACHMENT # 2
SK-M-5499
3 OF 4
R-II
RAD. ZONE II
VIEW "A-A"
PRC APERTURE CARD
POOR ORIGINAL
WELD DOCUMENTATION REQUIRED
MATERIAL TRACEABILITY REQUIRED
BECHTEL POWER CORPORATION
BERWICK, PENNSYLVANIA - SAN FRANCISCO, CALIFORNIA
PENNSYLVANIA POWER & LIGHT COMPANY
ALLENTOWN, PENNSYLVANIA
SUSQUEHANNA STEAM ELECTRIC STATION - UNIT 1 UNIT 2
FOR SUPPRESSION POOL WATER LEVEL INSTRUMENTATION TO DRAWN
8209200240