

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8304180598 DOC. DATE: 83/04/15 NOTARIZED: NO DOCKET #  
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylvania 05000387  
 AUTH. NAME AUTHOR AFFILIATION  
 CURTIS, N.W. Pennsylvania Power & Light Co.  
 RECIP. NAME RECIPIENT AFFILIATION  
 SCHWENCER, A. Licensing Branch 2

SUBJECT: Forwards application for amend to License NPF-14, changing Tech Specs to incorporate final setpoint data developed during startup test program.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+2  
 TITLE: Licensing Submittal: PSAR/FSAR Amdts & Related Correspondence.

NOTES: 1cy NMSS/FCAF/PM. 05000387  
*W/Check \$4000.00*

	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES	
		LTR	ENCL		LTR	ENCL
	NRR/DL/ADL	1	0	NRR LB2 BC	1	0
	NRR LB2 LA	1	0	PERCH,R. 01	1	1
INTERNAL:	ELD/HDS4	1	0	IE FILE	1	1
	IE/DEPER/EPB 36	3	3	IE/DEPER/IRB 35	1	1
	IE/DEQA/QAB 21	1	1	NRR/DE/AEAB	1	0
	NRR/DE/CEB 11	1	1	NRR/DE/EHEB	1	1
	NRR/DE/EQB 13	2	2	NRR/DE/GB 28	2	2
	NRR/DE/HGEB 30	1	1	NRR/DE/MEB 18	1	1
	NRR/DE/MTEB 17	1	1	NRR/DE/SAB 24	1	1
	NRR/DE/SGEB 25	2	2	NRR/DHFS/HFEB40	1	1
	NRR/DHFS/LQB 32	1	1	NRR/DL/SSPB	1	0
	NRR/DSI/AEB 26	1	1	NRR/DSI/ASB	1	1
	NRR/DSI/CPB 10	1	1	NRR/DSI/CSB 09	1	1
	NRR/DSI/ICSB 16	1	1	NRR/DSI/METB 12	1	1
	NRR/DSI/PSB 19	1	1	NRR/DSI/RAB 22	1	1
	NRR/DSI/RSB 23	1	1	<u>REG FILE</u> 04	1	1
	RGN1	3	3	RM/DDAMI/MIB	1	0
EXTERNAL:	ACRS 41	6	6	BNL (AMDTS ONLY)	1	1
	DMB/DSS (AMDTS)	1	1	FEMA-REP DIV 39	1	1
	LPDR 03	2	2	NRC PDR 02	1	1
	NSIC 05	1	1	NTIS	1	1
NOTES:		1	1			

THE UNITED STATES OF AMERICA  
 DEPARTMENT OF THE ARMY  
 OFFICE OF THE CHIEF OF STAFF  
 WASHINGTON, D. C. 20315

REPORT OF THE CHIEF OF STAFF  
 ON THE PROGRESS OF THE ARMY  
 DURING THE YEAR 1964

PREPARED BY THE CHIEF OF STAFF  
 AND THE CHIEFS OF THE MAJOR COMMANDS

Category	Item	Value	Unit	Notes
Personnel	Active Personnel	1,000,000	Personnel	
	Reserve Personnel	500,000	Personnel	
	Total Personnel	1,500,000	Personnel	
	Active Personnel	1,000,000	Personnel	
	Reserve Personnel	500,000	Personnel	
	Total Personnel	1,500,000	Personnel	
	Active Personnel	1,000,000	Personnel	
	Reserve Personnel	500,000	Personnel	
	Total Personnel	1,500,000	Personnel	
	Active Personnel	1,000,000	Personnel	
Equipment	Active Equipment	1,000,000	Equipment	
	Reserve Equipment	500,000	Equipment	
	Total Equipment	1,500,000	Equipment	
	Active Equipment	1,000,000	Equipment	
	Reserve Equipment	500,000	Equipment	
	Total Equipment	1,500,000	Equipment	
	Active Equipment	1,000,000	Equipment	
	Reserve Equipment	500,000	Equipment	
	Total Equipment	1,500,000	Equipment	
	Active Equipment	1,000,000	Equipment	
Budget	Active Budget	1,000,000	Budget	
	Reserve Budget	500,000	Budget	
	Total Budget	1,500,000	Budget	
	Active Budget	1,000,000	Budget	
	Reserve Budget	500,000	Budget	
	Total Budget	1,500,000	Budget	
	Active Budget	1,000,000	Budget	
	Reserve Budget	500,000	Budget	
	Total Budget	1,500,000	Budget	
	Active Budget	1,000,000	Budget	



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101 • 215 / 770-5151

Norman W. Curtis  
Vice President-Engineering & Construction-Nuclear  
215/770-7501

APR 15 1983

Director of Nuclear Reactor Regulation  
Attention: Mr. A. Schwencer, Chief  
Licensing Branch No. 2  
Division of Licensing  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

SUSQUEHANNA STEAM ELECTRIC STATION  
PROPOSED AMENDMENT 22 TO LICENSE NO. NPF 14  
ER 100450 FILE 841-8  
PLA-1622

Docket No. 50-387

Dear Mr. Schwencer:

The purpose of this letter is to propose a change to the Susquehanna SES Unit 1 Technical Specifications.

Technical Specification Table 3.3.2-2, Trip Function 6a, is footnoted to indicate that a final setpoint will be developed during the Startup Test Program (see Attachment A). Startup Test 15.3, HPCI Rated Pressure Quick Starts to the Vessel, was approved on January 16, 1983, and PP&L is proposing to amend the Technical Specifications based on the data taken in that test.


General Electric recommends that the setpoint be based on greater than 272 but less than or equal to 300 percent of the maximum steady state flow rate through the HPCI steam line. The allowable value is then derived from the following equation provided by GE:

$$dp(\text{trip}) = dp(\text{test}) \times \left[ \frac{3w(\text{max})}{w(\text{test})} \right]^2 \times \frac{\rho(\text{test})}{\rho(\text{max})}$$

This being the system design basis (which is consistent with IE Information Notice No. 82-16: HPCI/RCIC High Steam Flow Setpoints), the setpoint will be low enough to provide break detection in the HPCI steam supply line and initiate closure of the steam supply isolation valves, yet high enough to avoid spurious isolation trips resulting from pressure transients associated with quick starts of the system (Susquehanna has incorporated a time delay in the HPCI instrumentation system to avoid such trips).

BOO!  
w/check:  
\$ 4000.00

8304180598 830415  
PDR ADOCK 05000387  
P PDR

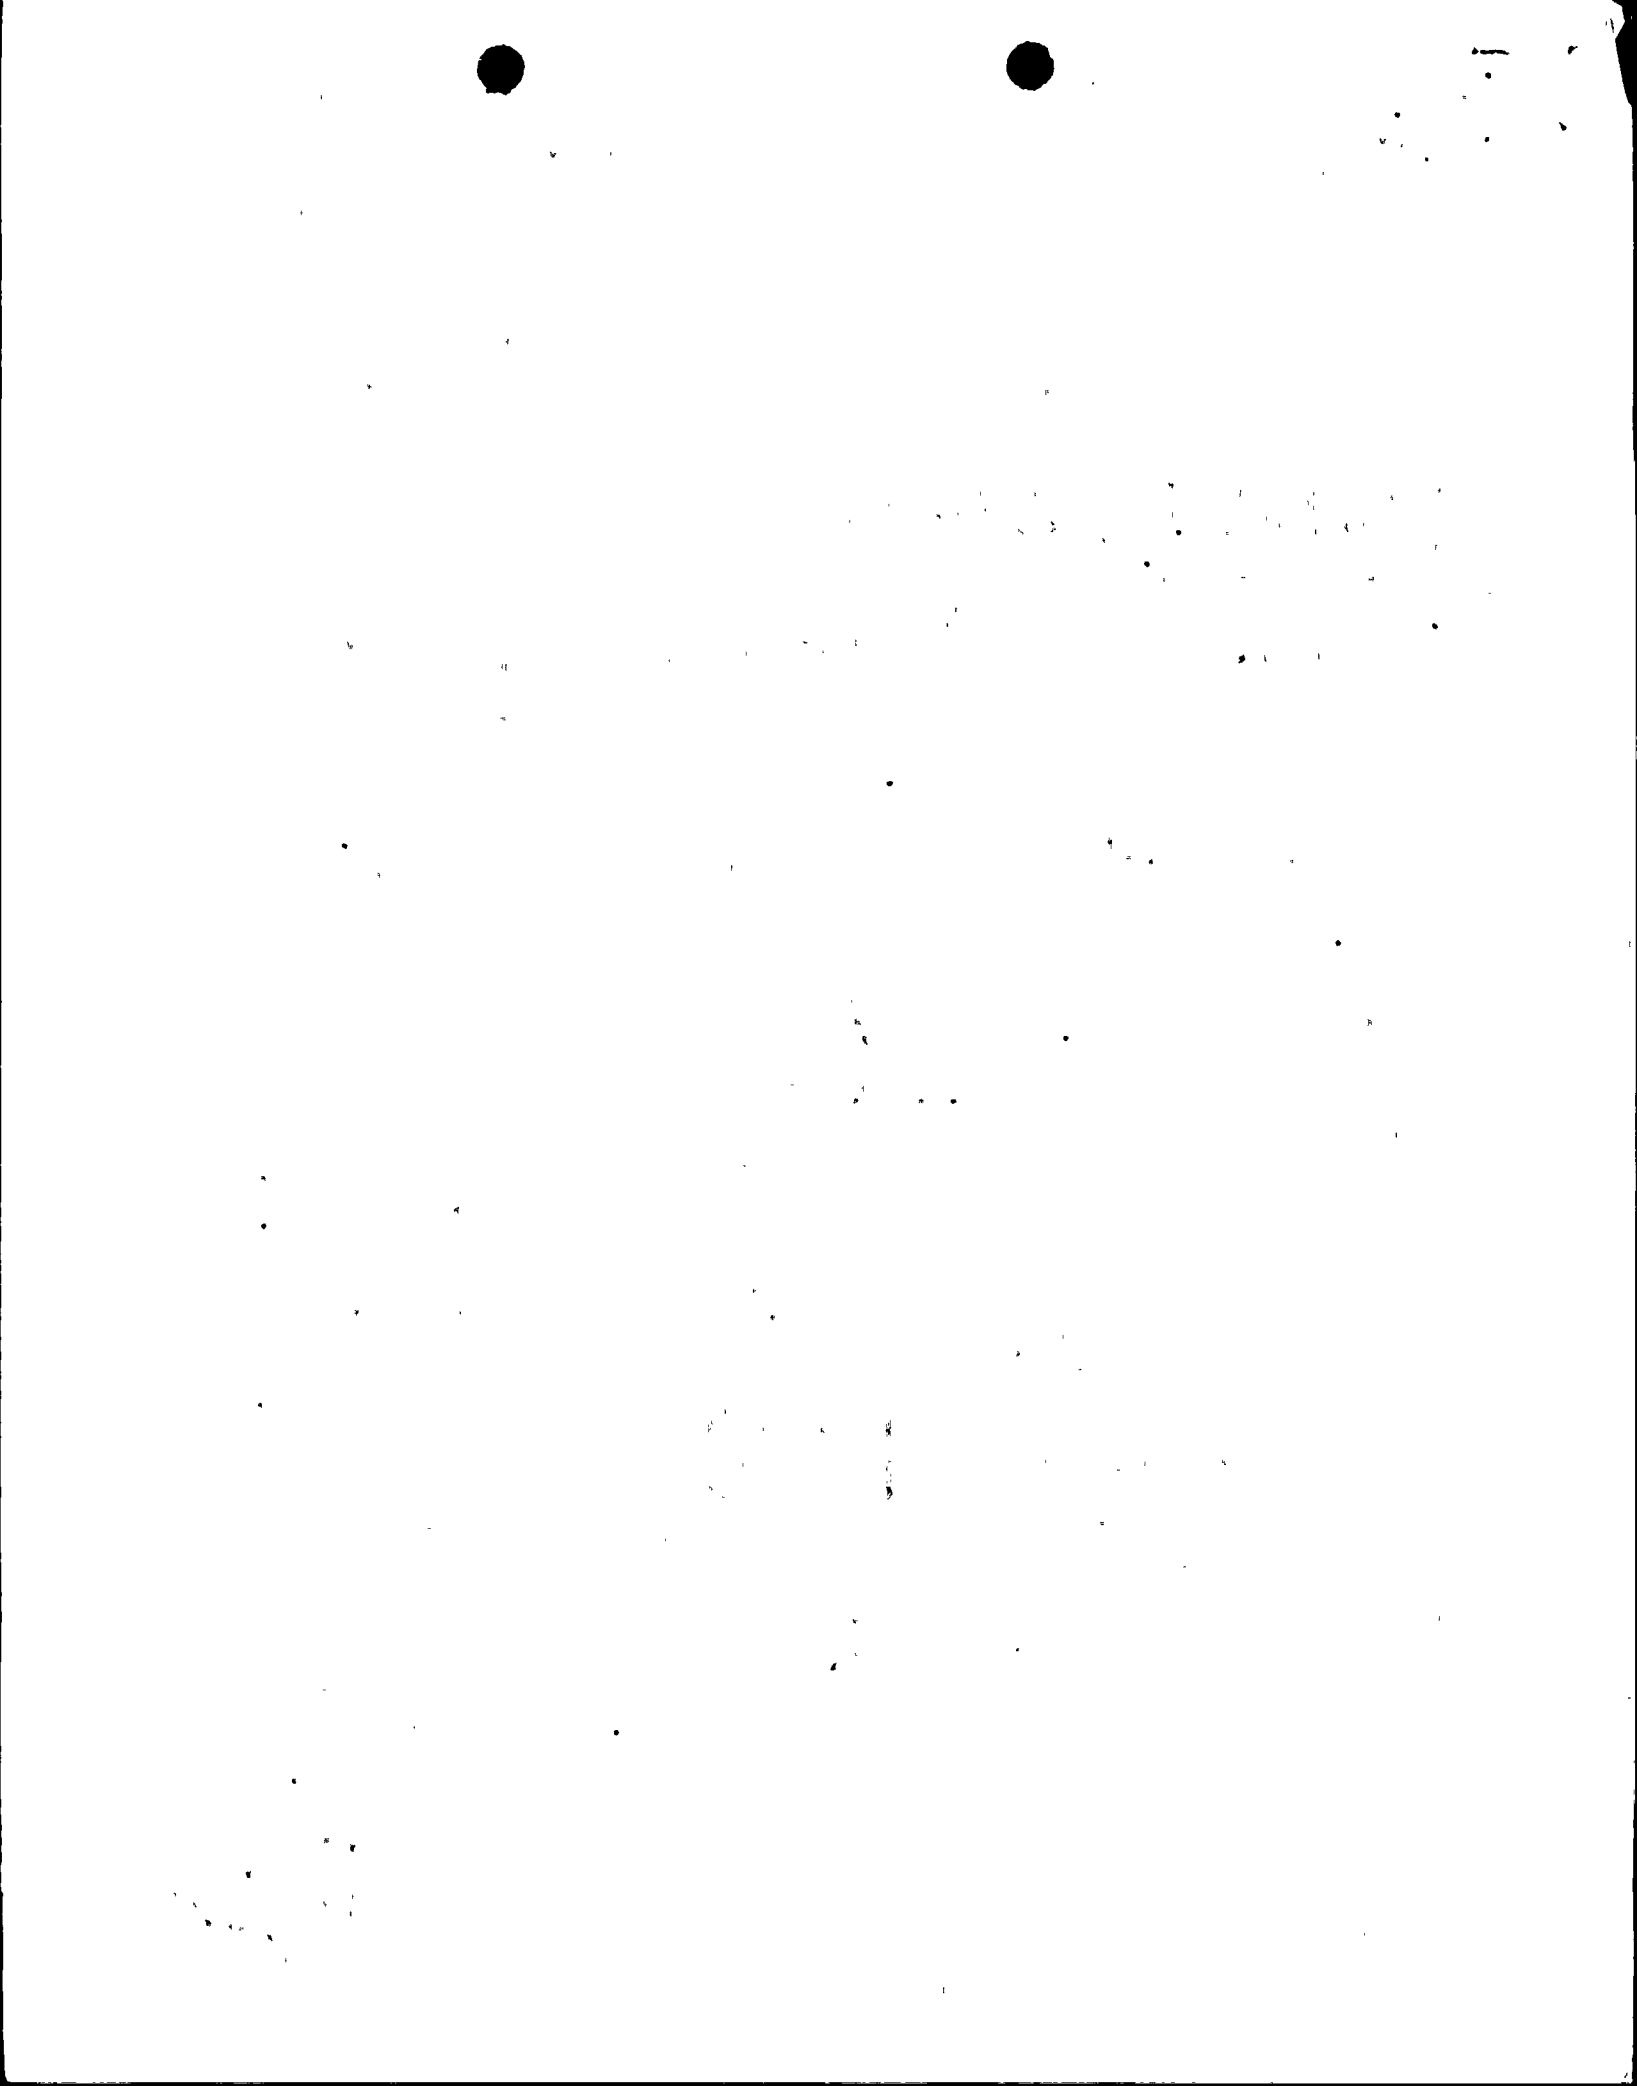

APR 15 1983

Page 2


SSES PLA-1622  
ER 100450 File 841-8  
Mr. A. Schwencer

In order to assure ourselves that the 300 percent criteria used as the basis for HPCI isolation was within the envelope of the Susquehanna safety analyses, calculations were performed which indicate that the break area associated with 3 times maximum steady state HPCI steamline flow was approximately 0.1 square feet. GE has previously analyzed steamline breaks of this size and found that with the RCIC and CRD systems available, the top of active fuel remains covered by several feet.

With respect to the radiological consequences associated with the maximum break not isolated by the 300 percent value, our analysis shows that the expected dose would be enveloped by the dose associated with a design basis LOCA and therefore well within 10CFR100 limits.

Based on the information provided above, the proposed change will not jeopardize the safe operation of Susquehanna SES. The appropriate amendment fees pursuant to 10CFR170 are enclosed.

Very truly yours,



N. W. Curtis  
Vice President-Engineering & Construction-Nuclear

Enclosure

cc: R. L. Perch - USNRC



2011

2011