

WAQC010



U.S. ENVIRONMENTAL PROTECTION AGENCY
MODEL STATE INFORMATION SYSTEM
WATER QUALITY COMPLIANCE SUBSYSTEM
BACTERIOLOGICAL OR TURBIDITY SUMMARY ANALYSIS INPUT (WAQC 402)

WAQC.402

Form Approved
OMB No. 158-RO155

PWS ID
2 4 0 0 9 9 8
1-7

TRANSACTION CODE
07
8-9

Location Address PUBLIC WATER SYSTEM NAME AND ADDRESS Mailing Address
Pennsylvania Power & Light Co. Senior Environmental Scientist (A1-2)
Susquehanna SES Pennsylvania Power & Light Co.
P.O. Box 467 Two North Ninth Street
Berwick, Pa. 18603 Allentown

PA. 18101

CONTAMINANT ID
0 1 0 0
10-13

CONTAMINANT NAME
TURBIDITY

ANALYSIS METHOD
0 0 1
14-16

NUMBER OF SAMPLES
REQUIRED: 0 3 1
TAKEN: 0 3 1
17-19 20-22

SAMPLE ANALYSIS RESULTS
HIGHEST: 0 0 8 0 DEC: 2
LOWEST: 0 0 3 0 DEC: 2
AVERAGE: 0 0 4 5 DEC: 2
23-26 27 28-31 32 33-36 37

NUMBER OF SAMPLES IN VIOLATION
FEDERAL MCL: 0 0 0 0
STATE MCL: 0 0 0 0
38-41 42-45

LONGEST VIOLATION DURATION
0 0 0
46-48

SAMPLE PERIOD
FROM: MO. 07 DAY 01 YR. 85
TO: MO. 07 DAY 31 YR. 85
49-54 55-60

SAMPLE TYPE
P
61

DATE OF LAST SAMPLE
MO. 07 DAY 31 YR. 85
62-67

LABORATORY ANALYZING THE MOST SAMPLES
ID: [] NAME: Susq. SES Chem Lab
68-72

CHECK SAMPLES
REGULATIONS REQUIRED NUMBER TAKEN: FEDERAL N STATE N
ACTUAL NUMBER TAKEN: 0 0 0
73 74 75-77

NOTIFIED OF VIOLATIONS
PUBLIC [] STATE []
78 79

NUMBER OF PORTIONS POSITIVE FERMENTATION TUBE METHOD
[] [] [] []


NUMBER OF SAMPLES REQUIRING CHECK SAMPLES
0 0

PREPARED BY D.G. Ortz DATE 8/2/85
APPROVED BY T.M. Crimmins DATE 8/2/85

SAMPLE TYPE KEY
C - CHECK SAMPLE
D - REGULAR DISTRIBUTION SYSTEM
P - PLANT TAP SAMPLE
R - RAW WATER SAMPLE
S - SPECIAL SAMPLE

IEP 3/71

8508120488 850731
PDR ADDCK 05000387
PDR

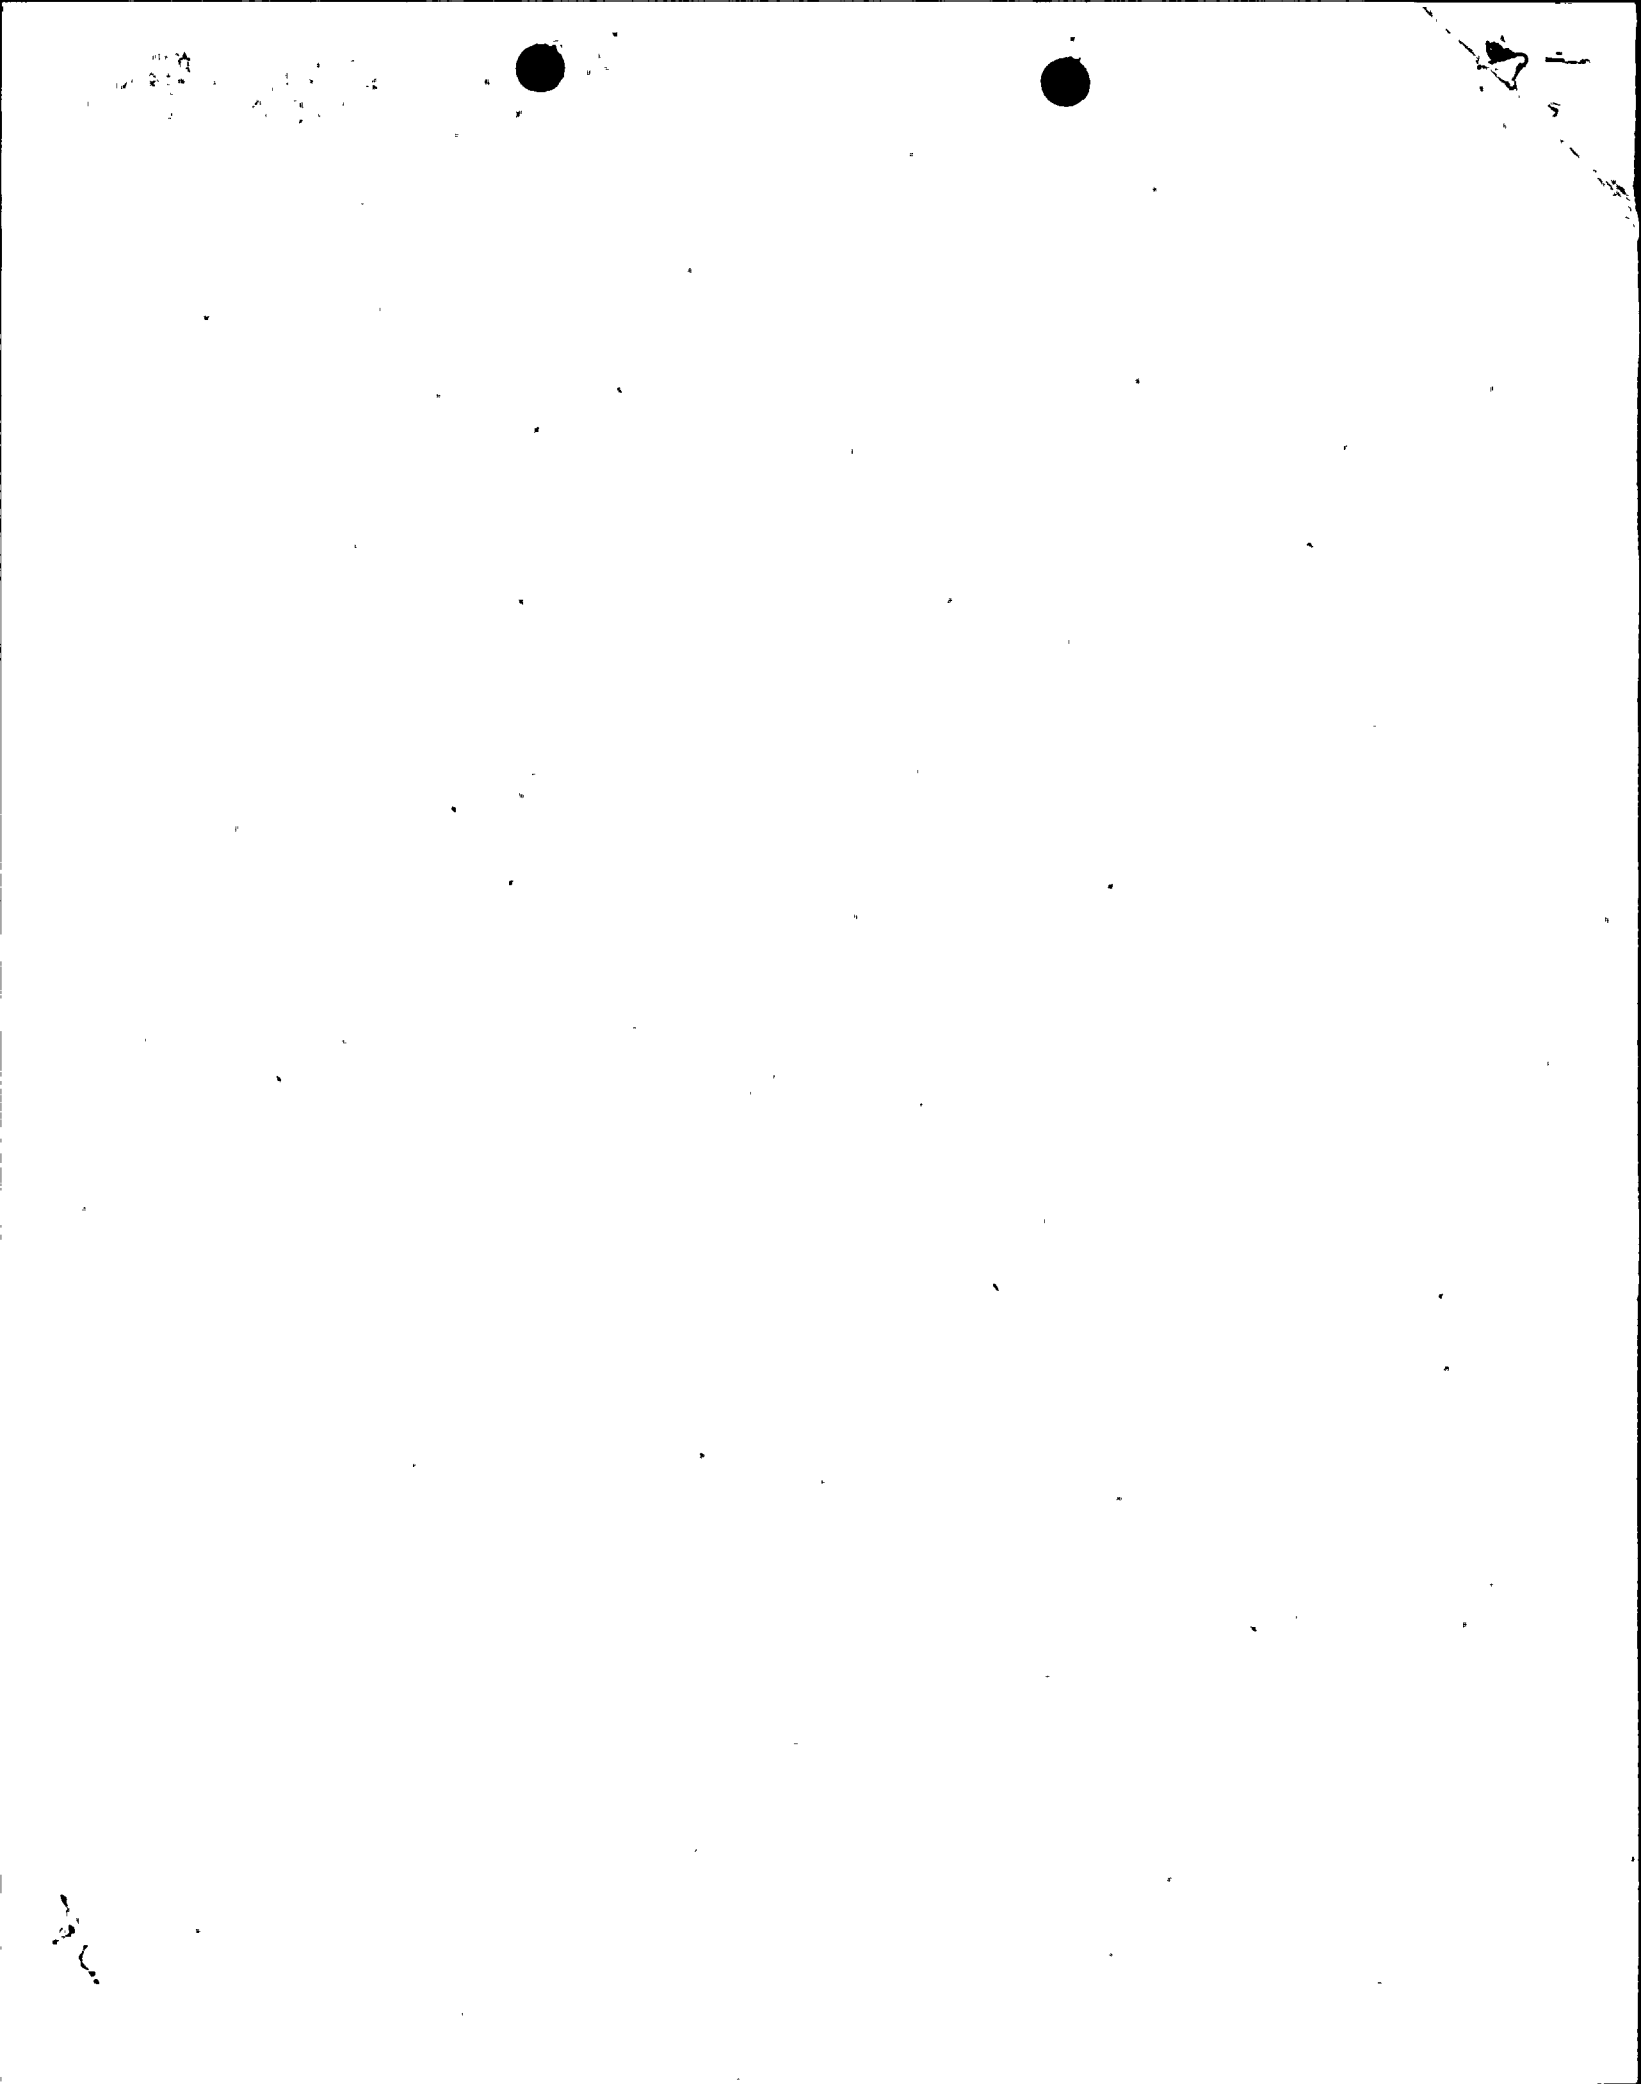



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101 • 215/770-5151

August 7, 1985

EPA Region III
Water Supply Branch (3WN43)
Sixth and Walnut Street
Philadelphia, PA 19106

SUSQUEHANNA STEAM ELECTRIC STATION
DRINKING WATER MONITORING REPORT (NIPDWR)
PWS ID 741326 JULY 1985
CCN-741326 FILE 012-03
PLE-7456

Gentlemen:

Enclosed is the July 1985 NIPDWR Monitoring Report for Pennsylvania Power and Light Company's Susquehanna Steam Electric Station.

If you have any questions, please call me at (215) 770-7889.

Respectfully yours,

J. S. Fields
Senior Environmental Scientist-Nuclear

JSF/amc

jsflth002879a

Enclosure

Copy to:

EPA Water Supply, Region II
Community Environmental Control
PA Dept. of Environmental Resources
90 E. Union Street, 2nd Floor
Wilkes-Barre, PA 18701

Mr. A. Schwencer
Licensing Branch No. 2
U.S. Nuclear Regulatory Commission
Washington, DC 20555

IE25
11