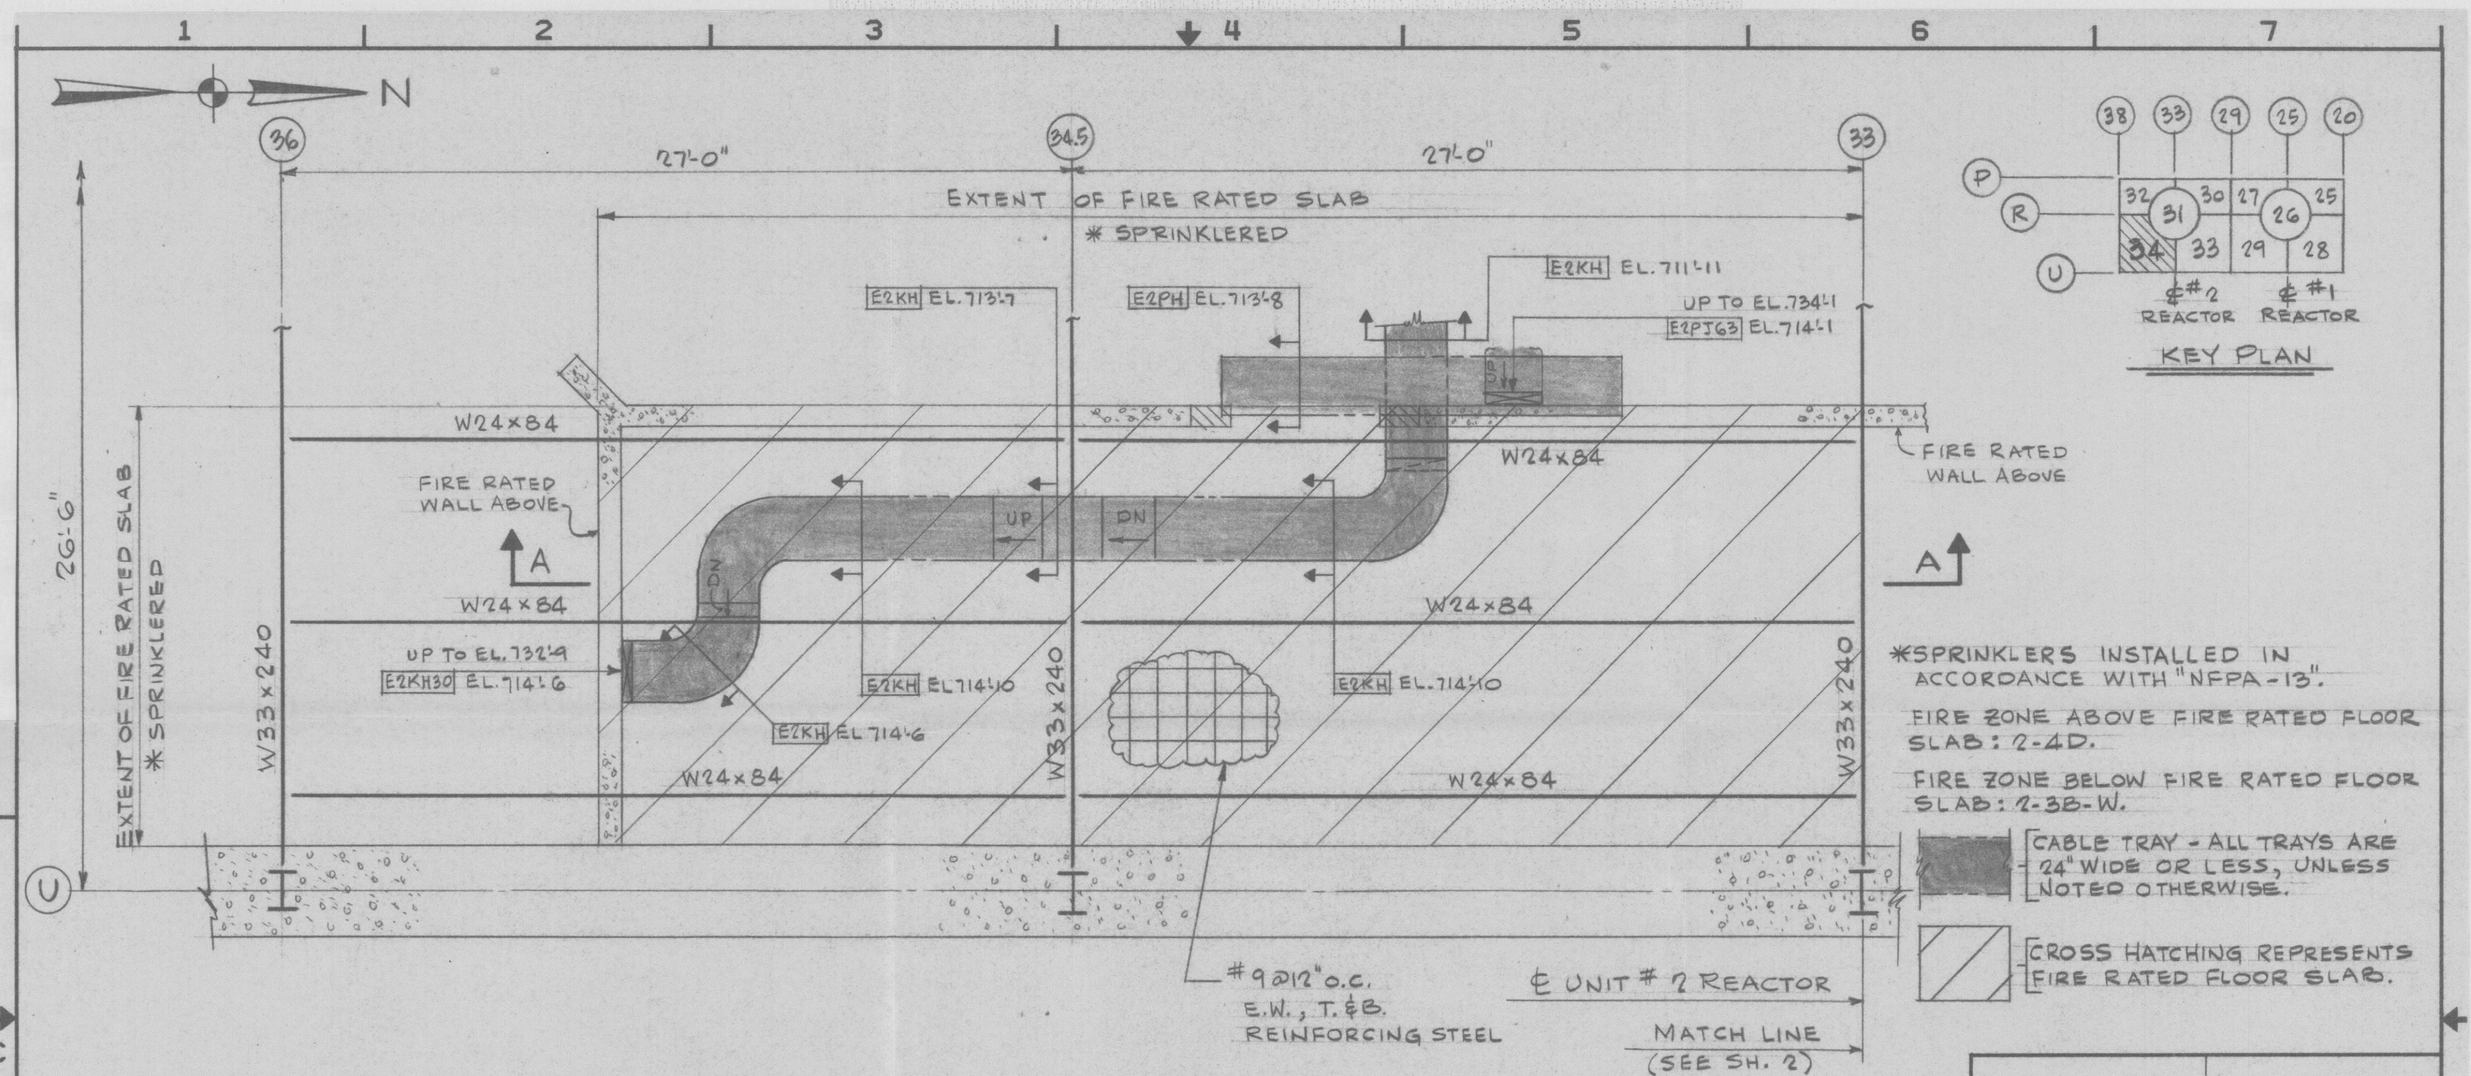

*SPRINKLERS INSTALLED IN ACCORDANCE WITH "NFPA-13".

FIRE ZONE ABOVE FIRE RATED FLOOR SLAB: 2-4D.

FIRE ZONE BELOW FIRE RATED FLOOR SLAB: 2-3B-W.

CABLE TRAY - ALL TRAYS ARE 24" WIDE OR LESS, UNLESS NOTED OTHERWISE.

CROSS HATCHING REPRESENTS FIRE RATED FLOOR SLAB.

PARTIAL PLAN BELOW EL. 719'-1

T.O.S. EL. 716'-10" U.N.O.

SCALE: 1/4"=1'-0"

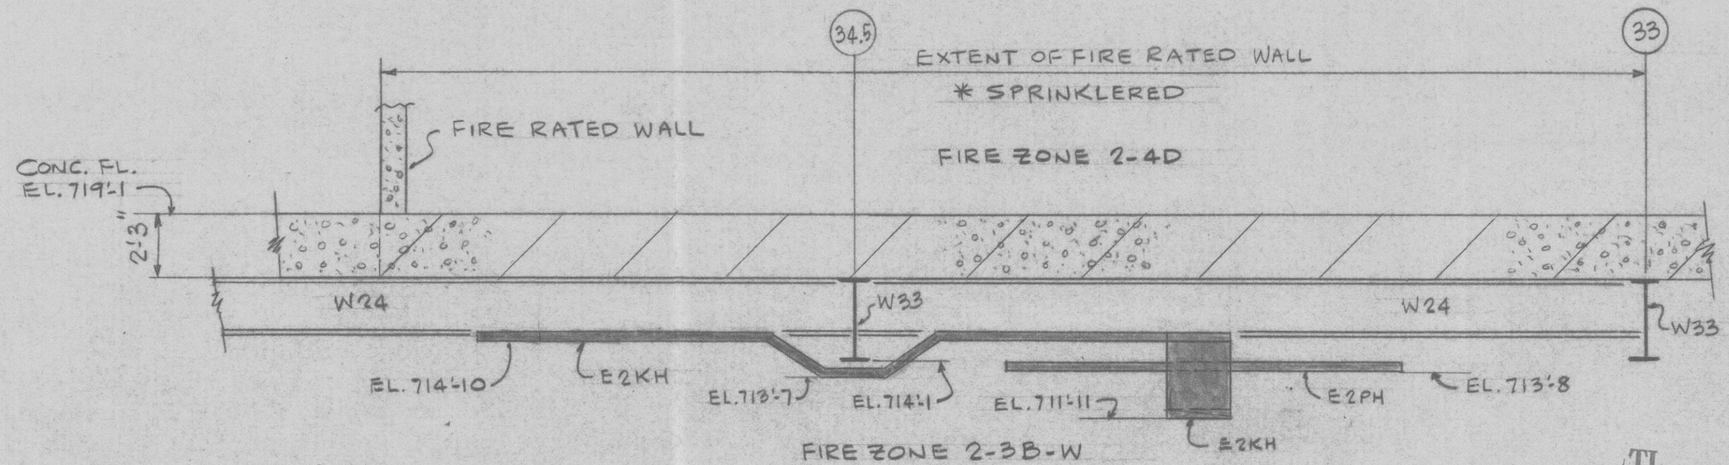

SECTION "A-A"

SCALE: 1/4"=1'-0"

C-306	E-105313
C-184	E-105233
E-34-3	E-107641 SH.3
AE DRAWING NO.	PP&L DRAWING NO.
REFERENCE DRAWINGS	

REV	DESCRIPTION	DR	CH		APPROVED	DATE
0	INITIAL ISSUE	WD	TNO	FM	TAG	12/14/84

NON-QUALITY RELATED DWG CLASS 3

SUSQUEHANNA S.E.S.
UNIT # 2
REACTOR BUILDING
APPENDIX R-DEVIATION REQ.#6
FIRE RATED FL. SLAB EL. 719'-1

AREA 34	ELEV. 719'-1	SCALE: NOTED

PENNSYLVANIA POWER & LIGHT COMPANY
ALLENTOWN PA.

PP&L DRAWING NO.	SHEET NO.	REV. NO.
C-206022	1	0

AE DRAWING NO. C-1779

APERTURE CARD

8611060279

PP&L FORM 350SC (1/84)

60712