

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8504160243 DOC. DATE: 85/04/04 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylvania 05000387
 AUTH. NAME AUTHOR AFFILIATION
 CURTIS, N.W. Pennsylvania Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 SCHWENCER, A. Licensing Branch 2

SUBJECT: Forwards addl info in support of proposed Amend 43 to
 License NPF-14 re surveillance testing of batteries & diesel
 generators, per NRC request.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 4
 TITLE: OR Submittal: General Distribution

NOTES: 1cy NMSS/FCAF/PM, LPDR 2cys Transcripts. 05000387
 OL: 07/17/82

	RECIPIENT ID CODE/NAME		COPIES LTTR ENCL		RECIPIENT ID CODE/NAME		COPIES LTTR ENCL
	NRR LB2 BC	01	7	7			
INTERNAL:	ACRS	09	6	6	ADM/LFMB		1 0
	ELD/HDS4		1	0	NRR/DE/MTEB		1 1
	NRR/DL DIR		1	1	NRR/DL/ORAB		1 0
	NRR/DL/TSRG		1	1	NRR/DSI/METB		1 1
	NRR/DSI/RAB		1	1	<u>REG FILE</u>	04	1 1
	RGN1		1	1			
EXTERNAL:	EG&G BRUSKE, S		1	1	LPDR	03	2 2
	NRC PDR	02	1	1	NSIC	05	1 1
NOTES:			3	3			

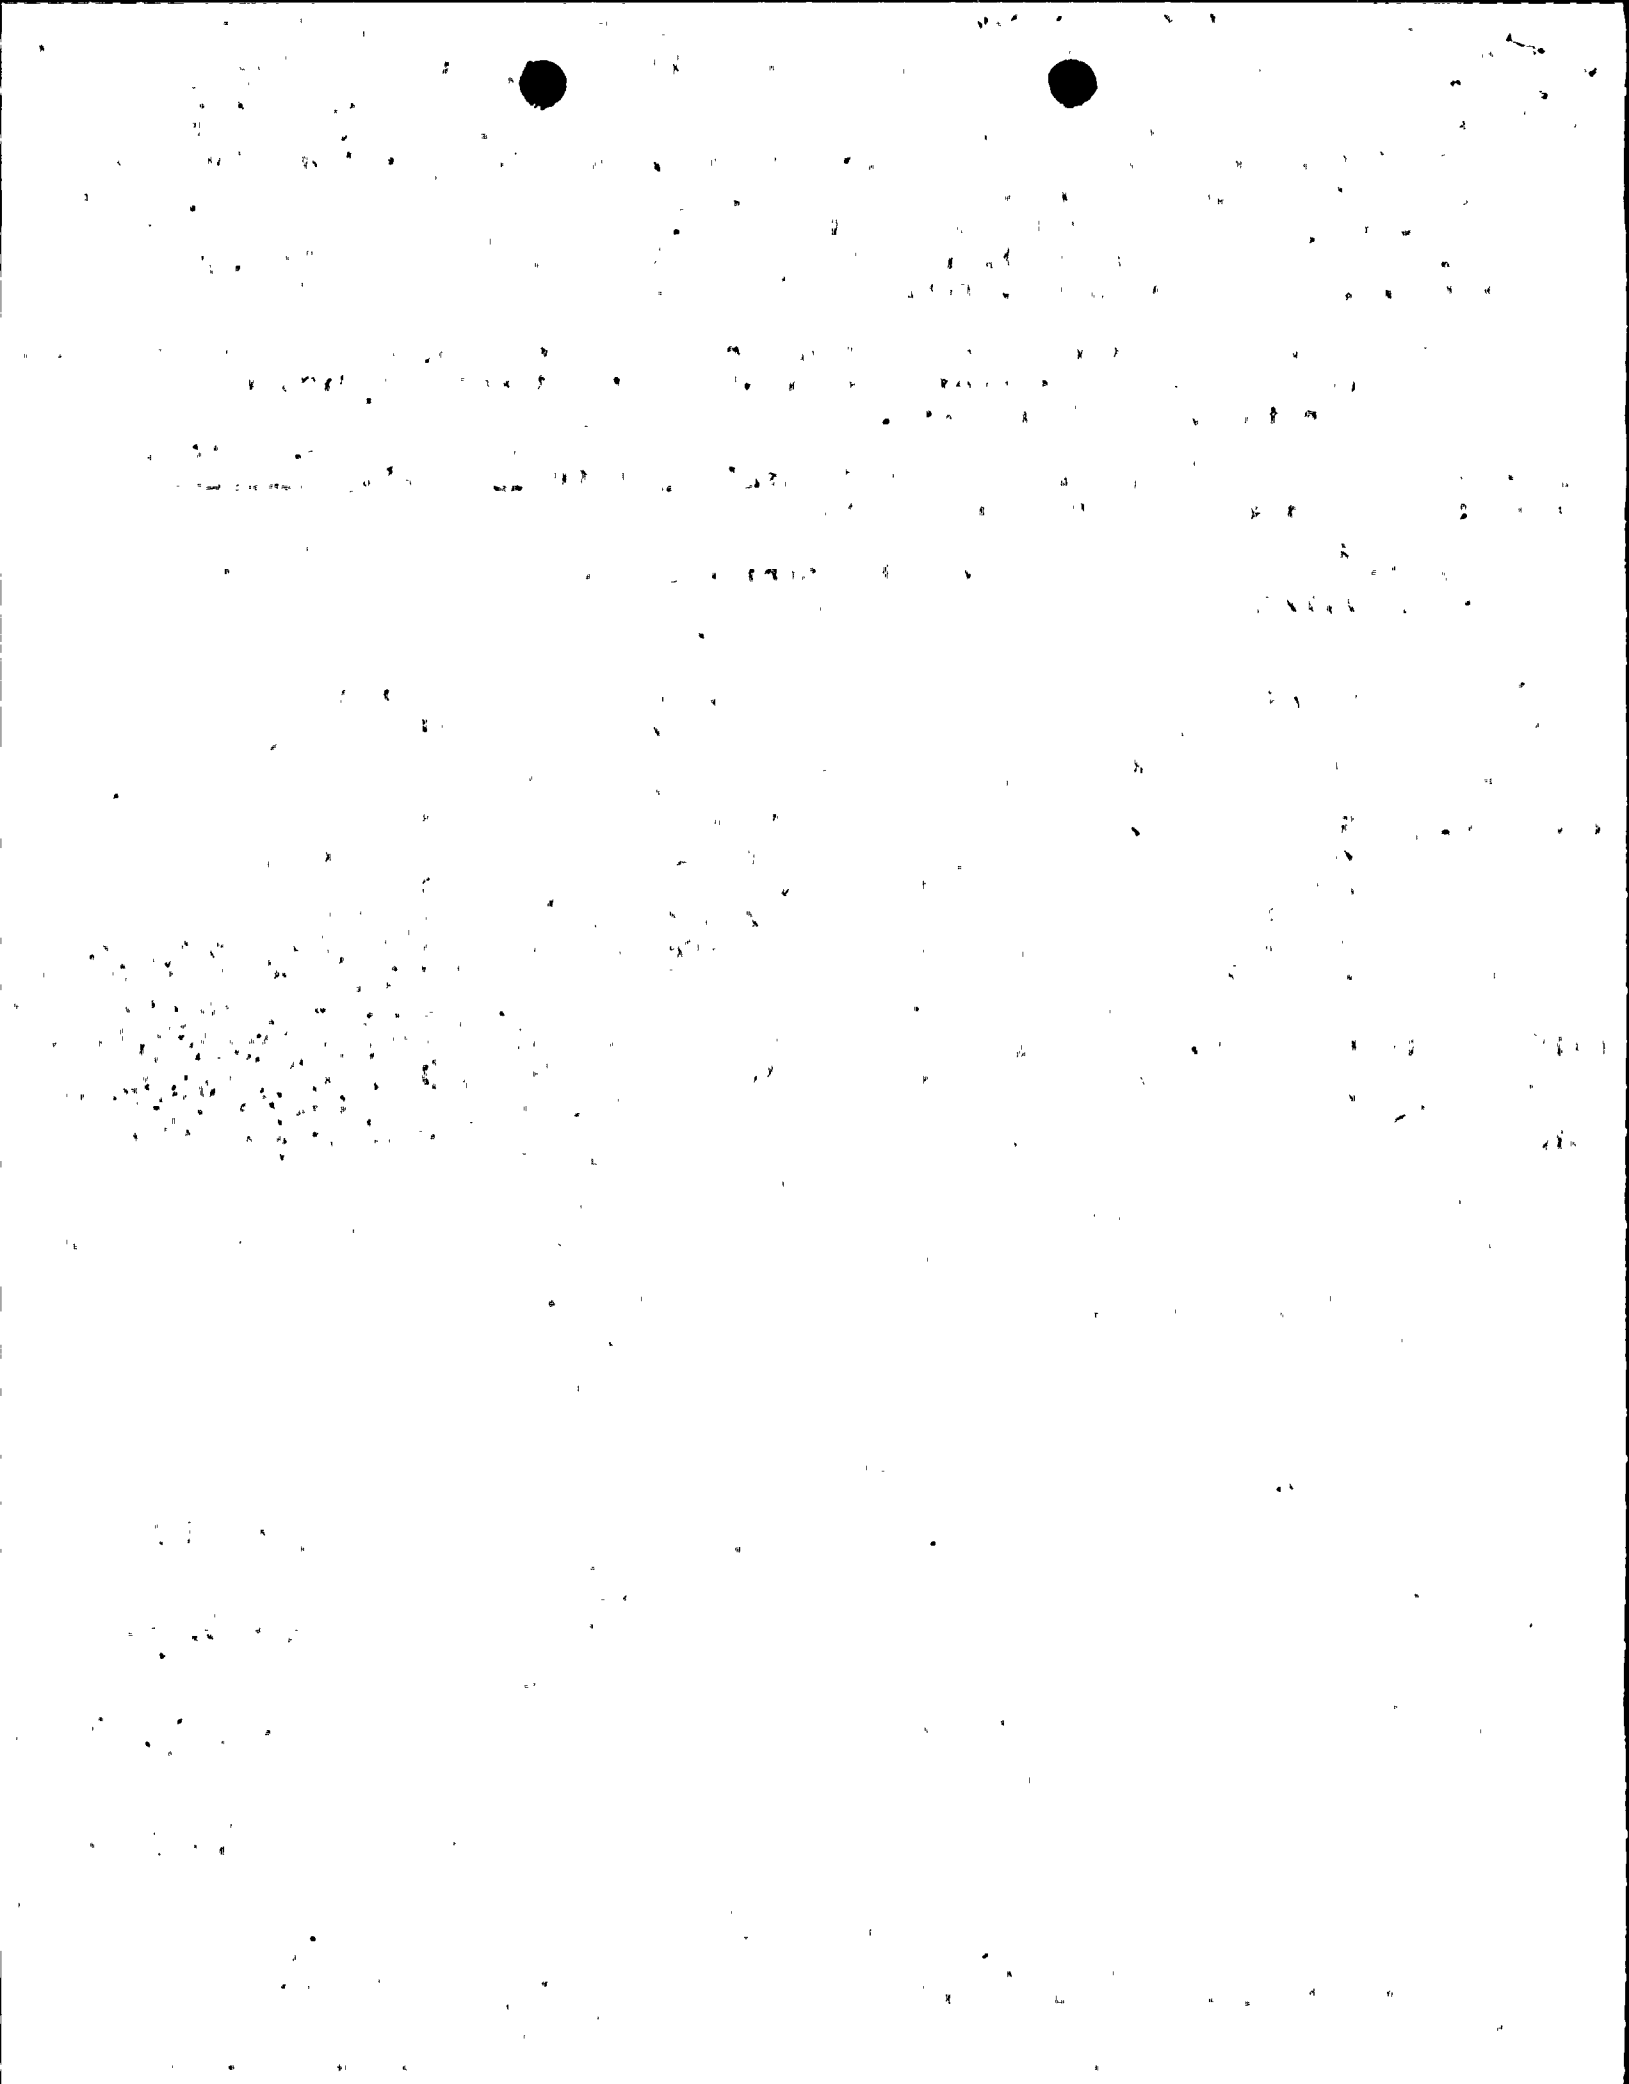



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101 • 215 / 770-5151

Norman W. Curtis
Vice President-Engineering & Construction-Nuclear
215/770-7501

APR 04 1985

Director of Nuclear Reactor Regulation
Attention: Mr. A. Schwencer, Chief
Licensing Branch No. 2
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, DC 20555

SUSQUEHANNA STEAM ELECTRIC STATION
ADDITIONAL INFORMATION - PROPOSED AMENDMENT 43
ER 100450 FILE 841-8
PLA-2450

Docket No. 50-387

Dear Mr. Schwencer:

The following information on surveillance testing of batteries and diesel generators at Susquehanna SES is provided at the request of your staff in support of their review of proposed Amendment 43 to Licensing No. NPF-14. In that proposal, PP&L requested that the condition "during shutdown" be removed from Specifications 4.8.1.1.2d and 4.8.2.1d.

Specification 4.8.1.1.2d

The attached tables, one for each unit, delineate PP&L's procedural requirements for performing each of the tests under this specification (assuming proposed Amendment 43 is approved); i.e., whether or not the unit will be shutdown when the test is performed; whether a test can be performed once and taken credit for on both units ("Common"); or whether the test must be performed for each unit, due to unit-specific aspects of the test ("Unitized"), such as the testing of the unitized emergency busses under Specification 4.8.1.1.2d.4.

Specification 4.8.2.1d

With respect to battery testing, the removal of the "during shutdown" condition is important because the 125-volt batteries for Unit 2 are now listed in the Unit 1 Technical Specifications due to Amendment 31 to NPF-14. Therefore, the Unit 1 Technical Specifications require load profile testing of the Unit 2 batteries during the shutdown of Unit 1. PP&L's procedural requirements for performing the required tests (again assuming proposed Amendment 43 is approved) is that the Unit 1 batteries will be tested during Unit 1 shutdown, and the Unit 2 batteries during Unit 2 shutdown.

8504160243 850404
PDR ADDCK 05000387
PDR

Pool
11



10

[The body of the document contains extremely faint and illegible text, likely bleed-through from the reverse side of the page. The text is scattered across the page and cannot be transcribed accurately.]

APR 4 1985

Page 2

SSES PLA-2450
ER 100450 File 841-8
Mr. A. Schwencer

Very truly yours,



N. W. Curtis
Vice President-Engineering & Construction-Nuclear

Attachments

cc: M. J. Campagnone USNRC
R. H. Jacobs USNRC

T. M. Gerusky, Director
Bureau of Radiation Protection
Pa. Dept. of Environmental Resources
P. O. Box 2063
Harrisburg, PA 17120

UNIT ONE

<u>SPECIFICATION</u>	<u>UNIT ONE SHUTDOWN ?</u>	<u>TEST TYPE</u> /	<u>FREQUENCY</u>
4.8.1.1.2d.1	No.	Common /	18 mos.
4.8.1.1.2d.2	Yes.	Unitized /	18 mos.
4.8.1.1.2d.3	Shutdown of the unit on which the test is being performed is required. This may be Unit 1.	Common /	18 mos.
4.8.1.1.2d.4	Yes.	Unitized /	18 mos.
4.8.1.1.2d.5	No.	Unitized /	18 mos.
4.8.1.1.2d.7	Yes.	Unitized /	18 mos.
4.8.1.1.2d.8	Yes.	Common /	18 mos.
4.8.1.1.2d.9	Yes.	Common /	18 mos.
4.8.1.1.2d.10	Yes.	Unitized /	18 mos.
4.8.1.1.2d.11	No.	Unitized /	18 mos.
4.8.1.1.2d.13	No.	Common /	18 mos.
4.8.1.1.2d.14	Yes.	Unitized /	18 mos.
4.8.1.1.2d.15	No.	Common /	18 mos.



1	2	3	4	5	6	7	8	9	10
11	12	13	14	15	16	17	18	19	20
21	22	23	24	25	26	27	28	29	30
31	32	33	34	35	36	37	38	39	40
41	42	43	44	45	46	47	48	49	50
51	52	53	54	55	56	57	58	59	60
61	62	63	64	65	66	67	68	69	70
71	72	73	74	75	76	77	78	79	80
81	82	83	84	85	86	87	88	89	90
91	92	93	94	95	96	97	98	99	100

101

102

103

104

105

UNIT TWO

<u>SPECIFICATION</u>	<u>UNIT TWO SHUTDOWN ?</u>	<u>TEST TYPE</u> / <u>FREQUENCY</u>
4.8.1.1.2d.1	No.	Common / 18 mos.
4.8.1.1.2d.2	Yes.	Unitized / 18 mos.
4.8.1.1.2d.3	Shutdown of the unit on which the test is being performed is required. This may be Unit 2.	Common / 18 mos.
4.8.1.1.2d.4	Yes.	Unitized / 18 mos.
4.8.1.1.2d.5	No.	Unitized / 18 mos.
4.8.1.1.2d.6	Yes.	Unitized / 18 mos.
4.8.1.1.2d.7	Yes.	Common / 18 mos.
4.8.1.1.2d.8	Yes.	Common / 18 mos.
4.8.1.1.2d.9	Yes.	Unitized / 18 mos.
4.8.1.1.2d.10	No.	Unitized / 18 mos.
4.8.1.1.2d.11	No.	Common / 18 mos.
4.8.1.1.2d.12	Yes.	Unitized / 18 mos.
4.8.1.1.2d.13	No.	Common / 18 mos.

10/10/10

The following information was obtained from the records of the
 Department of the Interior, Bureau of Land Management, on
 October 10, 1910, regarding the land owned by the
 United States in the State of California, and more
 particularly in the County of San Diego, California.
 The land is situated in the Township of San Marcos,
 Range 14 North, and Meridian 11 West, and is
 more particularly described as follows:

Section	Acres	Owner
1	36.00	United States
2	36.00	United States
3	36.00	United States
4	36.00	United States
5	36.00	United States
6	36.00	United States
7	36.00	United States
8	36.00	United States
9	36.00	United States
10	36.00	United States
11	36.00	United States
12	36.00	United States
13	36.00	United States
14	36.00	United States
15	36.00	United States
16	36.00	United States
17	36.00	United States
18	36.00	United States
19	36.00	United States
20	36.00	United States
21	36.00	United States
22	36.00	United States
23	36.00	United States
24	36.00	United States
25	36.00	United States
26	36.00	United States
27	36.00	United States
28	36.00	United States
29	36.00	United States
30	36.00	United States
31	36.00	United States
32	36.00	United States
33	36.00	United States
34	36.00	United States
35	36.00	United States
36	36.00	United States
37	36.00	United States
38	36.00	United States
39	36.00	United States
40	36.00	United States
41	36.00	United States
42	36.00	United States
43	36.00	United States
44	36.00	United States
45	36.00	United States
46	36.00	United States
47	36.00	United States
48	36.00	United States
49	36.00	United States
50	36.00	United States
51	36.00	United States
52	36.00	United States
53	36.00	United States
54	36.00	United States
55	36.00	United States
56	36.00	United States
57	36.00	United States
58	36.00	United States
59	36.00	United States
60	36.00	United States
61	36.00	United States
62	36.00	United States
63	36.00	United States
64	36.00	United States
65	36.00	United States
66	36.00	United States
67	36.00	United States
68	36.00	United States
69	36.00	United States
70	36.00	United States
71	36.00	United States
72	36.00	United States
73	36.00	United States
74	36.00	United States
75	36.00	United States
76	36.00	United States
77	36.00	United States
78	36.00	United States
79	36.00	United States
80	36.00	United States
81	36.00	United States
82	36.00	United States
83	36.00	United States
84	36.00	United States
85	36.00	United States
86	36.00	United States
87	36.00	United States
88	36.00	United States
89	36.00	United States
90	36.00	United States
91	36.00	United States
92	36.00	United States
93	36.00	United States
94	36.00	United States
95	36.00	United States
96	36.00	United States
97	36.00	United States
98	36.00	United States
99	36.00	United States
100	36.00	United States

10/10/10