

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8807210095 DOC. DATE: 88/06/30 NOTARIZED: NO DOCKET #
FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
AUTH. NAME AUTHOR AFFILIATION
SAXTON, C.H. Pennsylvania Power & Light Co.
RECIP. NAME RECIPIENT AFFILIATION

SUBJECT: "Bacteriological or Turbidity Summary Analysis Input," for
June 1988.W/880713 ltr.

DISTRIBUTION CODE: C001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2
TITLE: Licensing Submittal: Environmental Rept Amdt & Related Correspondence

NOTES: LPDR 2 cys Transcripts. 05000387
LPDR 2 cys Transcripts. 05000388

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD1-2 LA THADANI, M	1 1 1 1	PD1-2 PD	1 1
INTERNAL:	ACRS	6 6	AEOD/DOA	1 1
	AEOD/DSP/TPAB	1 1	ARM/DAF/LFMB	1 0
	NRR/DEST/ADE 8H	1 1	NRR/DEST/SGB 8D	1 1
	NRR/DREP/RPB 10	4 4	NUDOCS-ABSTRACT	1 1
	OGC 15-B-18	1 0	<u>REG FILE</u> 01	1 1
EXTERNAL:	LPDR	2 2	NRC PDR	1 1
	NSIC	1 1		
NOTES:		2 2		


TOTAL NUMBER OF COPIES REQUIRED: LTTR 27 ENCL 25

R
I
D
S

A
D
D
S

R
I
D
S

A
D
D
S

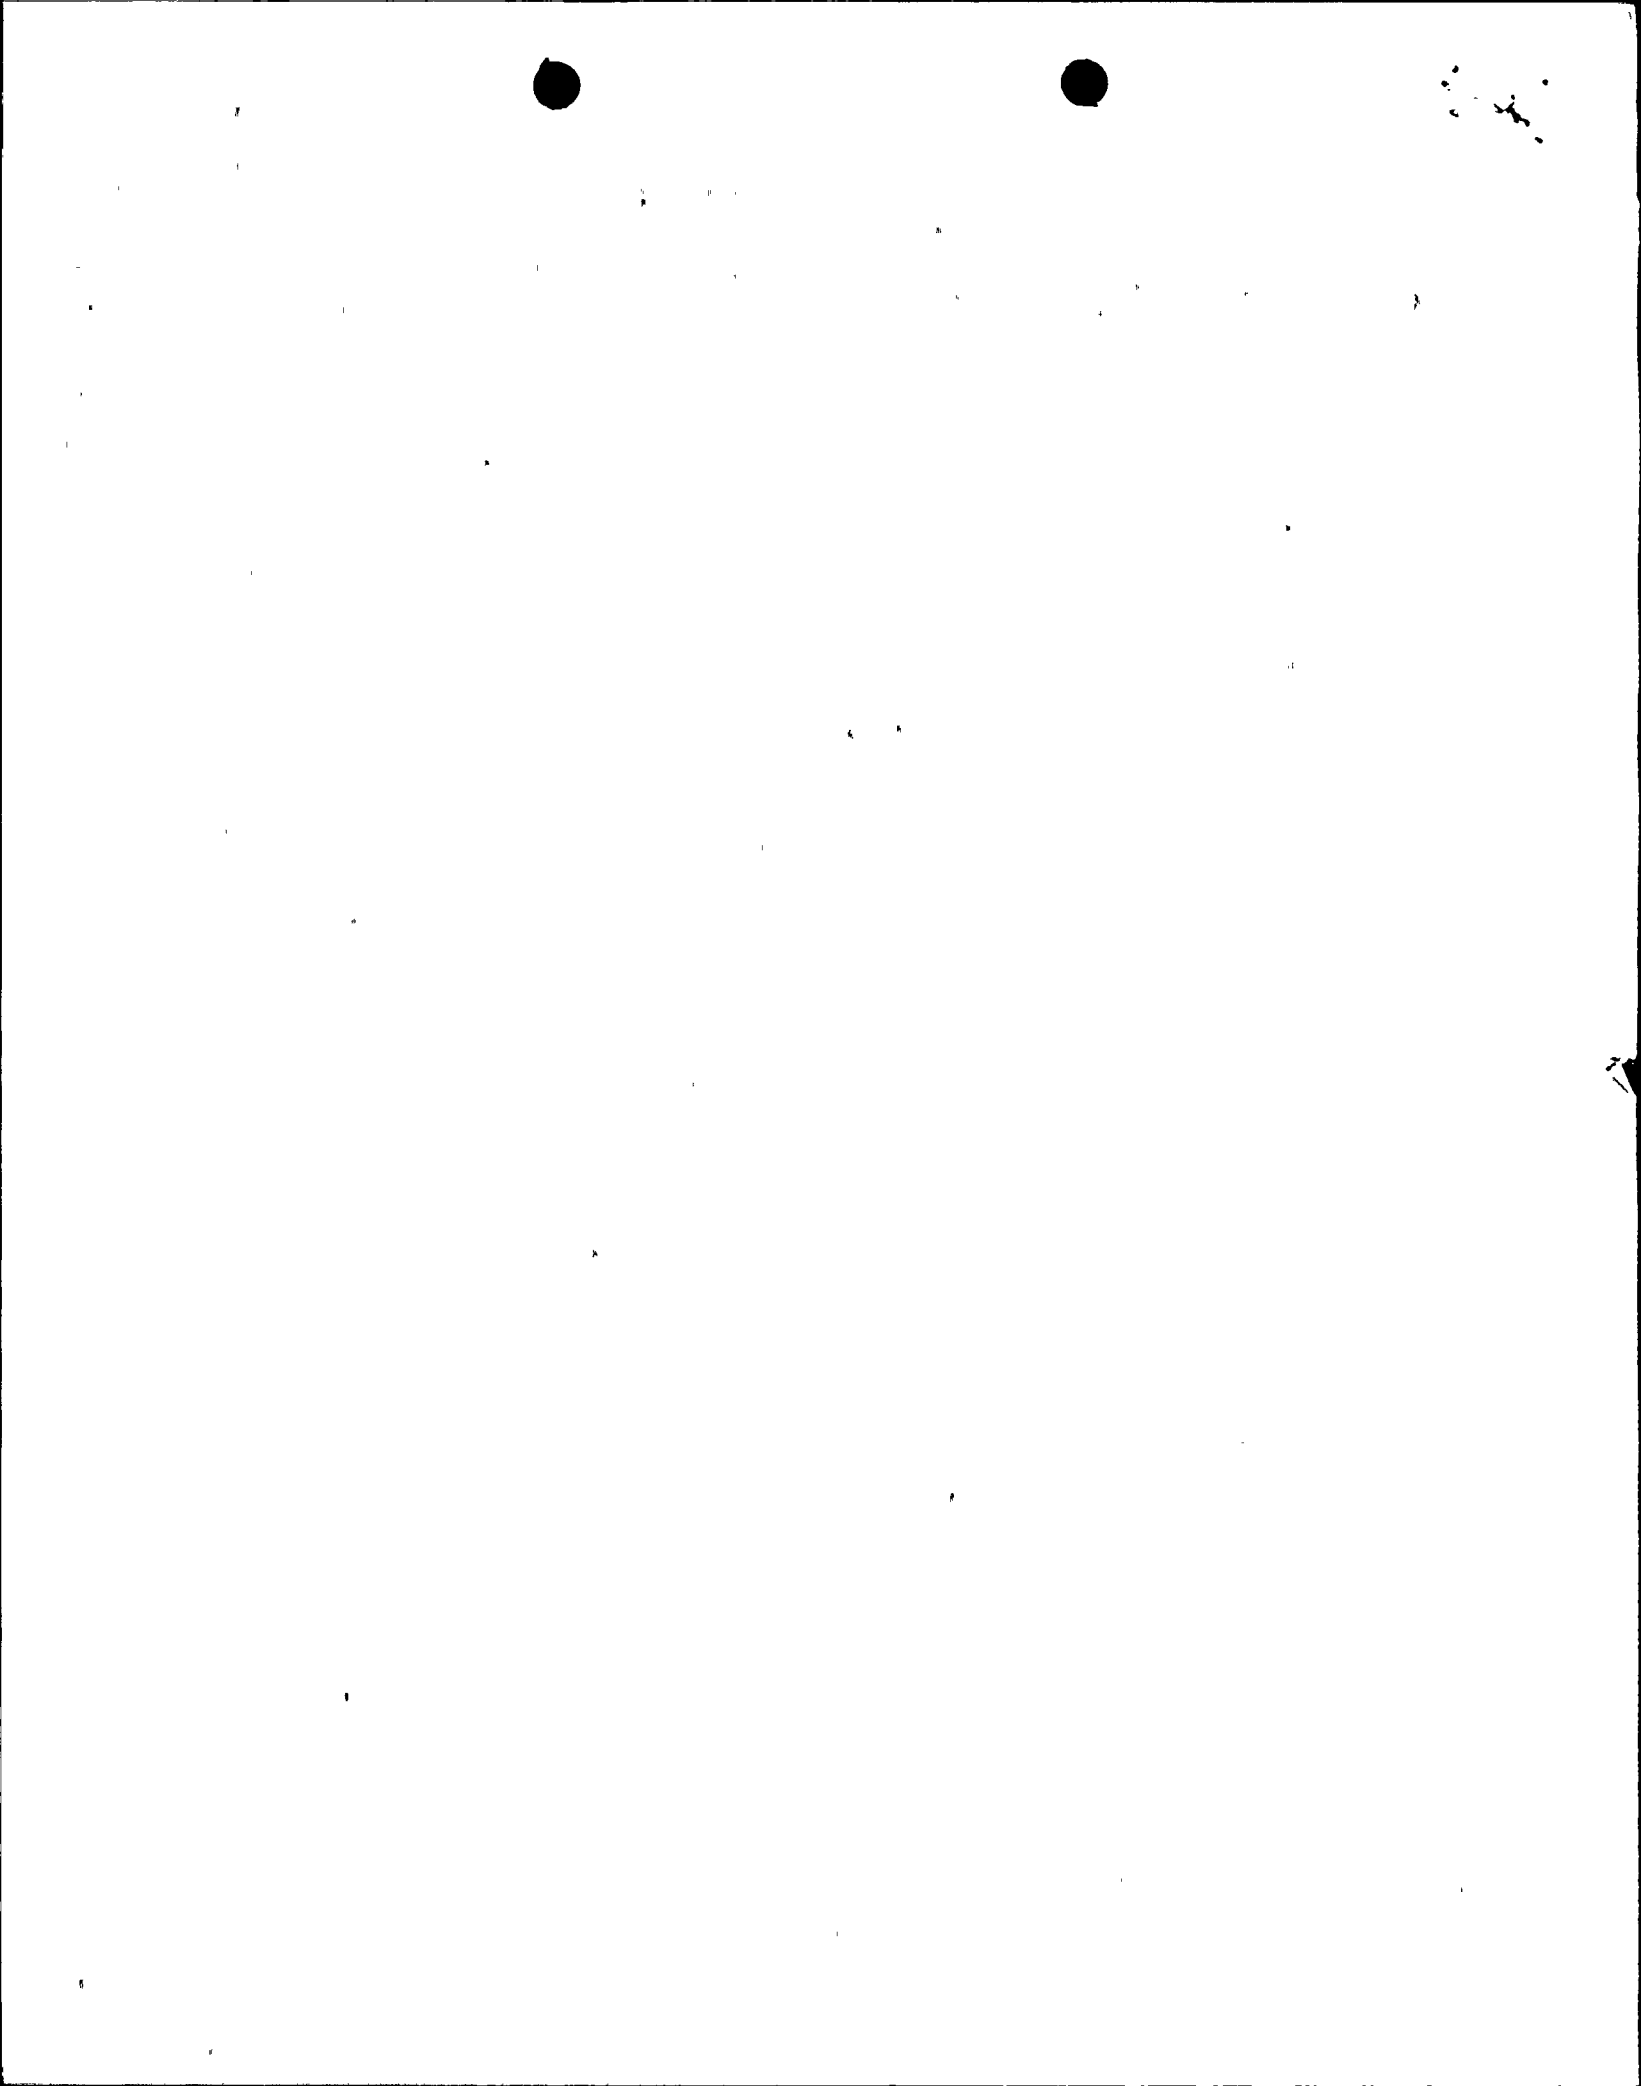

MODEL STATE INFORMATION SYSTEM
 BACTERIOLOGICAL OR TURBIDITY SUMMARY ANALYSIS INPUT
 WAQC .402



COMMONWEALTH OF PENNSYLVANIA
 DEPARTMENT OF ENVIRONMENTAL RESOURCES

Mailing Address	PUBLIC WATER SYSTEM NAME AND ADDRESS	Location Address
Sr. Env. Scientist - Nuclear (A1-2) Pennsylvania Power & Light Co. Two North Ninth Street Allentown, PA 18101	Pennsylvania Power & Light Co. Susquehanna Steam Electric Station P.O. Box 467 Berwick, PA 18603	
		PWS PHONE (717) 542-3264

INSERT AN "X" IF ANY ELEVATED RESULTS DURING THIS PERIOD. Coliform: >1/100 ml or ≥ 1 tube
 Turbidity: >1 NTU

PWS ID
 2400998
 1-7

TRANSACTION CODE
 07
 8-9

CONTAMINANT ID
 0100
 10-13

CONTAMINANT NAME
 Turbidity

ANALYSIS METHOD
 001
 14-16

NUMBER OF SAMPLES
 RECEIVED: 030
 TAKEN: 030
 17-19 20-22

2 DAY TURBIDITY VIOL
 YES NO

SAMPLE ANALYSIS RESULTS

HIGHEST	DEC	LOWEST	DEC	AVERAGE	DEC
0035	2	0025	2	0029	2
23-26	27	28-31	32	33-36	37

For Bact: Enter total number of "D" samples > 4/100 ml or > 2 tubes
 OR
 For Turb: Enter total number of samples contributing to 2-day violations

NO SAMPLES
 0000
 38-41

DUP 42-45

For Bact: Enter longest violation duration
 OR
 For Turb: Enter longest duration of any 2-day violation (average > 5)

DURATION
 000 Days
 46-48

SAMPLE PERIOD

FROM			UNTIL		
MO	DAY	YR	MO	DAY	YR
06	01	88	06	30	88
49-54			55-60		

Sample Type
 D
 61

DATE OF LAST SAMPLE

MO	DAY	YR
06	30	88
62-67		

LAB ID
 [] [] []
 68-72

Were all required check samples taken?
 Y = YES
 N = NO
 []
 74

Actual number of check samples taken
 [] [] []
 75-77

Turbidity entry point ID
 [] [] []
 80

PREPARED BY Diane B Davis Date 6-30-88
 APPROVED BY [Signature] Date 7-5-88

LAB NAME
 Susq. Chemistry LAB
 LAB PHONE
 (717) 542-3389

SAMPLE TYPE KEY

- C - CHECK SAMPLE
- D - REGULAR DISTRIBUTION SYSTEM
- P - PLANT TAP SAMPLE
- R - RAW WATER SAMPLE
- S - SPECIAL SAMPLE

DISTRIBUTION
 WHITE - DATA PROCESSING
 CANARY - WATER SUPPLIER
 PINK - LABORATORY
 BLUE - DER DISTRICT

NOTE: Notify the Department in Writing of an MCL violation within 48 hours of its determination.

000111

8807210095 880630
 PDR ADCK 05000387
 R PDC





Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101 • 215 / 770-5151

July 13, 1988

CRCP-Sterling Systems, Inc.
Attn: Patti Hull
2330 Erarat Boulevard
Harrisburg, PA 17710

SUSQUEHANNA STEAM ELECTRIC STATION
DRINKING WATER MONITORING REPORT (NIPDWR)
PWS ID 2400998 JUNE 1988
CCN 741326 FILE R9-8B
PLE- 10682 1/

Enclosed please find the June 1988 Turbidity Monitoring Report for Pennsylvania Power and Light Company's Susquehanna Steam Electric Station.

All values reported are within the maximum contaminant level required by the Pennsylvania Department of Environmental Resources.

If you have any questions, please contact me at (215) 770-7891.

Respectfully yours,

Curtis H. Saxton
Environmental Specialist-Nuclear

chs1tj3040o(25)

cc: ~~Mr. R. Sager~~ Pa-~~DER~~
~~Dr. W. R. Butler~~ US-NRC

Enclosure

COOL
|||

