

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8810190103 DOC. DATE: 88/10/12 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
 AUTH. NAME AUTHOR AFFILIATION
 SAXTON, C.H. Pennsylvania Power & Light Co.
 RECIPIENT NAME RECIPIENT AFFILIATION
 LABUZ, J.P. Pennsylvania, Commonwealth of

SUBJECT: Informs that final evaluation of well cross-tie project completed & recommendation & funding to install approved.

DISTRIBUTION CODE: C001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: Licensing Submittal: Environmental Rept Amdt & Related Correspondence

NOTES: LPDR 2 cys Transcripts. 05000387
 LPDR 2 cys Transcripts. 05000388

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD1-2 LA		1	1		PD1-2 PD		1	1
	THADANI, M		1	1					
INTERNAL:	ACRS		6	6		AEOD/DSP/TPAB		1	1
	ARM/DAF/LFMB		1	0		NRR/DEST/ADE 8H		1	1
	NRR/DEST/SGB 8D		1	1		NRR/DREP/RPB 10		4	4
	NUDOGS-ABSTRACT		1	1		OGC/HDS2		1	0
	REG FILE 01		1	1					
EXTERNAL:	LPDR		2	2		NRC PDR		1	1
	NSIC		1	1					
NOTES:			2	2					


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 26 ENCL 0 ~~24~~

E-C-1

R
I
D
S
/
A
D
D
S

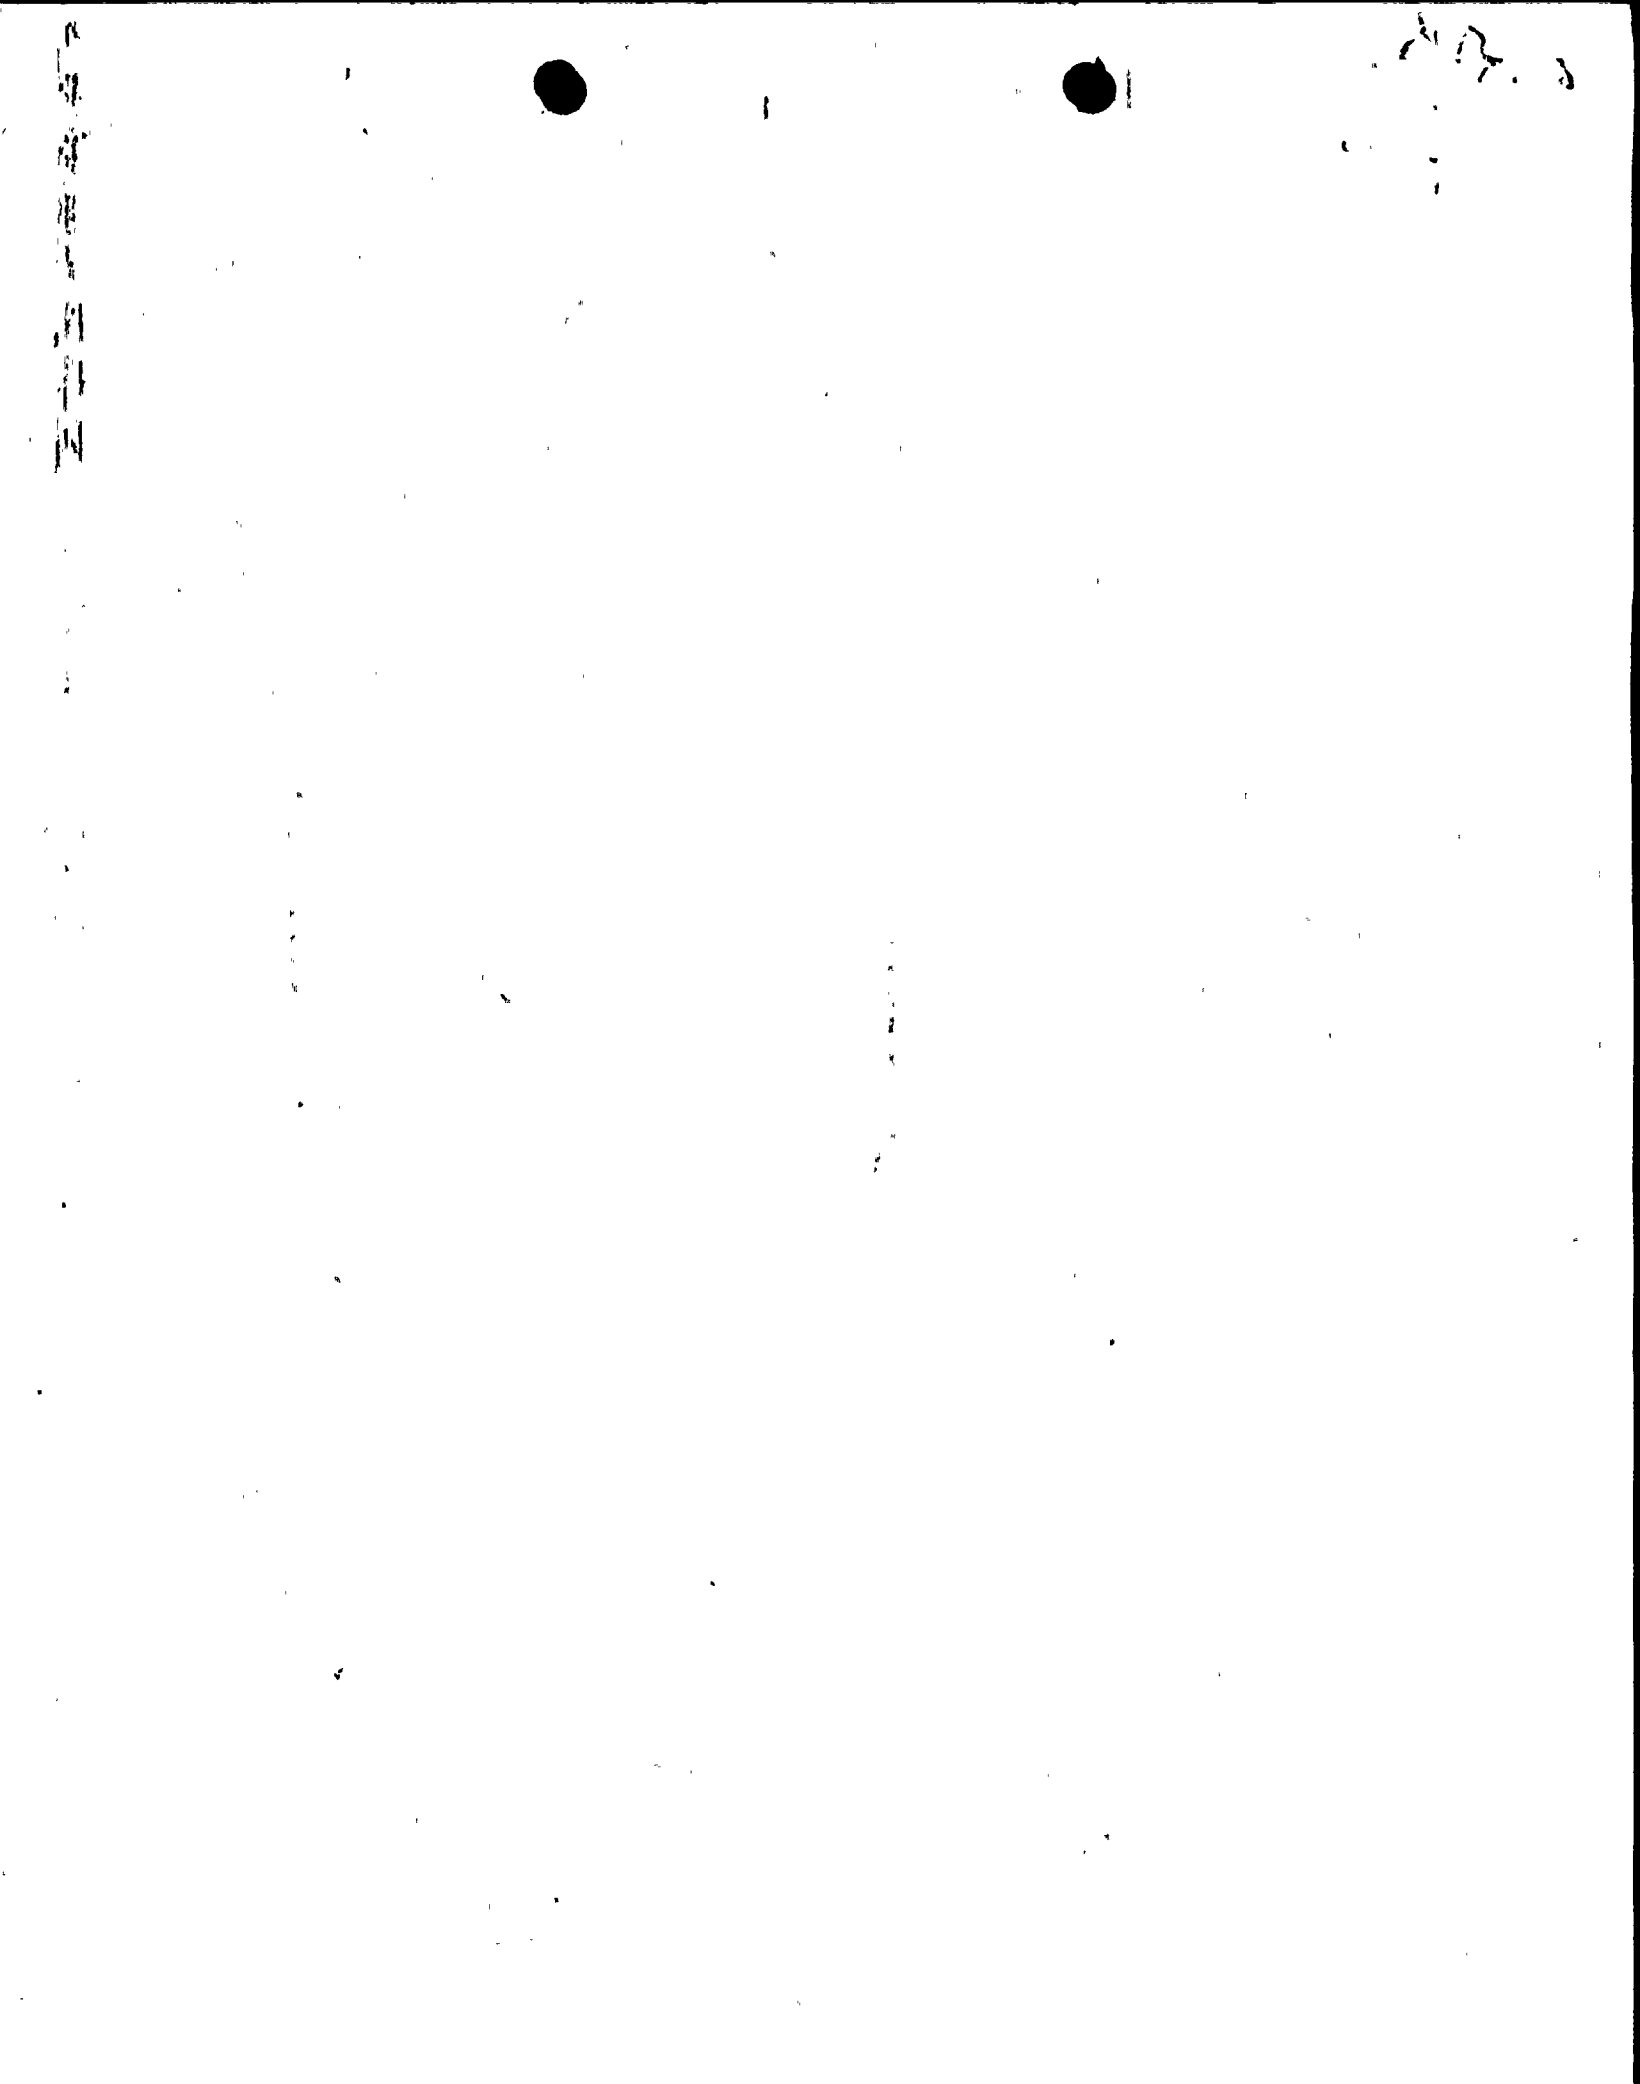



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101 • 215 / 770-5151

October 12, 1988

Mr. James P. LaBuz
Sanitary Engineer
Bureau of Community Environmental Control
Pennsylvania Department of Environmental Resources
90 East Union Street, Second Floor
Wilkes-Barre, PA 18701-3296

SUSQUEHANNA STEAM ELECTRIC STATION
WELL CROSS-TIE PROJECT APPROVED
CCN 741326 FILE R9-8B
PLE-10921

During our telephone conversation of September 28, 1988, I indicated Pennsylvania Power and Light Company was in the final stages of evaluating a major project to install a permanent well cross-tie. This cross-tie would allow the site well system (PWS 2400994) to replace the river water source (PWS 2400998) for drinking water at the station.

This letter is to inform you that the final evaluation has been completed and the recommendation and funding to install this project has been approved.

A preliminary schedule indicates construction of the well cross-tie will begin shortly and should be completed by the end of the year. I will keep you informed of the status of this activity as construction progresses.

Respectfully yours,

Curtis H. Saxton
Environmental Specialist-Nuclear

chsltj8113a(25)

cc: Mr. R. Sager Pa-DER
Dr. W. R. Butler US NRC

8810190103 881012
PDR ADOCK 05000387
P PIC

Cool
1/0

10/10/10



10/10/10