


1 2 3 4 5 6 7 8 9 10

A B C D E F G H

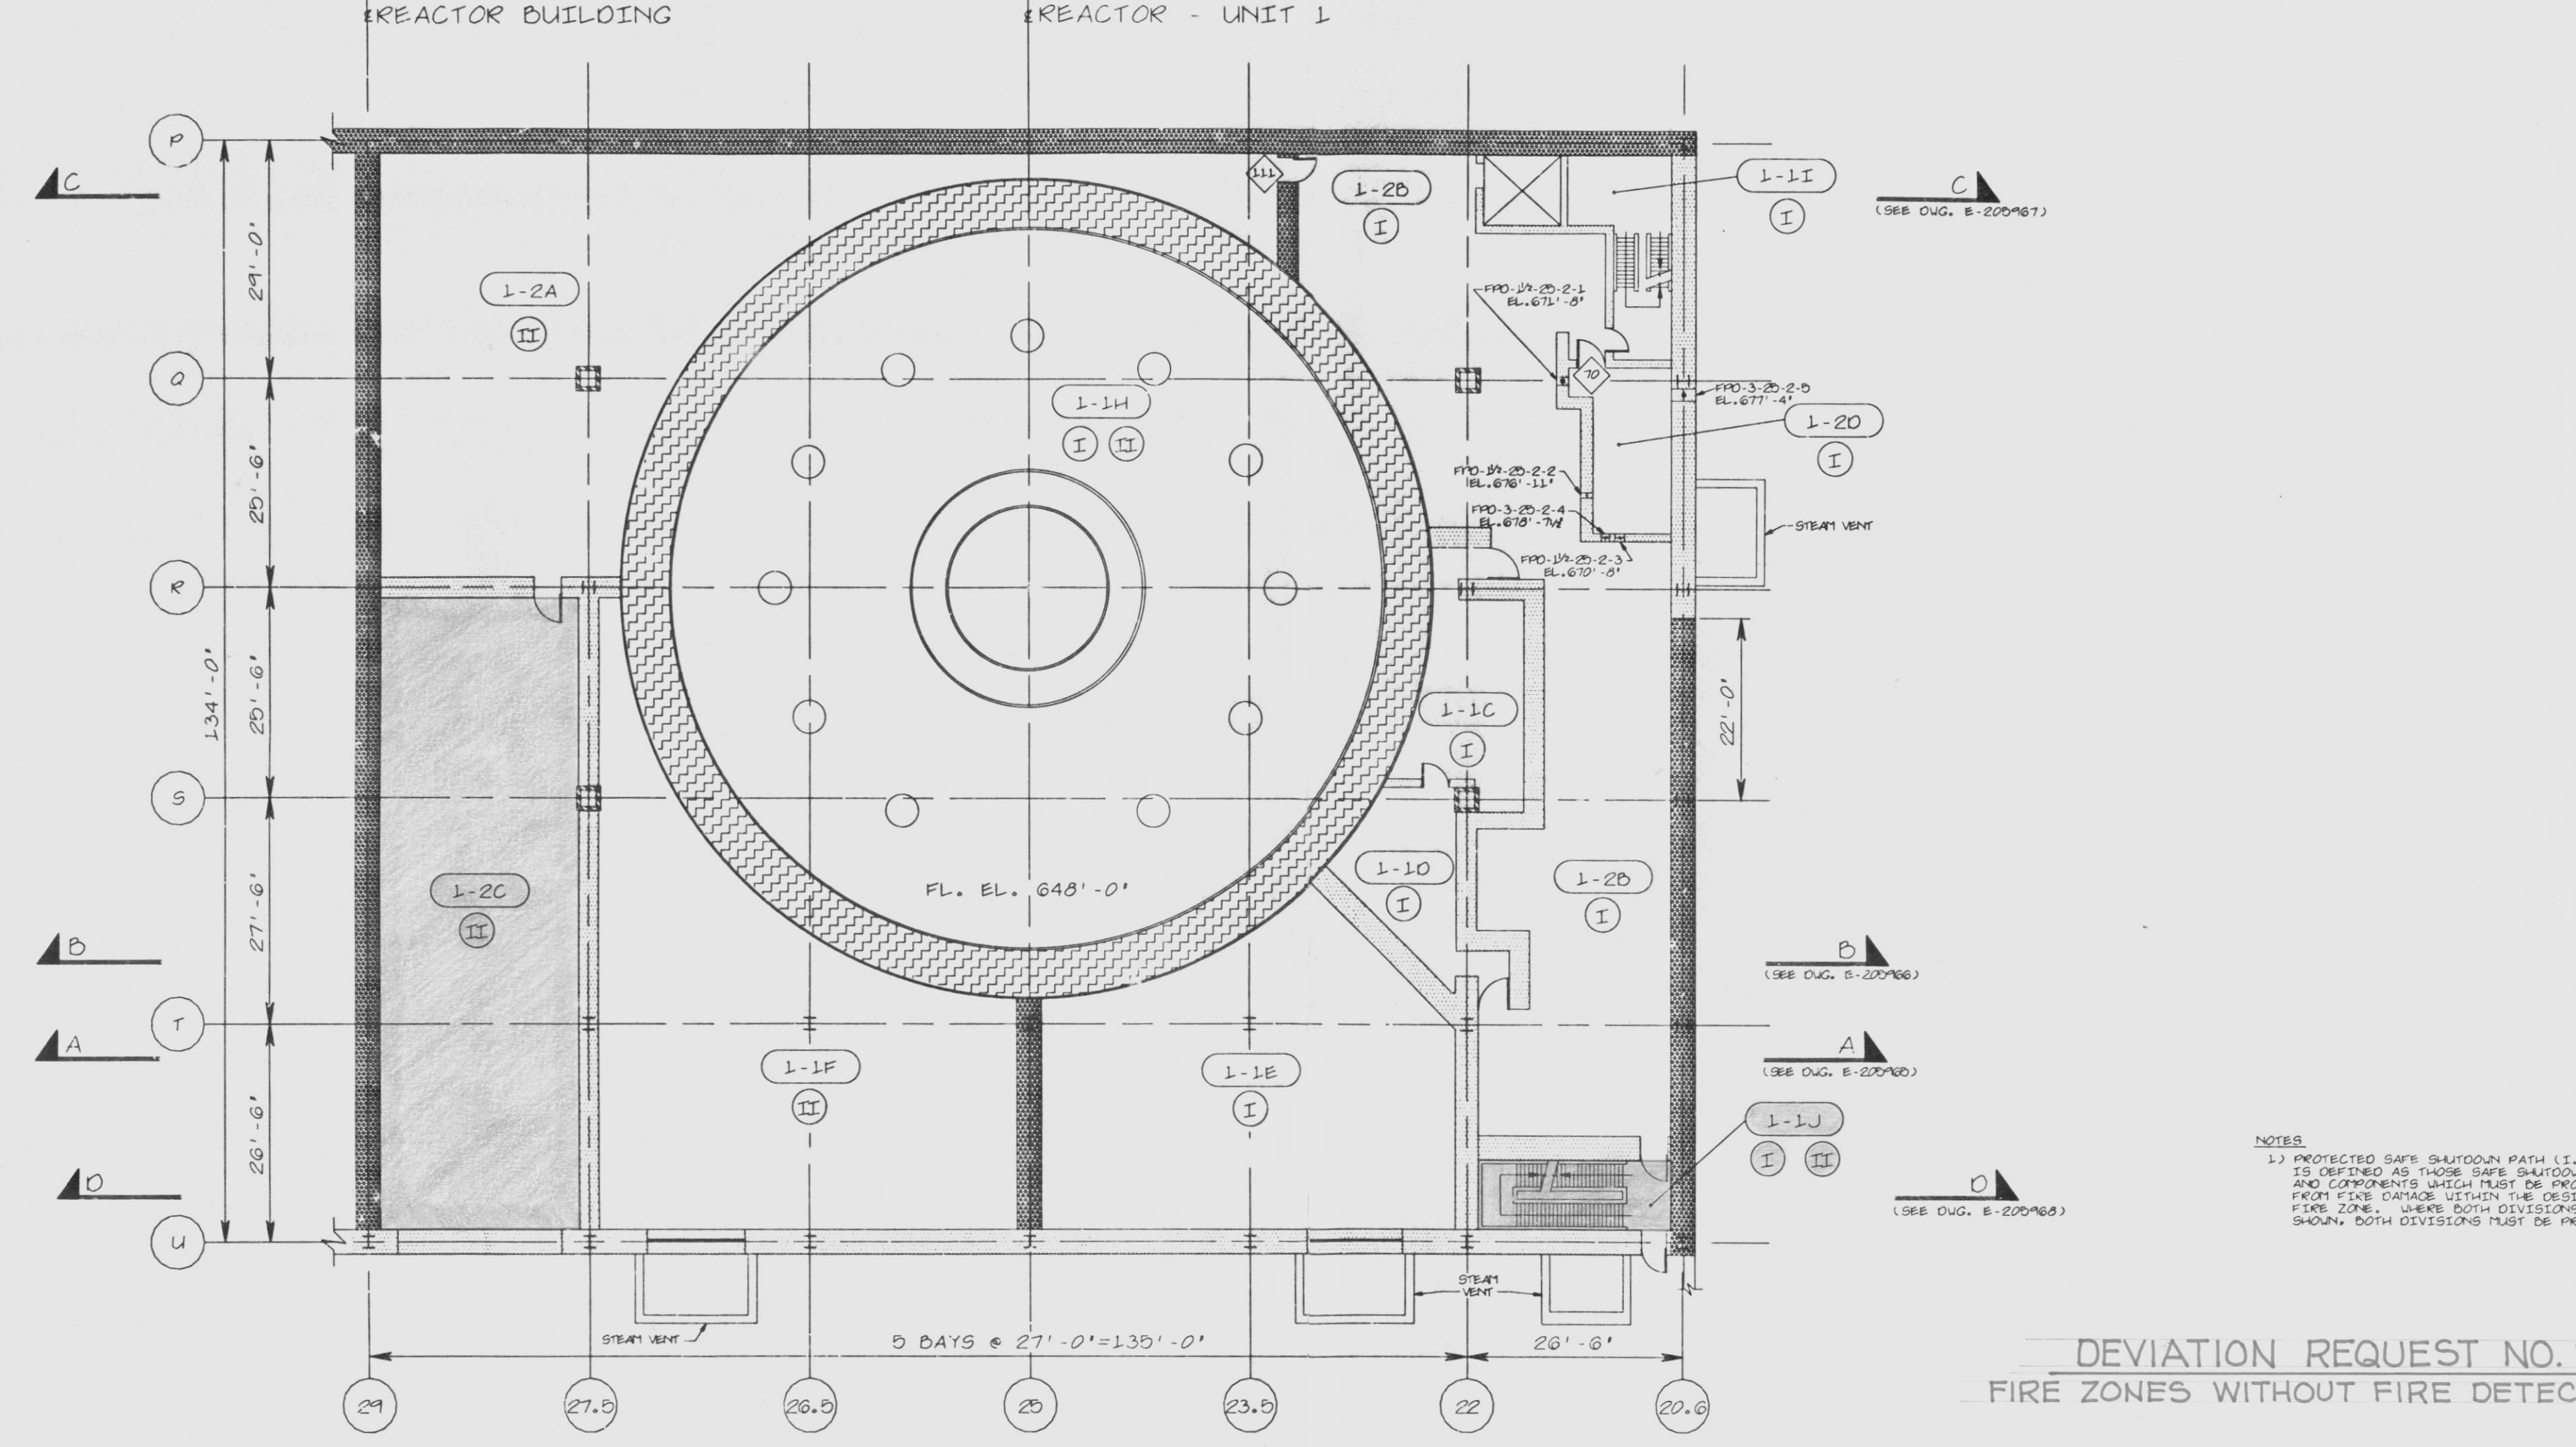

FLOOR PLAN @ EL. 670'-0"

NOTES
1) PROTECTED SAFE SHUTDOWN PATH (I.E. DIVISION) IS DEFINED AS THOSE SAFE SHUTDOWN CABLES AND COMPONENTS WHICH MUST BE PROTECTED FROM FIRE DAMAGE WITHIN THE DESIGNATED FIRE ZONE. WHERE BOTH DIVISIONS ARE SHOWN, BOTH DIVISIONS MUST BE PROTECTED.

DEVIATION REQUEST NO. 14
FIRE ZONES WITHOUT FIRE DETECTION

A-12	E-184302, SHT. 2
C-1739	E-205968
C-1738	E-205967
C-1737	E-205966
C-1736	E-205965
RE DRAWING NO.	PPAL DRAWING NO.

LEGEND

- FIRE ZONES
- I DIVISION I PROTECTED SAFE SHUTDOWN PATH
- II DIVISION II PROTECTED SAFE SHUTDOWN PATH
- ▨ 3 HR. FIRE-RATED WALLS
- ◇ FIRE DOOR NUMBER
- ▨ FIRE ZONE BOUNDARY
- ▨ INERTED CONTAINMENT BOUNDARY
- ▭ FIRE DAMPER
- FPD (RATING)-12-2-1
- FIRE DAMPER
- FIRE RATING
- AREA NO.
- DRAWING NO.
- SEQUENCE NO.
- FIRE RATING
- 1/2 = 1/2 HR. RATING
- 3 = 3 HR. RATING
- 3P = 3 HR. RATING IN PNEUMATIC OPER. MODE.

1 PER ENGINEERING INFO.				BOB	W	7/7	6/17
0 INITIAL ISSUE				BOB	W	FXM	TAG
NON-QUALITY RELATED				OR	OR		APPROVED DATE
SUSQUEHANNA S.E.S. UNIT 1 REACTOR BUILDING FIRE ZONE PLAN OF ELEVATION 670'-0"							
AREA 25.27.28.29 ELEV. 670'-0" SCALE 1/4" = 1'-0"							
PENNSYLVANIA POWER & LIGHT COMPANY ALLENTOWN PA.							
DRAWING NO. E-205950	SHEET NO. 1	REV. NO. 1					
RE DRAWING NO. C-1721	SHEET NO. 1	REV. NO. 1					

30X I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE DOCUMENT SUBMITTED TO SHS CORRESPONDENCE AND DRAWING FILES
DATE: 8/26/04

8812200158
SI APERTURE CARD