



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

PENNSYLVANIA POWER & LIGHT COMPANY  
ALLEGHENY-ELECTRIC COOPERATIVE, INC.

DOCKET NO. 50-387

SUSQUEHANNA STEAM ELECTRIC STATION, UNIT 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 93  
License No. NPF-14

1. The Nuclear Regulatory Commission (the Commission or the NRC) having found that:
  - A. The application for the amendment filed by the Pennsylvania Power & Light Company, dated April 12, 1989 as revised June 22, 1989 complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the regulations of the Commission;
  - C. There is reasonable assurance: (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 2.C.(2) of the Facility Operating License No. NPF-14 is hereby amended to read as follows:

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 93 and the Environmental Protection Plan contained in Appendix B, are hereby incorporated in the license. PP&L shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Walter R. Butler, Director  
Project Directorate I-2  
Division of Reactor Projects I/II

Attachment:  
Changes to the Technical  
Specifications

Date of Issuance: November 20, 1989

ATTACHMENT TO LICENSE AMENDMENT NO.

FACILITY OPERATING LICENSE NO. NPF-14

DOCKET NO. 50-387

Replace the following pages of the Appendix A Technical Specifications with enclosed pages. The revised pages are identified by Amendment number and contain vertical lines indicating the area of change. The overleaf pages are provided to maintain document completeness.\*

REMOVE

xxi  
xxii

3/4 4-1  
3/4 4-1a

3/4 4-1b  
3/4 4-1c

3/4 4-1d  
3/4 4-1e

3/4 4-1f  
3/4 4-1g

-  
-

3/4 4-3  
3/4 4-4

B 3/4 4-1  
B 3/4 4-2

-  
-

INSERT

xxi  
xxii\*

3/4 4-1  
3/4 4-1a

3/4 4-1b  
3/4 4-1c

3/4 4-1d  
3/4 4-1e

3/4 4-1f  
3/4 4-1g

3/4 4-2\*  
-

3/4 4-3\*  
3/4 4-4

B 3/4 4-1  
B 3/4 4-1a

B 3/4 4-2\*  
-

# INDEX

## LIST OF FIGURES

<u>FIGURE</u>		<u>PAGE</u>
3.1.5-1	SODIUM PENTABORATE SOLUTION TEMPERATURE/ CONCENTRATION REQUIREMENTS .....	3/4 1-21
3.1.5-2	SODIUM PENTABORATE SOLUTION CONCENTRATION .....	3/4 1-22
	THIS PAGE INTENTIONALLY LEFT BLANK.....	3/4 2-2
3.2.1-1	MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR) VS. AVERAGE BUNDLE EXPOSURE, ANF 8x8 FUEL.....	3/4 2-4
3.2.1-2	MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR) VS. AVERAGE BUNDLE EXPOSURE, ANF 9x9 FUEL.....	3/4 2-4a
3.2.2-1	LINEAR HEAT GENERATION RATE FOR APRM SETPOINTS VERSUS AVERAGE PLANAR EXPOSURE, ANF FUEL.....	3/4 2-7
3.2.3-1	FLOW DEPENDENT MCPR OPERATING LIMIT.....	3/4 2-9
3.2.3-2	REDUCED POWER MCPR OPERATING LIMIT.....	3/4 2-9a
3.2.4-1	LINEAR HEAT GENERATION RATE (LHGR) LIMIT VERSUS AVERAGE PLANAR EXPOSURE ANF 8x8 FUEL.....	3/4 2-10b
3.2.4-2	LINEAR HEAT GENERATION RATE (LHGR) LIMIT VERSUS AVERAGE PLANAR EXPOSURE, ANF 9x9 FUEL.....	3/4 2-10c
3.4.1.1-1	THERMAL POWER RESTRICTIONS.....	3/4 4-1b
3.4.6.1-1	MINIMUM REACTOR VESSEL METAL TEMPERATURE VS. REACTOR VESSEL PRESSURE .....	3/4 4-18
B 3/4 3-1	REACTOR VESSEL WATER LEVEL .....	B 3/4 3-8
B 3/4.4.6-1	FAST NEUTRON FLUENCE (E>1MeV) AT 1/4 T AS A FUNCTION OF SERVICE LIFE .....	B 3/4 4-7
5.1.1-1	EXCLUSION AREA .....	5-2
5.1.2-1	LOW POPULATION ZONE .....	5-3
5.1.3-1a	MAP DEFINING UNRESTRICTED AREAS FOR RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS .....	5-4
5.1.3-1b	MAP DEFINING UNRESTRICTED AREAS FOR RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS .....	5-5
6.2.1-1	OFFSITE ORGANIZATION .....	6-3
6.2.2-1	UNIT ORGANIZATION .....	6-4

# INDEX

## LIST OF TABLES

<u>TABLE</u>	<u>PAGE</u>
1.1 SURVEILLANCE FREQUENCY NOTATION .....	1-9
1.2 OPERATIONAL CONDITIONS .....	1-10
2.2.1-1 REACTOR PROTECTION SYSTEM INSTRUMENTATION SETPOINTS .....	2-4
3.3.1-1 REACTOR PROTECTION SYSTEM INSTRUMENTATION .....	3/4 3-2
3.3.1-2 REACTOR PROTECTION SYSTEM RESPONSE TIMES .....	3/4 3-6
4.3.1.1-1 REACTOR PROTECTION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS .....	3/4 3-7
3.3.2-1 ISOLATION ACTUATION INSTRUMENTATION .....	3/4 3-11
3.3.2-2 ISOLATION ACTUATION INSTRUMENTATION SETPOINTS .....	3/4 3-17
3.3.2-3 ISOLATION SYSTEM INSTRUMENTATION RESPONSE TIME ....	3/4 3-21
4.3.2.1-1 ISOLATION ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS .....	3/4 3-23
3.3.3-1 EMERGENCY CORE COOLING SYSTEM ACTUATION INSTRUMENTATION .....	3/4 3-28
3.3.3-2 EMERGENCY CORE COOLING SYSTEM ACTUATION INSTRUMENTATION SETPOINTS .....	3/4 3-31
3.3.3-3 EMERGENCY CORE COOLING SYSTEM RESPONSE TIMES .....	3/4 3-33
4.3.3.1-1 EMERGENCY CORE COOLING SYSTEM ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS .....	3/4 3-34
3.3.4.1-1 ATWS RECIRCULATION PUMP TRIP SYSTEM INSTRUMENTATION .....	3/4 3-37
3.3.4.1-2 ATWS RECIRCULATION PUMP TRIP SYSTEM INSTRUMENTATION SETPOINTS .....	3/4 3-38

### 3/4.4 REACTOR COOLANT SYSTEM

#### 3/4.4.1 RECIRCULATION SYSTEM

##### RECIRCULATION LOOPS - TWO LOOP OPERATION

##### LIMITING CONDITION FOR OPERATION

---

3.4.1.1.1 Two reactor coolant system recirculation loops shall be in operation with the reactor at a THERMAL POWER/coreflow condition outside of Regions I and II of Figure 3.4.1.1.1-1.

APPLICABILITY: OPERATIONAL CONDITIONS 1\* and 2\*†, except during single loop operation.#

##### ACTION:

a. In OPERATIONAL CONDITION 1:

1. With:

- a) No reactor coolant system recirculation loops in operation, or
- b) Region I of Figure 3.4.1.1.1-1 entered, or
- c) Region II of Figure 3.4.1.1.1-1 entered and core thermal hydraulic instability occurring as evidenced by:
  - 1) Two or more APRM readings oscillating with at least one oscillating greater than or equal to 10% of RATED THERMAL POWER peak-to-peak, or
  - 2) Two or more LPRM upscale alarms activating and deactivating with a 1 to 5 second period, or
  - 3) Observation of a sustained LPRM oscillation of greater than 10 w/cm<sup>2</sup> peak-to-peak with a 1 to 5 second period, or
- d) Region II of Figure 3.4.1.1.1-1 entered and less than 50% of the required LPRM upscale alarms OPERABLE,  
immediately place the reactor mode switch in the shutdown position.

2. If Region II of Figure 3.4.1.1.1-1 is entered and greater than or equal to 50% of the required LPRM upscale alarms OPERABLE, immediately exit the region by:

- a) inserting a predetermined set of high worth control rods, or
- b) increasing core flow.

---

\*See Special Test Exception 3.10.4.

#See Specification 3.4.1.1.2 for single loop operation requirements.

†The LPRM upscale alarms are not required to be OPERABLE to meet this specification in OPERATIONAL CONDITION 2.

## REACTOR COOLANT SYSTEM

### SURVEILLANCE REQUIREMENTS

---


#### ACTION: (Continued)

3. With less than 50% of the required LPRM upscale alarms OPERABLE, follow ACTION a.1.d. upon entry into Region II of Figure 3.4.1.1.1-1.
  - b. In OPERATIONAL CONDITION 2 with no reactor coolant system recirculation loops in operation, return at least one reactor coolant system recirculation loop to operation, or be in HOT SHUTDOWN within the next 6 hours.
  - c. With any pump discharge valve not OPERABLE remove the associated loop from operation, close the valve and comply with the requirements of Specification 3.4.1.1.2.
  - d. With any pump discharge bypass valve not OPERABLE close the valve and verify closed at least once per 31 days.
- 4.4.1.1.1.1 Each pump discharge valve and bypass valve shall be demonstrated OPERABLE by cycling each valve through at least one complete cycle of full travel during each startup\*\* prior to THERMAL POWER exceeding 25% of RATED THERMAL POWER.
- 4.4.1.1.1.2 Each pump MG set scoop tube electrical and mechanical stop shall be demonstrated OPERABLE with overspeed setpoints less than or equal to 102.5 and 105%, respectively, of rated core flow, at least once per 18 months.
- 4.4.1.1.1.3 At least 50% of the required LPRM upscale alarms shall be determined OPERABLE by performance of the following on each LPRM upscale alarm:
- 1) CHANNEL FUNCTIONAL TEST at least once per 92 days and
  - 2) CHANNEL CALIBRATION at least once per 184 days.

---

\*\*If not performed within the previous 31 days.

**Figure 3.4.1.1-1  
THERMAL POWER RESTRICTIONS**

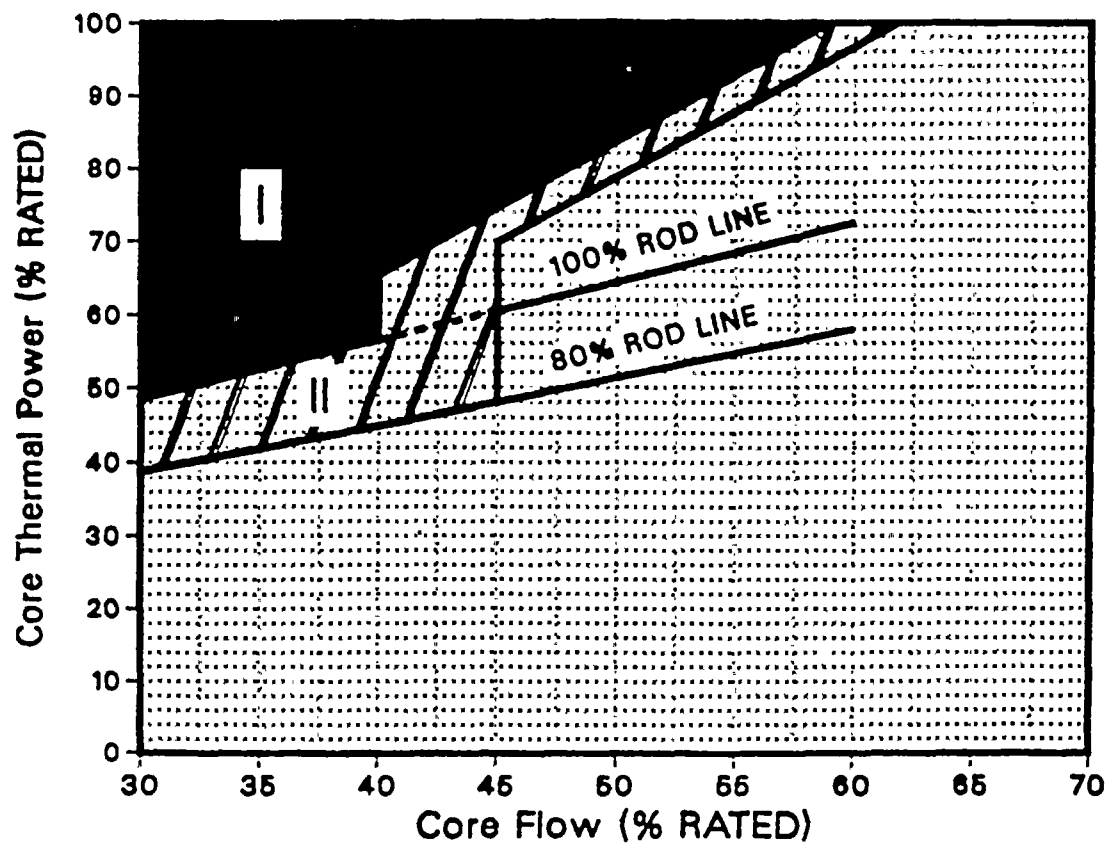

**FIGURE 3.4.1.1-1  
THERMAL POWER RESTRICTIONS**



## REACTOR COOLANT SYSTEM

### RECIRCULATION LOOPS - SINGLE LOOP OPERATION

#### LIMITING CONDITION FOR OPERATION

3.4.1.1.2 One reactor coolant recirculation loop shall be in operation with the pump speed  $\leq 80\%$  of the rated pump speed and the reactor at a THERMAL POWER/core flow condition outside of Regions I and II of Figure 3.4.1.1.1-1, and

a. the following revised specification limits shall be followed:

1. Specification 2.1.2: the MCPR Safety Limit shall be increased to 1.07.
2. Table 2.2.1-1: the APRM Flow-Biased Scram Trip Setpoints shall be as follows:

<u>Trip Setpoint</u>	<u>Allowable Value</u>
$\leq 0.58W + 54\%$	$\leq 0.58W + 57\%$

3. Specification 3.2.1: The MAPLHGR limits shall be as specified in Figures 3.2.1-2 and 3.2.1-3.
4. Specification 3.2.2: the APRM Setpoints shall be as follows:

<u>Trip Setpoint</u>	<u>Allowable Value</u>
$S \leq (0.58W + 54\%)T$	$S \leq (0.58W + 57\%)T$
$S_{RB} \leq (0.58W + 45\%)T$	$S_{RB} \leq (0.58W + 48\%)T$

5. Specification 3.2.3: The MINIMUM CRITICAL POWER RATIO (MCPR) shall be greater than or equal to the largest of the following values:

- a. 1.42,
- b. the MCPR determined from Figure 3.2.3-1 plus 0.01, and
- c. the MCPR determined from Figure 3.2.3-2 plus 0.01.

6. Table 3.3.6-2: the RBM/APRM Control Rod Block Setpoints shall be as follows:

a. RBM - Upscale	<u>Trip Setpoint</u> $\leq 0.66W + 36\%$	<u>Allowable Value</u> $\leq 0.66W + 39\%$
b. APRM-Flow Biased	<u>Trip Setpoint</u> $\leq 0.58 + 45\%$	<u>Allowable Value</u> $\leq 0.58W + 48\%$

APPLICABILITY: OPERATIONAL CONDITIONS 1\* and 2\*+, except during two loop operation.#

## REACTOR COOLANT SYSTEM

### LIMITING CONDITION FOR OPERATION (Continued)

---

#### ACTION:

- a. In OPERATIONAL CONDITION 1:
  1. With:
    - a) No reactor coolant system recirculation loops in operation, or
    - b) Region I of Figure 3.4.1.1.1-1 entered, or
    - c) Region II of Figure 3.4.1.1.1-1 entered and core thermal hydraulic instability occurring as evidenced by:
      - 1) Two or more APRM readings oscillating with at least once oscillating greater than or equal to 10% of RATED THERMAL POWER peak-to-peak, or
      - 2) Two or more LPRM upscale alarms activating and deactivating with a 1 to 5 second period, or
      - 3) Observation of a sustained LPRM oscillation of greater than 10 w/cm<sup>2</sup> peak-to-peak with a 1 to 5 second period, or
    - d) Region II of Figure 3.4.1.1.1-1 entered and less than 50% of the required LPRM upscale alarms OPERABLE,  
  
immediately place the reactor mode switch in the shutdown position.
  2. If Region II of Figure 3.4.1.1.1-1 is entered and greater than or equal to 50% of the required LPRM upscale alarms are OPERABLE, immediately exit the region by:
    - a) inserting a predetermined set of high worth control rods, or
    - b) increasing core flow by increasing the speed of the operating recirculation pump.
  3. With less than 50% of the required LPRM upscale alarms OPERABLE, follow ACTION a.1.d upon entry into Region II of Figure 3.4.1.1.1-1.
- b. In OPERABLE CONDITION 2 with no reactor coolant system recirculation loops in operation, return at least one reactor coolant system recirculation loop to operation, or be in HOT SHUTDOWN within the next 6 hours.

## REACTOR COOLANT SYSTEM

### SURVEILLANCE REQUIREMENTS (Continued)

- c. With any of the limits specified in 3/4.1.1.2a not satisfied:
  - 1. Upon entering single loop operation, comply with the new limits within 6 hours or be in at least HOT SHUTDOWN within the following 6 hours.
  - 2. If the provisions of ACTION c.1 do not apply, take the ACTION(s) required by the referenced Specification(s):
- d. With one or more jet pumps inoperable, be in at least HOT SHUTDOWN within 12 hours.
- e. With any pump discharge valve not OPERABLE remove the associated loop from operation, close the valve and verify closed at least once per 31 days.
- f. With any pump discharge bypass valve not OPERABLE close the valve and verify closed at least once per 31 days.

### SURVEILLANCE REQUIREMENTS

- 4.4.1.1.2.1 Upon entering single loop operation and at least once per 24 hours thereafter, verify that the pump speed in the operating loop is  $\leq 80\%$  of the rated pump speed.
- 4.4.1.1.2.2 At least 50% of the required LPRM upscale alarms shall be determined OPERABLE by performance of the following on each LPRM upscale alarm:
  - 1) CHANNEL FUNCTIONAL TEST at least once per 92 days, and
  - 2) CHANNEL CALIBRATION at least once per 184 days.
- 4.4.1.1.2.3 Within 15 minutes prior to either THERMAL POWER increase resulting from a control rod withdrawal or recirculation loop flow increase, verify that the following differential temperature requirements are met if THERMAL POWER is  $< 30\%^{****}$  of RATED THERMAL POWER or the recirculation loop flow in the operating recirculation loop is  $\leq 50\%^{****}$  of rated loop flow:
  - a.  $< 145^{\circ}\text{F}$  between reactor vessel steam space coolant and bottom head drain line coolant,
  - b.  $\leq 50^{\circ}\text{F}$  between the reactor coolant within the loop not in operation and the coolant in the reactor pressure vessel, and
  - c.  $\leq 50^{\circ}\text{F}$  between the reactor coolant within the loop not in operation and operating loop.

## REACTOR COOLANT SYSTEM

### SURVEILLANCE REQUIREMENTS (Continued)

- 4.4.1.1.2.4 The pump discharge valve and bypass valve in both loops shall be demonstrated OPERABLE by cycling each valve through at least one complete cycle of full travel during each startup\*\* prior to THERMAL POWER exceeding 25% of RATED THERMAL POWER.
- 4.4.1.1.2.5 The pump MG set scoop tube electrical and mechanical stop shall be demonstrated OPERABLE with overspeed setpoints less than or equal to 102.5% and 105%, respectively, of rated core flow, at least once per 18 months.
- 4.4.1.1.2.6 During single recirculation loop operation, all jet pumps, including those in the inoperable loop, shall be demonstrated OPERABLE at least once per 24 hours by verifying that no two of the following conditions occur:###
- a. The indicated recirculation loop flow in the operating loop differs by more than 10% from the established single recirculation pump speed-loop flow characteristics.
  - b. The indicated total core flow differs by more than 10% from the established total core flow value from single recirculation loop flow measurements.
  - c. The indicated diffuser-to-lower plenum differential pressure of any individual jet pump differs from established single recirculation loop patterns by more than 10%.
- 4.4.1.1.2.7 The SURVEILLANCE REQUIREMENTS associated with the specifications referenced in 3.4.1.1.2a shall be followed.
- \* See Special Test Exception 3.10.4.
- \*\* If not performed within the previous 31 days.
- \*\*\*\* Initial value. Final value to be determined based on startup testing. Any required change to this value shall be submitted to the Commission within 90 days of test completion.
- # See Specification 3.4.1.1.1 for two loop operation requirements.
- ## This requirement does not apply when the loop not in operation is isolated from the reactor pressure vessel.
- ### During startup testing following each refueling outage, data shall be recorded for the parameters listed to provide a basis for

## REACTOR COOLANT SYSTEM

### SURVEILLANCE REQUIREMENTS (Continued)

---

establishing the specified relationships. Comparisons of the actual data in accordance with the criteria listed shall commence upon the performance of subsequent required surveillances.

- + The LPRM upscale alarms are not required to be OPERABLE to meet this specification in OPERATIONAL CONDITION 2.

## REACTOR COOLANT SYSTEM

### JET PUMPS

#### LIMITING CONDITION FOR OPERATION

---

3.4.1.2 All jet pumps shall be OPERABLE.

APPLICABILITY: OPERATIONAL CONDITIONS 1 and 2, when both recirculation loops are in operation.

#### ACTION:

With one or more jet pumps inoperable, be in at least HOT SHUTDOWN within 12 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.4.1.2\*\* Each of the above required jet pumps shall be demonstrated OPERABLE prior to THERMAL POWER exceeding 25% of RATED THERMAL POWER and at least once per 24 hours by determining recirculation loop flow, total core flow and diffuser-to-lower plenum differential pressure for each jet pump and verifying that no two of the following conditions occur when the recirculation pumps are operating at the same speed:

- a. The indicated recirculation loop flow differs by more than 10% from the established pump speed-loop flow characteristics.
- b. The indicated total core flow differs by more than 10% from the established total core flow value derived from recirculation loop flow measurements.
- c. The indicated diffuser-to-lower plenum differential pressure of any individual jet pump differs from established patterns by more than 10%.

\*\*See Specification 4.4.1.1.2.9 for single loop operation requirements.

## REACTOR COOLANT SYSTEM

### RECIRCULATION PUMPS

#### LIMITING CONDITION FOR OPERATION

---

3.4.1.3 Recirculation pump speed mismatch shall be maintained within:

- a. 5% of each other with core flow greater than or equal to 75% of rated core flow.
- b. 10% of each other with core flow less than 75% of rated core flow.

APPLICABILITY: OPERATIONAL CONDITIONS 1\* and 2\*, when both recirculation loops are in operation.

#### ACTION:

With the recirculation pump speeds different by more than the specified limits, either:

- a. Restore the recirculation pump speeds to within the specified limit within 2 hours, or
- b. Declare the recirculation loop of the pump with the slower speed not in operation and take the ACTION required by Specification 3.4.1.1.1.

#### SURVEILLANCE REQUIREMENTS

---

4.4.1.3 Recirculation pump speed mismatch shall be verified to be within the limits at least once per 24 hours.

\*See Special Test Exception 3.10.4.

## REACTOR COOLANT SYSTEM

### IDLE RECIRCULATION LOOP STARTUP

#### LIMITING CONDITION FOR OPERATION

---

3.4.1.4 An idle recirculation loop shall not be started unless the temperature differential between the reactor pressure vessel steam space coolant and the bottom head drain line coolant is less than or equal to 145°F, and:

- a. When both loops have been idle, unless the temperature differential between the reactor coolant within the idle loop to be started up and the coolant in the reactor pressure vessel is less than or equal to 50°F, or
- b. When only one loop has been idle, unless the temperature differential between the reactor coolant within the idle and operating recirculation loops is less than or equal to 50°F, and the operating loop flow rate is less than or equal to 50% of rated loop flow, and the reactor is operating at a THERMAL POWER/core flow condition below the 80% Rod Line shown in Figure 3.4.1.1.i-1.

APPLICABILITY: OPERATIONAL CONDITIONS 1, 2, 3 and 4.

#### ACTION:

With temperature differences and/or flow rates exceeding the above limits, suspend startup of any idle recirculation loop.

#### SURVEILLANCE REQUIREMENTS

---

4.4.1.4 The temperature differentials and flow rate shall be determined to be within the limits within 15 minutes prior to startup of an idle recirculation loop.



### 3/4.4 REACTOR COOLANT SYSTEM

#### BASES

#### 3/4.4.1 RECIRCULATION SYSTEM

Operation with one reactor recirculation loop inoperable has been evaluated and found acceptable, provided that the unit is operated in accordance with Specification 3.4.1.1.2.

For single loop operation, the MAPLHGR limits are multiplied by a factor of 1.0 for ANF fuel. This multiplication factor is derived from LOCA analyses initiated from single loop operation conditions. The resulting MAPLHGR limits for single loop operation assure the peak cladding temperature during a LOCA event remains below 2200°F.

The MINIMUM CRITICAL POWER RATIO (MCPR) limits for single loop operation assure that the Safety Limit MCPR is not exceeded for any Anticipated Operational Occurrence (AOO) and for the Recirculation Pump Seizure Accident.

For single loop operation, the RBM and APRM setpoints are adjusted by a 8.5% decrease in recirculation drive flow to account for the active loop drive flow that bypasses the core and goes up through the inactive loop jet pumps.

Surveillance on the pump speed of the operating recirculation loop is imposed to exclude the possibility of excessive reactor vessel internals vibration. Surveillance on differential temperatures below the threshold limits on THERMAL POWER or recirculation loop flow mitigates undue thermal stress on vessel nozzles, recirculation pumps and the vessel bottom head during extended operation in the single loop mode. The threshold limits are those values which will sweep up the cold water from the vessel bottom head.

Specifications have been provided to prevent, detect, and mitigate core thermal hydraulic instability events. These specifications are prescribed in accordance with NRC Bulletin 88-07, Supplement 1, "Power Oscillations in Boiling Water Reactors (BWRs)," dated December 30, 1988. The boundaries of the regions in Figure 3.4.1.1.1.1-1 are determined using ANF decay ratio calculations and supported by Susquehanna SES stability testing.

LPRM upscale alarms are required to detect reactor core thermal hydraulic instability events. The criteria for determining which LPRM upscale alarms are required is based on assignment of these alarms to designated core zones. These core zones consist of the level A, B and C alarms in 4 or 5 adjacent LPRM strings. The number and location of LPRM strings in each zone assure that with 50% or more of the associated LPRM upscale alarms OPERABLE sufficient monitoring capability is available to detect core wide and regional oscillations. Operating plant instability data is used to determine the specific LPRM strings assigned to each zone. The core zones and required LPRM upscale alarms in each zone are specified in appropriate procedures.

An inoperable jet pump is not, in itself, a sufficient reason to declare a recirculation loop inoperable, but it does, in case of a design-basis-accident, increase the blowdown area and reduce the capability of reflooding the core; thus, the requirement for shutdown of the facility with a jet pump inoperable. Jet pump failure can be detected by monitoring jet pump performance on a prescribed schedule for significant degradation.

### 3/4.4 REACTOR COOLANT SYSTEM

#### BASES

---

#### 3/4.4.1 RECIRCULATION SYSTEM (Continued)

Recirculation pump speed mismatch limits are in compliance with the ECCS LOCA analysis design criteria for two loop operation. The limits will ensure an adequate core flow coastdown from either recirculation loop following a LOCA. In the case where the mismatch limits cannot be maintained during the loop operation, continued operation is permitted in the single loop mode.

In order to prevent undue stress on the vessel nozzles and bottom head region, the recirculation loop temperatures shall be within 50°F of each other prior to startup of an idle loop. The loop temperature must also be within 50°F of the reactor pressure vessel coolant temperature to prevent thermal shock to the recirculation pump and recirculation nozzles. Since the coolant in the bottom of the vessel is at a lower temperature than the coolant in the upper regions of the core, undue stress on the vessel would result if the temperature difference was greater than 145°F.

#### 3/4.4 REACTOR COOLANT SYSTEM

##### BASES (Continued)

#### 3/4.4.2 SAFETY/RELIEF VALVES

The safety valve function of the safety/relief valves operate to prevent the reactor coolant system from being pressurized above the Safety Limit of 1325 psig in accordance with the ASME Code. A total of 10 OPERABLE safety-relief valves is required to limit reactor pressure to within ASME III allowable values for the worst case upset transient.

Demonstration of the safety/relief valve lift settings will occur only during shutdown and will be performed in accordance with the provisions of Specification 4.0.5.

#### 3/4.4.3 REACTOR COOLANT SYSTEM LEAKAGE

##### 3/4.4.3.1 LEAKAGE DETECTION SYSTEMS

The RCS leakage detection systems required by this specification are provided to monitor and detect leakage from the reactor coolant pressure boundary.

##### 3/4.4.3.2 OPERATIONAL LEAKAGE

The allowable leakage rates from the reactor coolant system have been based on the predicted and experimentally observed behavior of cracks in pipes. The normally expected background leakage due to equipment design and the detection capability of the instrumentation for determining system leakage was also considered. The evidence obtained from experiments suggests that for leakage somewhat greater than that specified for UNIDENTIFIED LEAKAGE the probability is small that the imperfection or crack associated with such leakage would grow rapidly. However, in all cases, if the leakage rates exceed the values specified or the leakage is located and known to be PRESSURE BOUNDARY LEAKAGE, the reactor will be shutdown to allow further investigation and corrective action.

The Surveillance Requirements for RCS pressure isolation valves provide added assurance of valve integrity thereby reducing the probability of gross valve failure and consequent intersystem LOCA.

#### 3/4.4.4 CHEMISTRY

The water chemistry limits of the reactor coolant system are established to prevent damage to the reactor materials in contact with the coolant. Chloride limits are specified to prevent stress corrosion cracking of the stainless steel. The effect of chloride is not as great when the oxygen concentration in the coolant is low, thus the 0.2 ppm limit on chlorides is permitted during POWER OPERATION. During shutdown and refueling operations, the temperature necessary for stress corrosion to occur is not present so a 0.5 ppm concentration of chlorides is not considered harmful during these periods.