

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9101090298      DOC. DATE: 91/01/04      NOTARIZED: NO      DOCKET #  
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv      05000387  
          50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv      05000388  
 AUTH. NAME      AUTHOR AFFILIATION  
 KEISER, H.W.      Pennsylvania Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
 BUTLER, W.R.      Project Directorate I-2

SUBJECT: Requests extension of relief from requirements of Specs  
           3.0.4 & 4.0.4 until NRC completes review of proposed Amends  
           139 & 93 to Licenses NPF-14 & NPF-22, respectively re  
           surveillance of reactor protection sys & control rod block.

DISTRIBUTION CODE: A001D      COPIES RECEIVED: LTR 1 ENCL 0      SIZE: 2  
 TITLE: OR Submittal: General Distribution

NOTES: LPDR 1 cy Transcripts.      05000387  
           LPDR 1 cy Transcripts.      05000388

	RECIPIENT ID CODE/NAME	COPIES	LTR	ENCL	RECIPIENT ID CODE/NAME	COPIES	LTR	ENCL
	PD1-2 LA	1	1		PD1-2 PD	1	1	
	THADANI, M	2		2				
INTERNAL:	ACRS	6	6		NRR/DET/ECMB 9H	1	1	
	NRR/DET/ESGB	1	1		NRR/DOEA/OTSB11	1	1	
	NRR/DST 8E2	1	1		NRR/DST/SELB 8D	1	1	
	NRR/DST/SICB 7E	1	1		NRR/DST/SRXB 8E	1	1	
	NUDOCS-ABSTRACT	1	1		OC/LFMB	1	0	
	OGC/HDS2	1	0		<del>REG FILE</del> 01	1	1	
	RES/DSIR/EIB	1	1					
EXTERNAL:	NRC PDR	1	1		NSIC	1	1	
NOTES:		2		2				


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 26 ENCL ~~24~~<sup>0</sup>

*A/A*

R  
I  
D  
S  
/  
A  
D  
D  
S

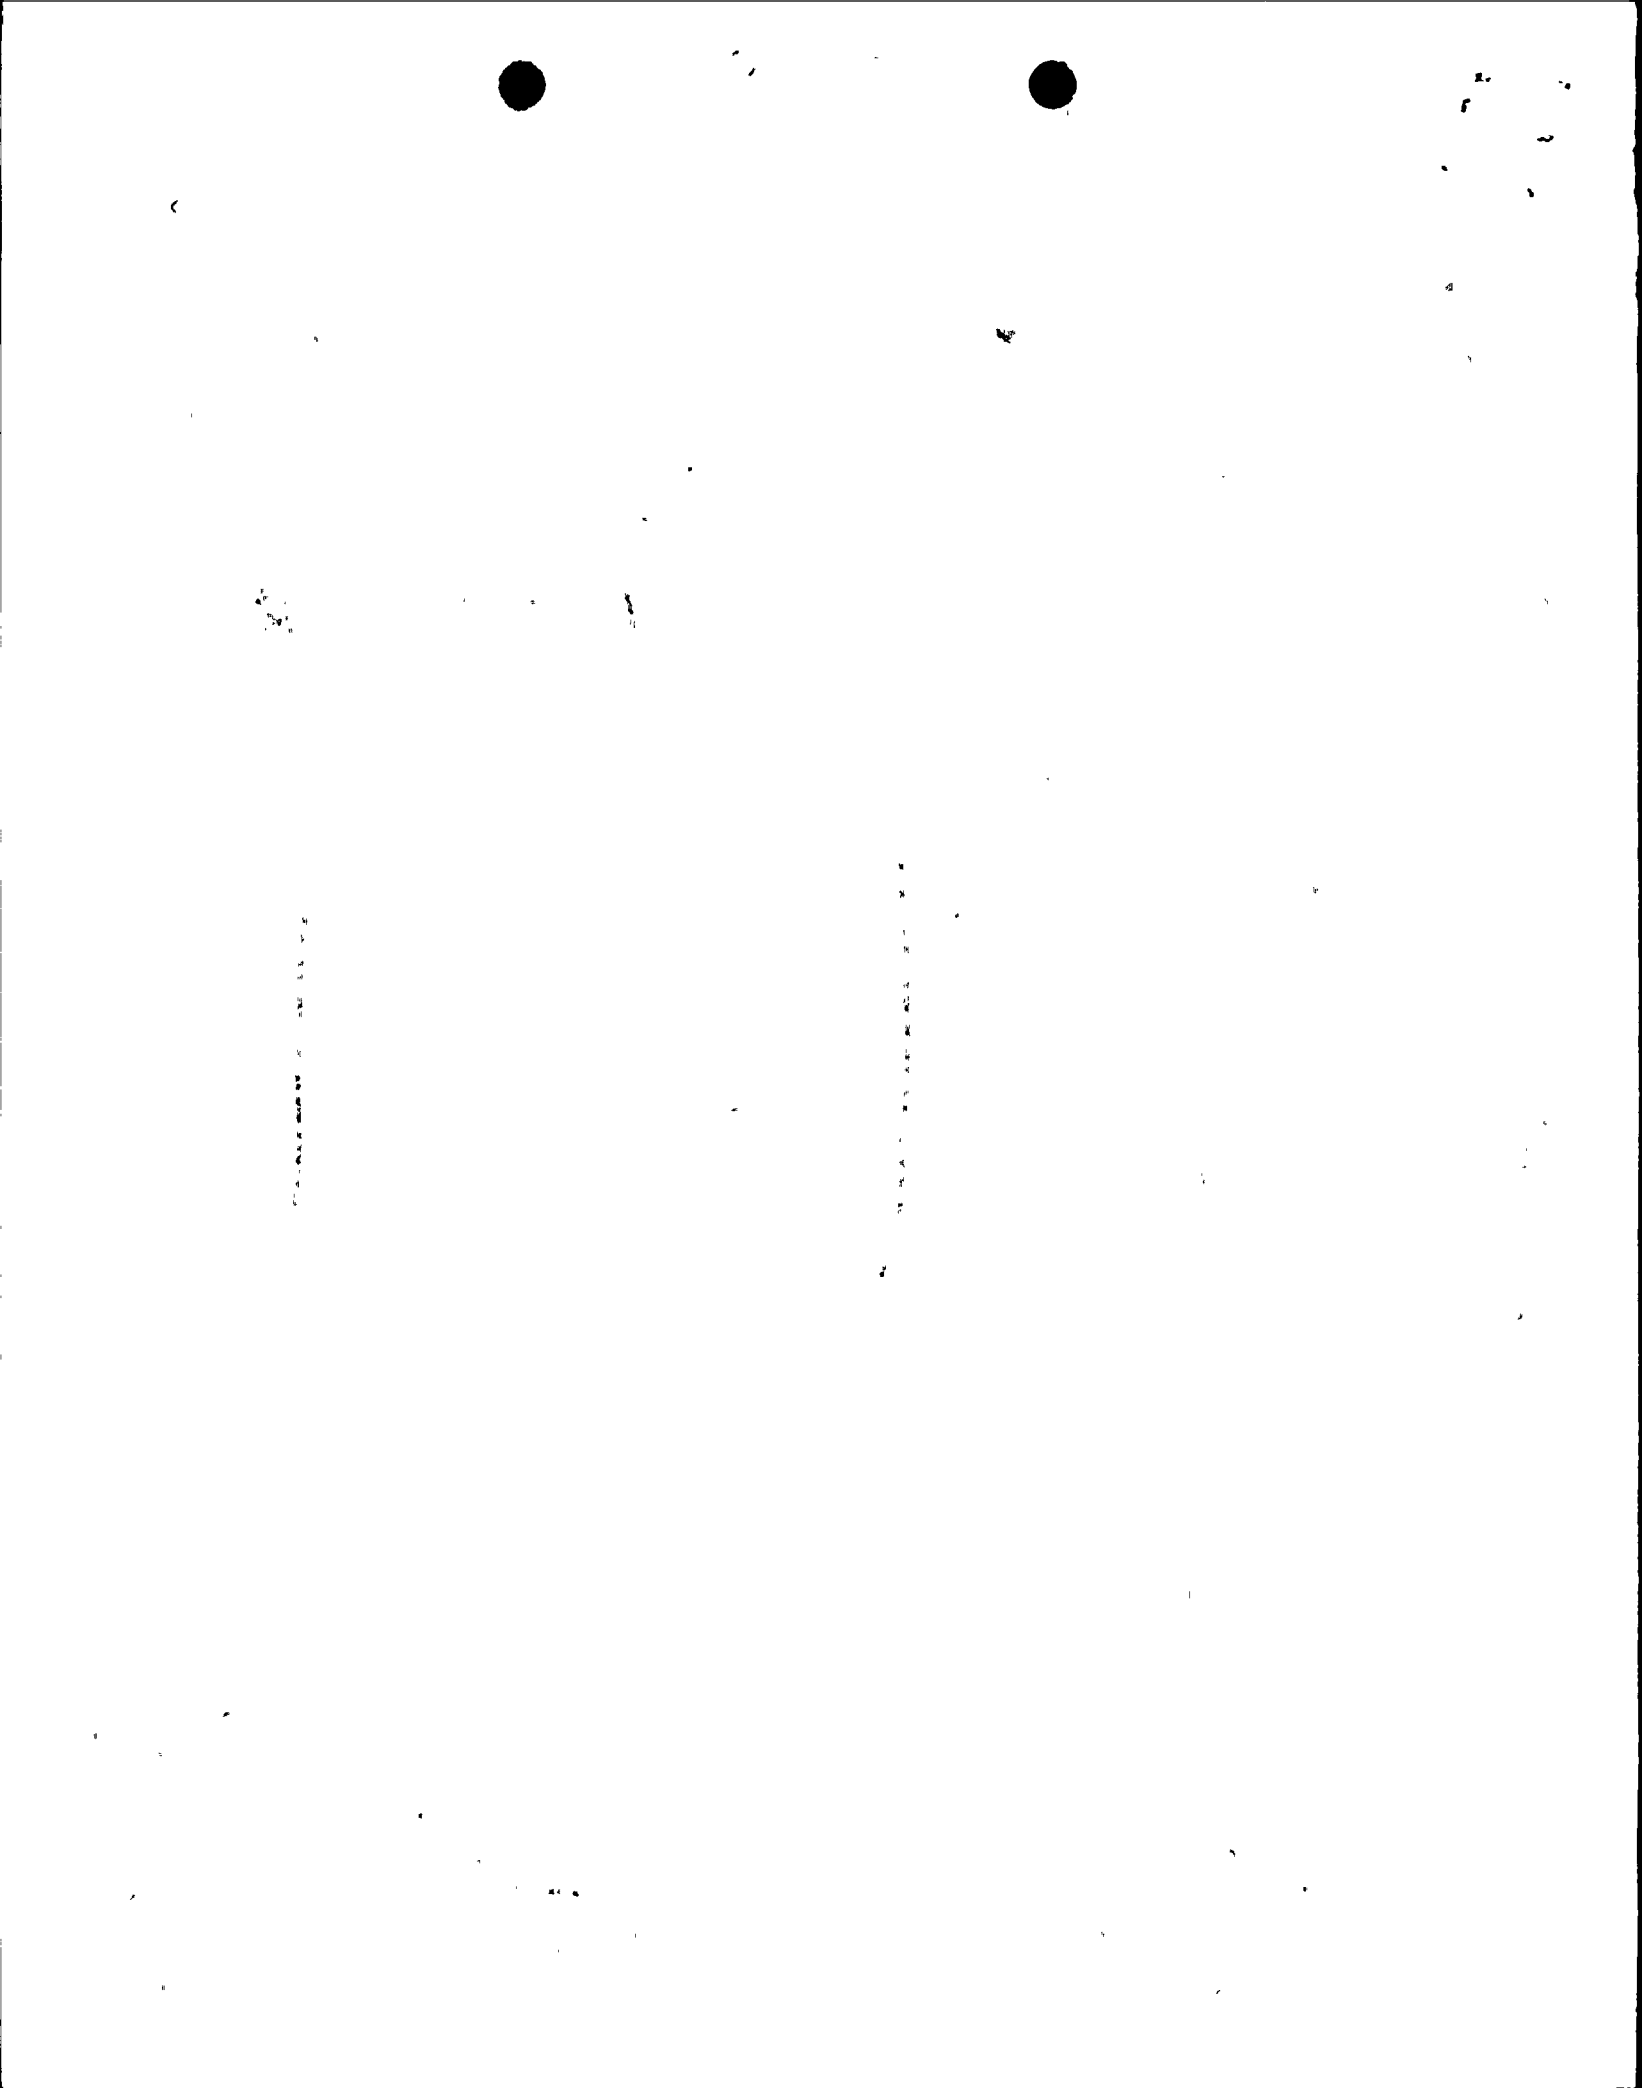



**Pennsylvania Power & Light Company**

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

Harold W. Keiser  
Senior Vice President-Nuclear  
215/774-4194

JAN 04 1991

Director of Nuclear Reactor Regulation  
Attention: Dr. W. R. Butler, Project Director  
Project Directorate I-2  
Division of Reactor Projects  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555

**SUSQUEHANNA STEAM ELECTRIC STATION  
EXTENSION OF RELIEF FROM REQUIREMENTS OF  
3.0.4 AND 4.0.4  
PLA-3500**

**FILES A17-2, R41-2**

Docket Nos. 50-387  
50-388

References:

1. PLA-3484, H. W. Keiser to W. R. Butler, "Request for Waiver - Specifications 3.0.4 and 4.0.4," dated November 29, 1990.
2. PLA-3486, H. W. Keiser to W. R. Butler, "Proposed Amendments 139 to License No. NPF-14 and 93 to License No. NPF-22: Exceptions to Specifications 3.0.4 and 4.0.4," dated November 30, 1990.
3. \_\_\_\_\_, W. R. Butler to H. W. Keiser, "Request for a Temporary Waiver of Compliance Related to Susquehanna Steam Electric Station, Units 1 and 2," dated November 30, 1990.

Dear Dr. Butler:

The purpose of this letter is to request an extension of the relief from the requirements of 3.0.4 and 4.0.4 as stated in Reference 3.

Susquehanna SES Unit 2 is scheduled to be shutdown on January 5, 1991 to perform repairs. This shutdown places the unit in a similar situation as discussed in Reference 1 for a previous shutdown. PP&L has requested a Technical Specification Change to correct the situation of surveillance for certain instruments related to the Reactor Protection System (RPS), Control Rod Block (CRB), and Source Range Monitor (SRM) could not be performed prior to entry into an Operational Condition for which the surveillance requirements are prerequisites. As stated in References 1 and 2 and agreed to by NRC in Reference 3, the problem has a low safety significance.

*Adol  
1/6*

9101090298 910104  
PDR ADOCK 05000387  
P PDR



00004



[Faint, illegible text consisting of several lines of characters, possibly a header or title area.]

[Small, faint mark or characters.]



PP&L requests that the relief from the requirements of 3.0.4 and 4.0.4 as stated in Reference 3 be extended until the NRC Staff completes its review of the proposed amendment to the Technical Specifications (Reference 2).

If you have any questions, please contact Mr. C. T. Coddington at (215) 774-7915.

Very truly yours,



H. W. Keiser

RDk:bir  
RDk\PLA3500

cc: ~~NRC Document Control Desk~~ (original)  
NRC Region I  
Mr. G. S. Barber, NRC Sr. Resident Inspector  
Mr. M. C. Thadani, NRC Project Manager  
Mr. T. M. Gerusky, PA DER