

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9107230134 DOC. DATE: 91/07/15 NOTARIZED: NO DOCKET #
FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
AUTH. NAME AUTHOR AFFILIATION
KEISER, H. Pennsylvania Power & Light Co.
RECIP. NAME RECIPIENT AFFILIATION
BUTLER, W. R. Project Directorate I-2

SUBJECT: Discusses plans to enhance erosion/corrosion program pursuant to Generic Ltr 89-08.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
TITLE: OR Submittal: General Distribution

NOTES: LPDR 1 cy Transcripts. 05000387 /
LPDR 1 cy Transcripts. 05000388 /


Table with 4 columns: RECIPIENT ID CODE/NAME, COPIES LTR ENCL, RECIPIENT ID CODE/NAME, COPIES LTR ENCL. Includes entries for THADANI, M., ACRS, NRR/DET/ESGB, NRR/DST 8E2, NRR/DST/SICB8H7, NUDOCS-ABSTRACT, OGC/HDS2, RES/DSIR/EIB, NRR/DET/ECMB 7D, NRR/DOEA/OTSB11, NRR/DST/SELB 7E, NRR/DST/SRXB 8E, OC/LFMB, REG FILE 01, NSIC, and NOTES.

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 26 ENCL 24

R
I
D
S
/
A
D
D
S

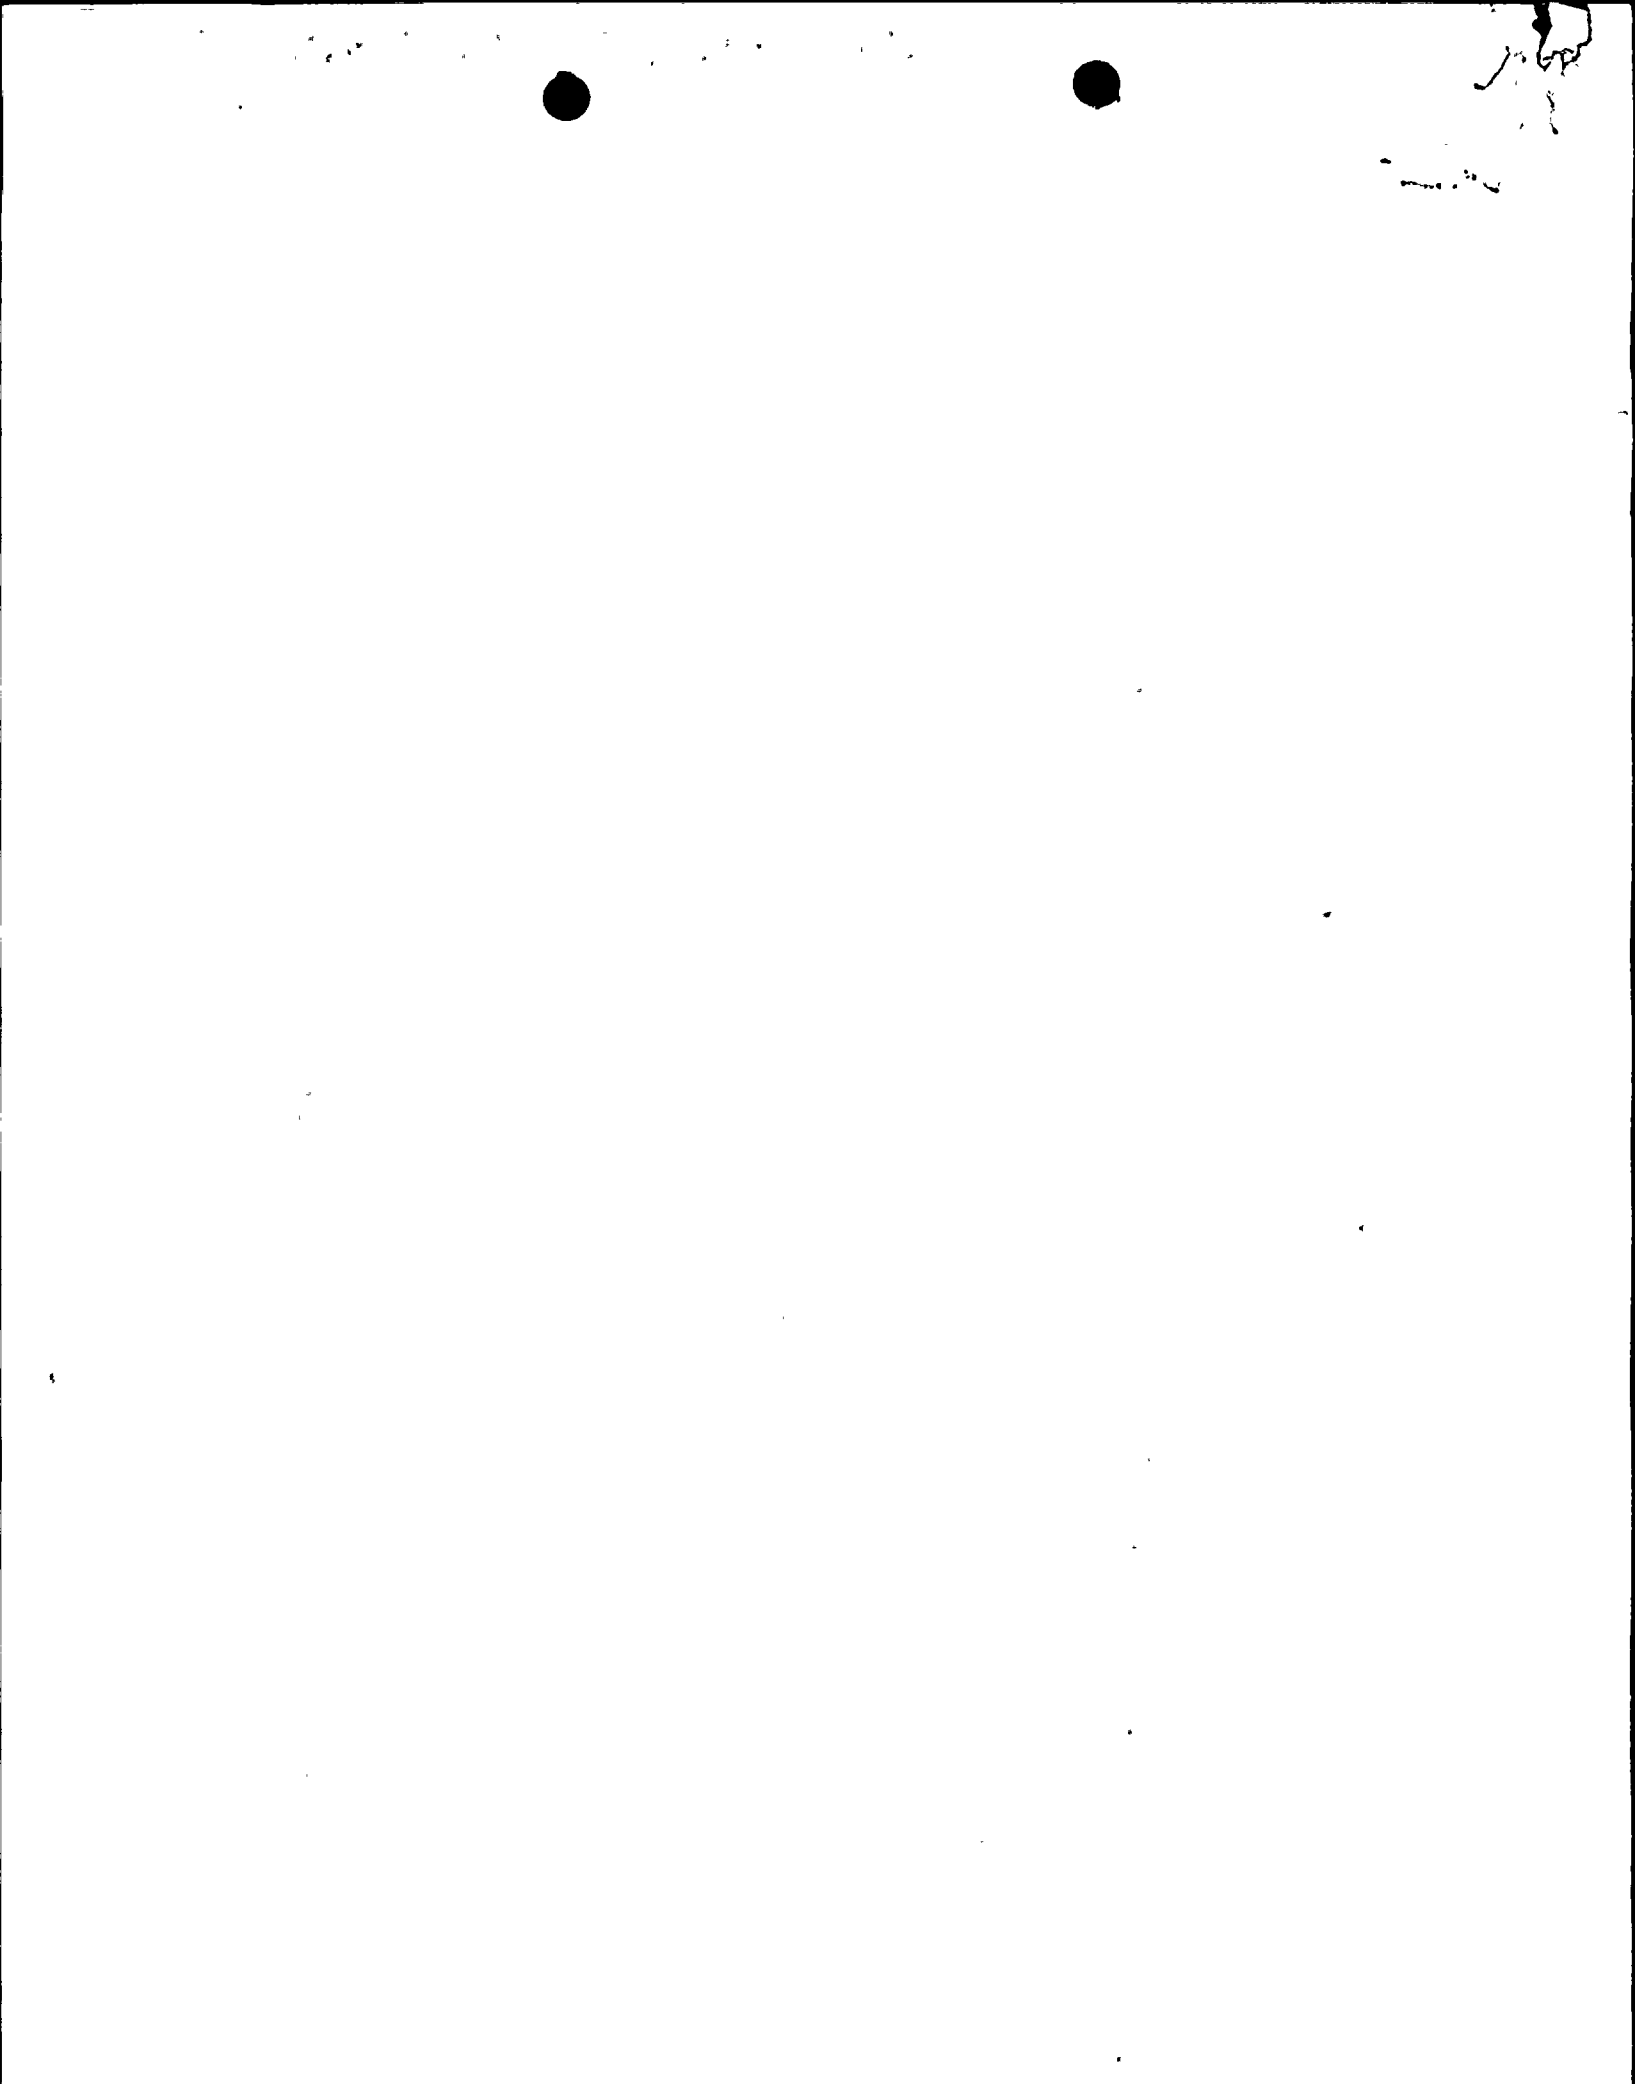



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

JUL 15 1991

Harold W. Keiser
Senior Vice President-Nuclear
215/774-4194

Director of Nuclear Reactor Regulation
Attention: Dr. W. R. Butler, Project Director
Project Directorate I-2
Division of Reactor Projects
U.S. Nuclear Regulatory Commission
Washington, DC 20555

SUSQUEHANNA STEAM ELECTRIC STATION
GENERIC LETTER 89-08
PLA-3597 FILE R41-2, SO47

Docket Nos. 50-387
and 50-388

Dear Dr. Butler:

In PLA-3232, dated July 27, 1989, PP&L described our plans to enhance our erosion/corrosion program pursuant to Generic Letter 89-08. We indicated these enhancements would be accomplished over a two year period. To date we have incorporated the erosion/corrosion program into the Inservice Inspection Program database and are using existing Nuclear Department Procedures to control the overall process. We have not yet completed our work to develop a formal trending program. The trending program enhancement is now anticipated to be completed in October, 1991.

Our existing program currently meets or exceeds the NUMARC program.

Should you have any questions please call Mr. W. W. Williams at (215) 774-7910.

Very truly yours,

H. W. Keiser

cc: NRC Document Control Desk (original)
NRC Region I
Mr. J. J. Raleigh - NRC Project Manager
Mr. G. S. Barber - NRC Sr. Resident Inspector

9107230134 910715
PDR ADOCK 05000387
PDR

*Adol
1/0*



100-1-1

100-1-1

100-1-1

100-1-1