

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9203110003 DOC. DATE: 92/03/04 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
 AUTH. NAME AUTHOR AFFILIATION
 KEISER, H.W. Pennsylvania Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 MILLER, C.L. Project Directorate I-2

SUBJECT: Advises that util proposes to withdraw 911104 Proposed Amends 149 & 103 to Licenses NPF-14 & NPF-22, respectively, based on 920128 & 228 discussions w/NRC. Amends changed TS re operational effectiveness review.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2
 TITLE: OR Submittal: General Distribution

NOTES: LPDR 1 cy Transcripts. 05000387
 LPDR 1 cy Transcripts. 05000388

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		L	T		ID CODE/NAME		L	T
	PD1-2 LA		1	1		PD1-2 PD		1	1
	RALEIGH, J.		2	2					
INTERNAL:	ACRS		6	6		NRR/DET/ECMB 7D		1	1
	NRR/DET/ESGB		1	1		NRR/DOEA/OTSB11		1	1
	NRR/DST 8E2		1	1		NRR/DST/SELB 7E		1	1
	NRR/DST/SICB8H7		1	1		NRR/DST/SRXB 8E		1	1
	NUDOCS-ABSTRACT		1	1		OC/LEMB		1	0
	OGC/HDS2		1	0		REG FILE 01		1	1
	RES/DSIR/EIB		1	1					
EXTERNAL:	NRC PDR		1	1		NSIC		1	1
NOTES:			2	2					


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 26 ENCL 24

AA2

R
I
D
S
/
A
D
D
S
R
I
D
S
/
A
D
D
S





Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

Harold W. Keiser
Senior Vice President-Nuclear
215/774-4194

MAR 04 1992

Director of Nuclear Reactor Regulation
Attention: Mr. C. L. Miller, Project Director
Project Directorate I-2
Division of Reactor Projects
U.S. Nuclear regulatory Commission
Washington, D.C. 20555

**SUSQUEHANNA STEAM ELECTRIC STATION
REVISION TO PROPOSED AMENDMENTS 149
AND 103 : TECH SPEC CHANGES TO SUPPORT OER
PLA-3742**

Docket Nos. 50-387
and 50-388

FILES A17-2/R41-2

Reference: PLA-3670, H.W. Keiser to C.L. Miller, "Proposed amendment No. 149 to License No. NPF-14 and Proposed Amendment No. 103 to License No. NPF-22 : Changes to the SSES Units 1 & 2 Technical Specifications Relating to Operational Effectiveness Review", dated November 4, 1992.


Dear Mr. Miller:

Section 6.2.2f of the referenced submittal outlines administrative controls related to operator overtime requirements. In the referenced submittal, PP&L proposed an editorial change to allow the Superintendent's "designee" rather than his "deputy" to authorize changes in the subject controls.

Based on discussions with Mr. Fred Allenspach of NRR on January 28 and February 28, 1992, PP&L hereby proposes to withdraw this portion of our proposed change. The rest of our request remains intact.

The above change is wholly administrative in nature, and therefore does not represent a change to our previous No Significant Hazards evaluation. Any questions should be directed to Mr. R. Sgarro at (215) 774-7914.

Very truly yours,

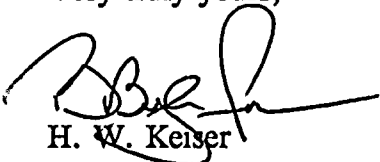
H. W. Keiser

Attachment

9203110003 920304
PDR ADCK 05000387
P PDR

1001 / 10

10-1-58

MEMORANDUM FOR THE RECORD

Re: [Illegible]

[Illegible]

cc: ~~NRC Document-Control-Desk (original)~~
NRC Region I
Mr. G. S. Barber, NRC Sr. Resident Inspector
Mr. J. J. Raleigh, NRC Project Manager
Mr. T. M. Gerusky, PA DER



1950
1951
1952
1953
1954
1955
1956
1957
1958
1959
1960