

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9207230011 DOC. DATE: 92/07/16 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
 AUTH. NAME AUTHOR AFFILIATION
 FIELDS, J.S. Pennsylvania Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 COUNCIL, E.E. Pennsylvania, Commonwealth of

SUBJECT: Advises that annual maint of diffuser pipe for facilities completed on 920619. Activity did not interfere w/free discharge of Susquehanna River.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: General Distribution

NOTES: LPDR 1 cy Transcripts. ; MAXWELL, G 05000387
 LPDR 1 cy Transcripts. ; MAXWELL, G 05000388


	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD1-2 LA		1	1		PD1-2 PD		1	1
	RALEIGH, J.		2	2					
INTERNAL:	ACRS		6	6		NRR/DET/ESGB		1	1
	NRR/DOEA/OTSB11		1	1		NRR/DST 8E2		1	1
	NRR/DST/SELB 7E		1	1		NRR/DST/SICB8H7		1	1
	NRR/DST/SRXB 8E		1	1		NUDOCS-ABSTRACT		1	1
	OC/LFMB		1	0		OGC/HDS2		1	0
	<u>REG FILE</u> 01		1	1		RES/DSIR/EIB		1	1
EXTERNAL:	NRC PDR		1	1		NSIC		1	1
NOTES:			2	2					

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 25 ENCL ~~23~~ ⁰

Er-1





Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

July 16, 1992

Mr. Eugene E. Council, Chief
Division of Waterways and Storm Water Management
Bureau of Dams and Waterway Management
Department of Environmental Resources
P.O. Box 2357
Harrisburg, PA 17120


SUSQUEHANNA STEAM ELECTRIC STATION
MAINTENANCE OF INTAKE STRUCTURE/DIFFUSER PIPE
PERMIT #E40-195, COMPLETION
CCN 741326 FILE R9-8C
PLE- 15800

Dear Mr. Council:

Annual maintenance of the diffuser pipe for the Susquehanna Steam Electric Station was completed on June 19, 1992. This notification is in accordance with Section 10 of permit #E40-195. This activity did not interfere with free discharge of the Susquehanna River.

If you have any questions, please call me at (215) 774-7889.

Sincerely,

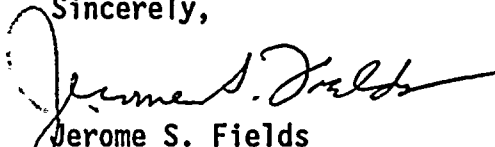

Jerome S. Fields
Sr. Environmental Scientist - Nuclear

jsf/ltg2830a(26)

cc: NRC Document Control Desk
 NRC Region I
 Mr. G. F. Maxwell, Acting NRC Project Manager
 Mr. D. W. Roeseke, COE

220010
9207230011 920716
PDR ADOCK 05000387
PDR

A001
1/0



Handwritten marks or scribbles in the top right corner.

Handwritten marks or scribbles in the bottom left corner.

Handwritten marks or scribbles in the bottom right corner.