

# ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9302100213      DOC. DATE: 93/02/04      NOTARIZED: NO      DOCKET #  
 FACIL: 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylvania      05000388  
 AUTH. NAME      AUTHOR AFFILIATION  
 KEISER, H.W.      Pennsylvania Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
 MILLER, C.L.      Project Directorate I-2

*See Rpt.*

SUBJECT: Forwards Susquehanna SES Unit 2 Summary Technical Final Rept  
 for Nov 1992.

DISTRIBUTION CODE: A017D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 1 + 120  
 TITLE: OR Submittal: Append J Containment Leak Rate Testing

NOTES:

	RECIPIENT		COPIES		
	ID CODE/NAME	LTR	ENCL	LTR	
	PD1-2 LA	1	0	PD1-2 PD	1    1
	CLARK, R	2	2		
INTERNAL:	ACRS	6	6	NRR/DST/SPLB 8D	1    1
	OC/LEMB	1	0	OGC/HDS2	1    1
	<u>REG FILE</u> 01	1	1	RES/DE/SEB	1    1
	RES/DSIR/SAIB	1	1		
EXTERNAL:	NRC PDR	1	1	NSIC	1    1


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR    18    ENCL    16

*MA2*

R  
I  
D  
S  
/  
A  
D  
D  
S  
/  
A  
D  
D  
S

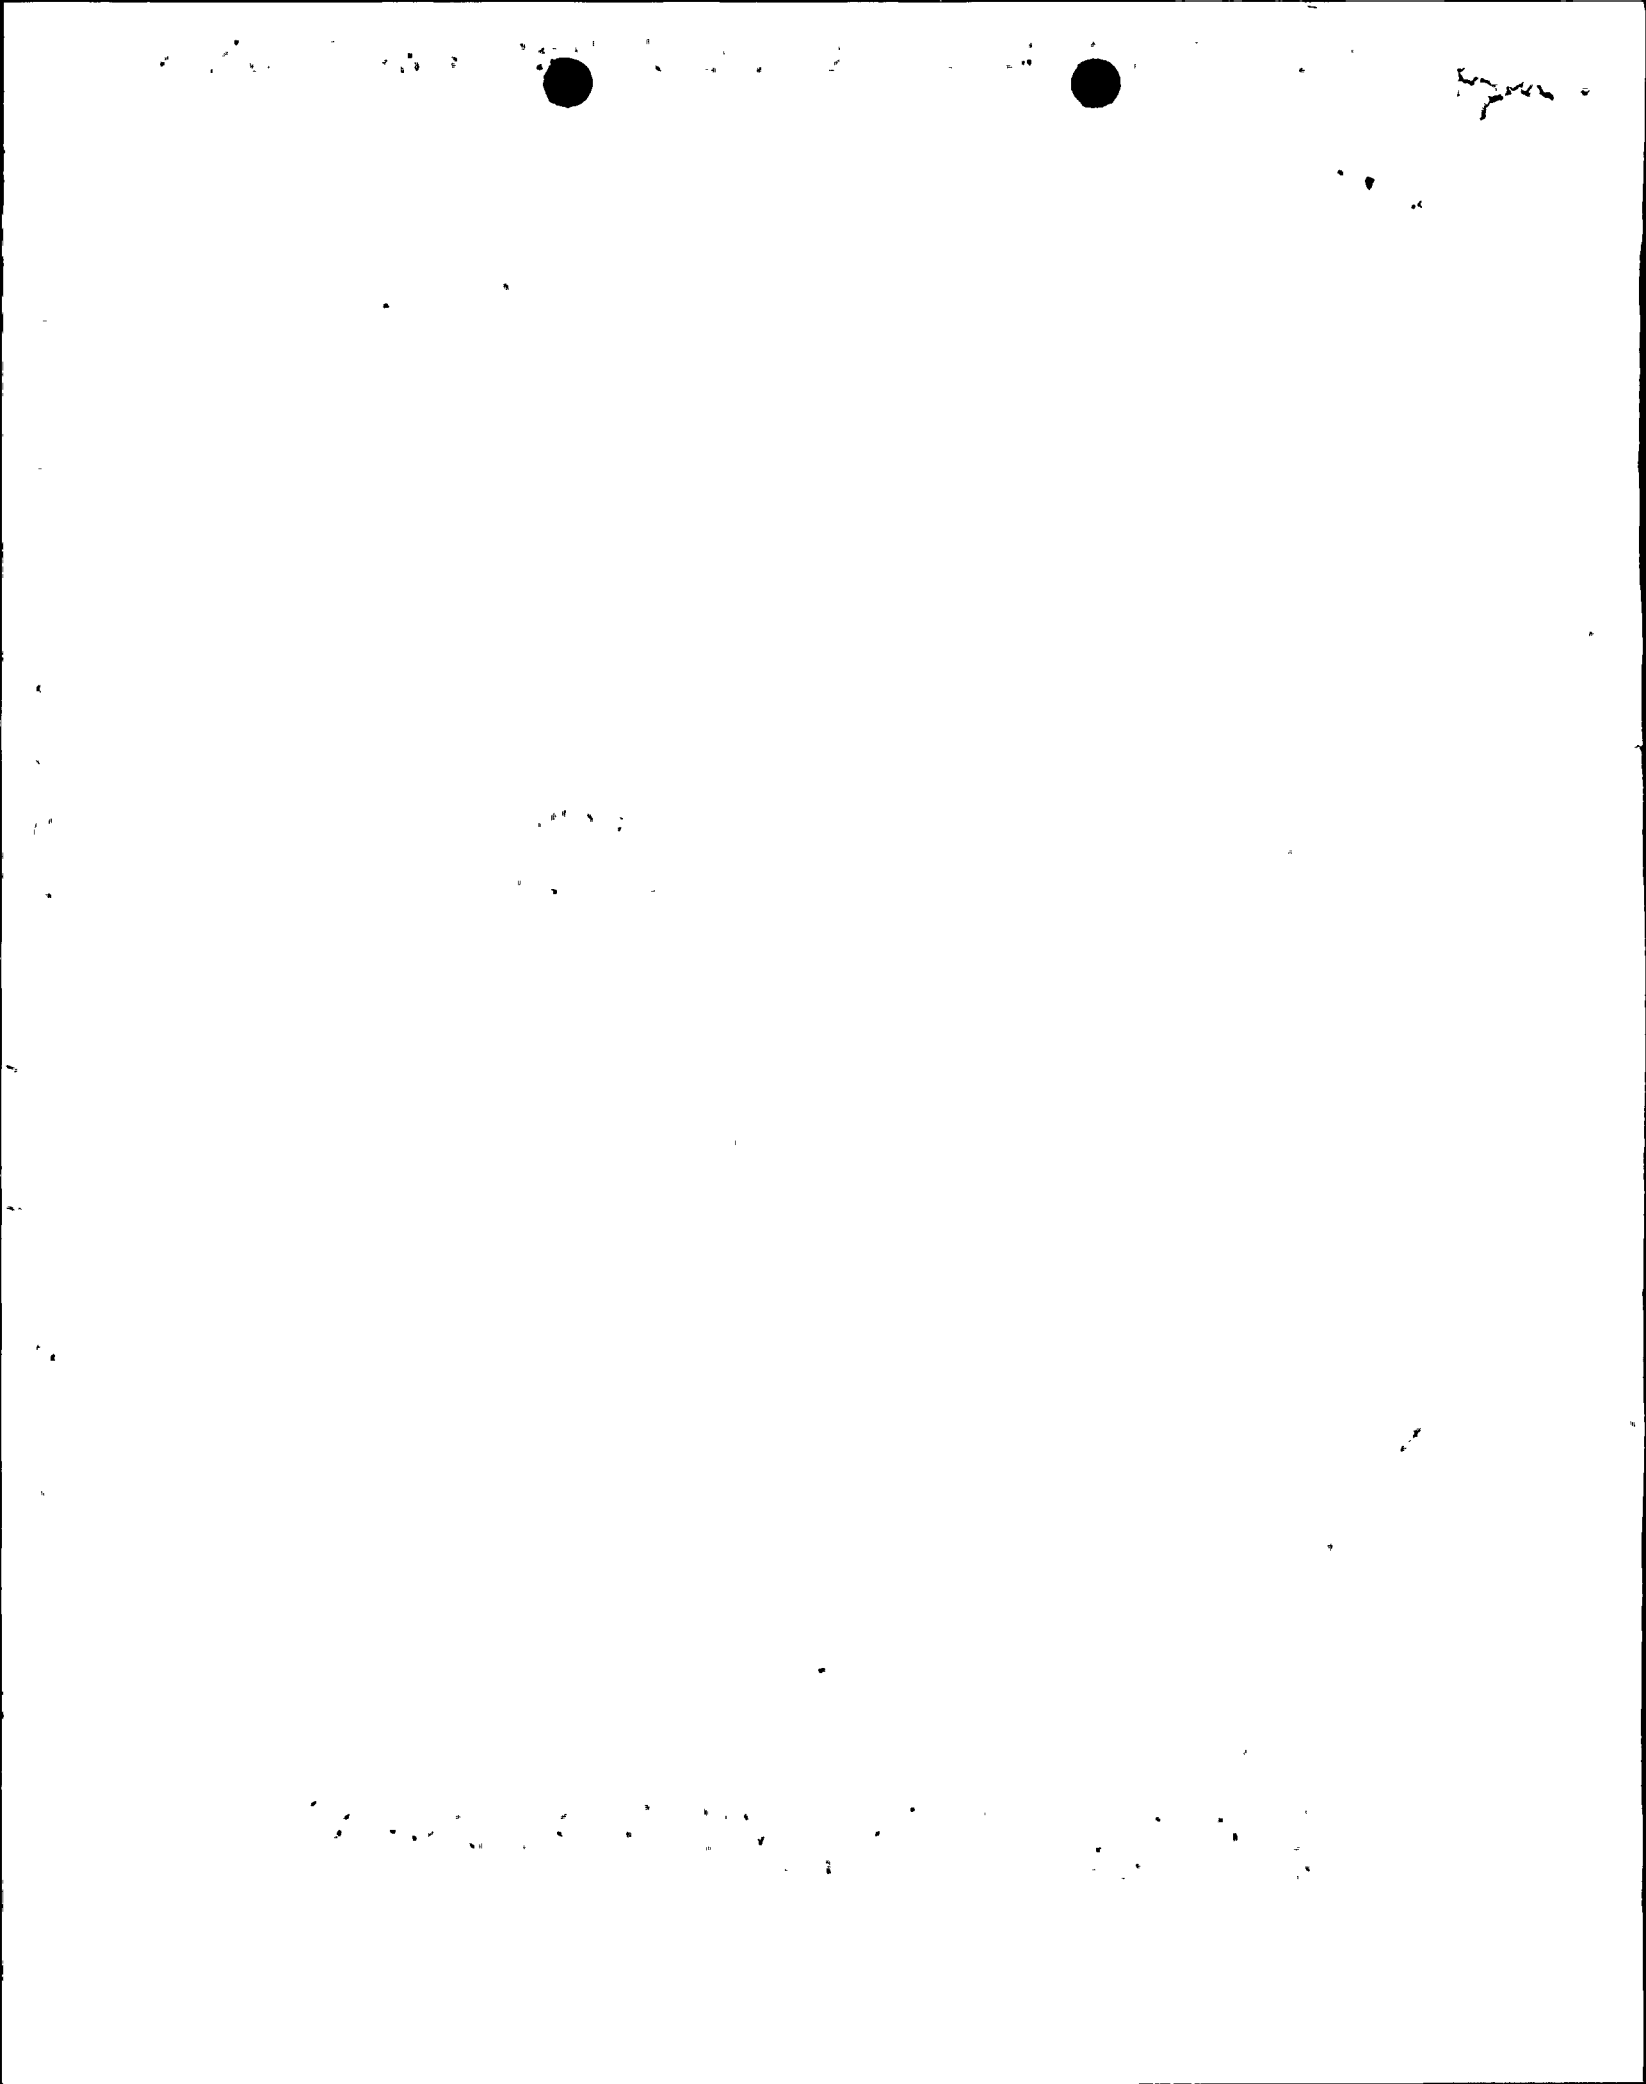



**Pennsylvania Power & Light Company**

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

Harold W. Keiser  
Senior Vice President-Nuclear  
215/774-4194

FEB 04 1993

Director of Nuclear Reactor Regulation  
Attention: Mr. C. L. Miller, Project Director  
Project Directorate I-2  
Division of Reactor Projects  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

**SUSQUEHANNA STEAM ELECTRIC STATION**  
**ILRT SUMMARY TECHNICAL REPORT**  
**PLA-3916 FILE R41-2A**

Docket No. 50-388

Dear Mr. Miller:

Pursuant to 10CFR50, Appendix J, attached is the Susquehanna SES Unit 2 Summary Technical Report for the ILRT completed November 2, 1992. Appendix H of the report summarizes Type B and C tests performed since the previous ILRT.

Acceptance criteria were met for both the "as found" and "as left" ILRT.

Very truly yours,

H. W. Keiser

080061

Attachment

cc: NRC-Document Control Desk (original)  
NRC Region I  
Mr. G. S. Barber, NRC Sr. Resident Inspector  
Mr. R. J. Clark, NRC Sr. Project Manager

9302100213 930204  
PDR ADCK 05000388  
P PDR

AD17 1/1

1000

18468