

ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9303010415 DOC. DATE: 93/02/24 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylvania 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylvania 05000388
 AUTH. NAME AUTHOR AFFILIATION
 KEISER, H.W. Pennsylvania Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 ROSS, D.F. Office for Analysis & Evaluation of Operational Data, Direc

SUBJECT: Supports Commissions recent decision re full implementation of INES, to better represents safety significance of events at facility than four level scale currently in use in US.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR	ENCL	RECIPIENT ID CODE/NAME	COPIES LTR	ENCL
	PD1-2 LA	1	1	PD1-2 PD	1	1
	CLARK, R	2	2			
INTERNAL:	ACRS	6	6	NRR/DE/EELB	1	1
	NRR/DORS/OTSB	1	1	NRR/DRCH/HICB	1	1
	NRR/DSSA/SRXB	1	1	NUDOCS-ABSTRACT	1	1
	OC/LFMB	1	0	OGC/HDS2	1	0
	<u>REG FILE</u> 01	1	1			
EXTERNAL:	NRC PDR	1	1	NSIC	1	1


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 20 ENCL 18 ⁰

MAF

R
I
D
S
/
A
D
D
S
/
A
D
D
S





Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

FEB 24 1993

Harold W. Keiser
Senior Vice President-Nuclear
215/774-4194

Mr. Denwood F. Ross, Jr.
Deputy Director
Office for Analysis and
Evaluation of Operational Data
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

**SUSQUEHANNA STEAM ELECTRIC STATION
SUPPORT OF THE USE OF IAEA INTERNATIONAL
NUCLEAR EVENT SCALE
PLA-3925**

FILE R41-2

Docket Nos. 50-387
and 50-388

Dear Mr. Ross:

We at Pennsylvania Power and Light Company support the Commission's recent decision regarding use of the International Nuclear Event Scale (INES). We would support the full implementation of INES as it better represents the safety significance of the events at a facility than does the four level scale currently in use in the United States.


We urge the Commission to move forward with the full implementation of INES.

Very truly yours,

H. W. Keiser

cc: NRC Document Control Desk (original)
NRC Region I
Mr. G. S. Barber - NRC Sr. Resident Inspector, SSES
Mr. R. J. Clark - NRC Sr. Project Manager, OWFN

010050

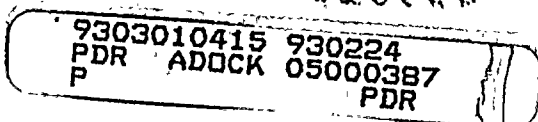

ADD 1/0



100

100

100