

ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9303250003 DOC. DATE: 93/03/18 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
 AUTH. NAME AUTHOR AFFILIATION
 FIELDS, J.S. Pennsylvania Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 SWARTZ, P.O. Pennsylvania, Commonwealth of

SUBJECT: Advises that util approves allocation of funds for replacement of Wilkes-Barre River gaging station. Any addl escrowed funds should be credited to next Susquehanna River Basin Commission bill for svcs to close account.

DISTRIBUTION CODE: C001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: Licensing Submittal: Environmental Rept Amdt & Related Correspondence

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD1-2 LA		3	3		PD1-2 PD		1	1
	CLARK, R		1	1					
INTERNAL:	ACRS		6	6		OC/LEMB		1	0
	OGC/HDS2		1	0		<u>REG FILE</u> 01		1	1
	RGN1 DRSS/RPB		1	1					
EXTERNAL:	EG&G SIMPSON, F		2	2		NRC PDR		1	1
	NSIC		1	1					


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 19 ENCL 170

ER-1

R
I
D
S
/
A
D
D
S
/
A
D
D
S

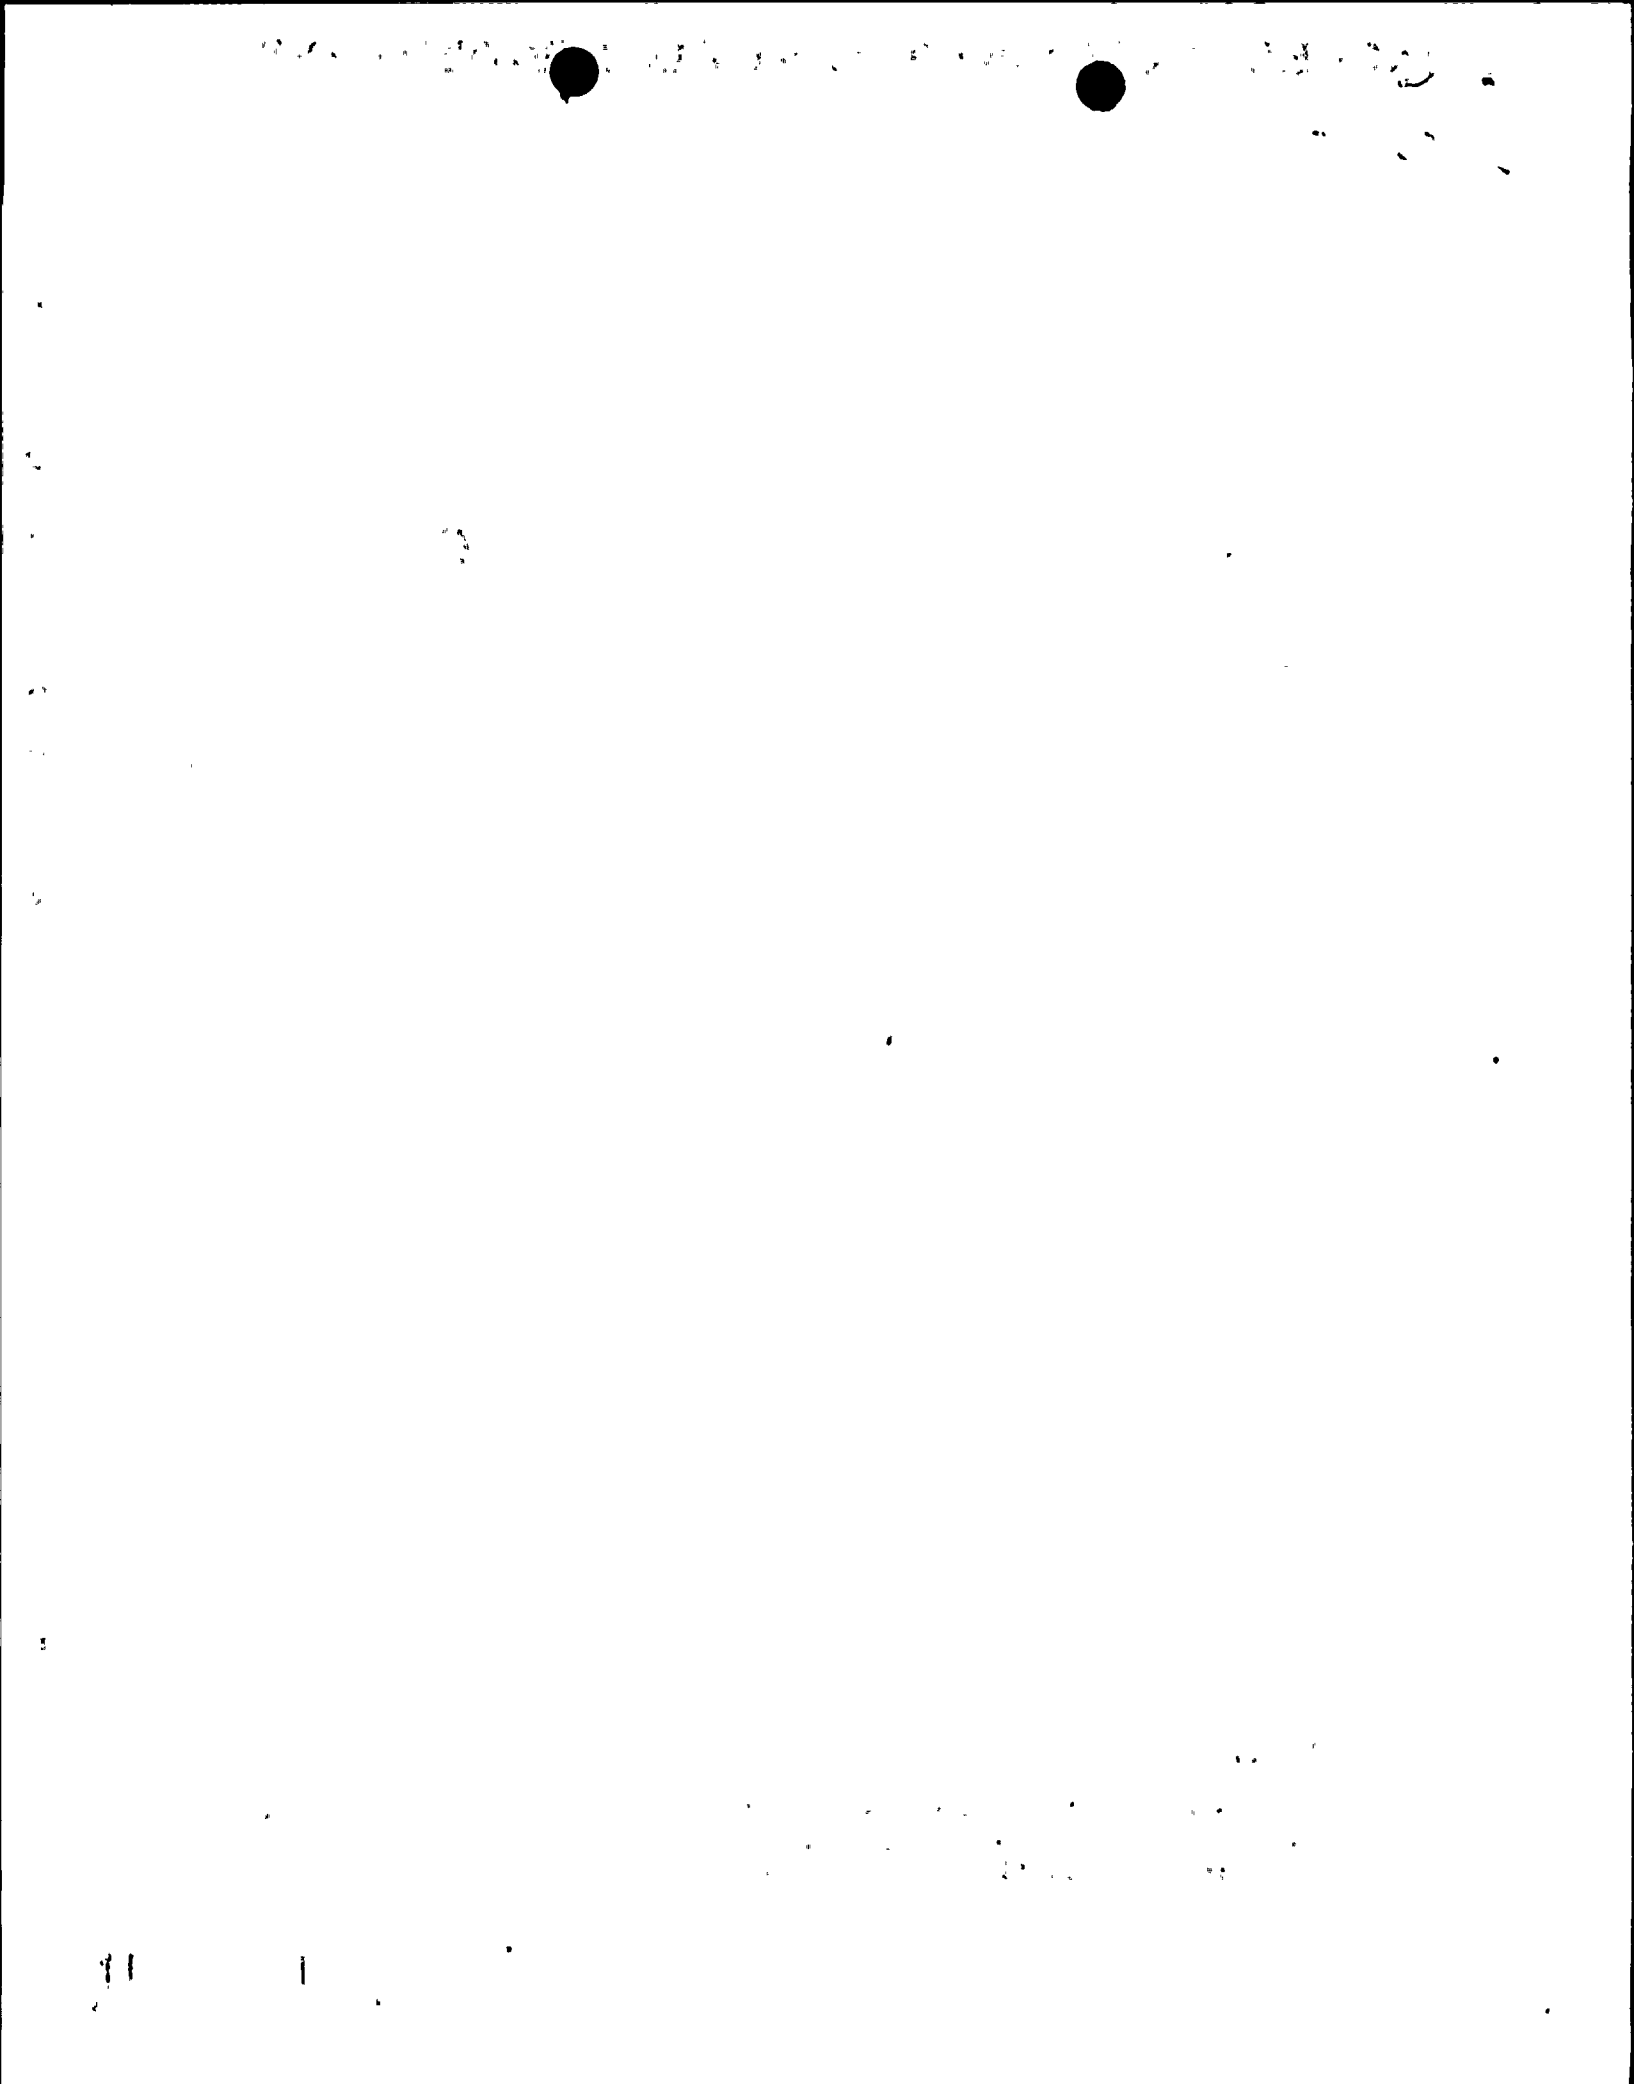



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

March 18, 1993

Mr. Paul O. Swartz
Executive Director
Susquehanna River Basin Commission
1721 North Front Street
Harrisburg, PA 17102

SUSQUEHANNA STEAM ELECTRIC STATION
REPLACEMENT OF WILKES-BARRE GAGE
CCN 741326 FILE R9-3
PLE- 16671

Dear Paul:

Pennsylvania Power & Light Company (PP&L) approves allocation of \$40,000 for replacement of the Wilkes-Barre river gaging station. PP&L understands that Article 4(D) 1&2 of the PP&L/Susquehanna River Basin Commission (SRBC) contract addresses capital improvements for river gages.

PP&L's portion of the escrowed account is two-thirds and also PP&L's portion of the gage replacement costs is two-thirds of the \$40,000. The remaining one-third of the costs will be paid by GPU Service Corp. Any additional escrowed funds should be credited to the next SRBC bill for services so that the account can be closed.

If you have any questions, please call me at (215) 774-7889.

Sincerely,

Jerome S. Fields
Sr. Environmental Scientist - Nuclear

jsf/1tc457c(25)

- cc: ~~NRC Document Control Desk~~
- NRC Region I
- Mr. R. J. Clark, NRC Sr. Project Manager
- Mr. D. A. Friends, SRBC
- Mr. J. C. Phillips, GPU

9303250003 930318
PDR ADOCK 05000387
P PDR

COD 1/0

STOOLIE