

ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9304190359 DOC. DATE: ~~93/03/31~~ NOTARIZED: NO DOCKET #
FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
AUTH. NAME AUTHOR AFFILIATION
YOUNG, K.A. Pennsylvania Power & Light Co.
BYRAM, R.G. Pennsylvania Power & Light Co.
RECIP. NAME RECIPIENT AFFILIATION

SUBJECT: Monthly operating repts for Mar 1993 for Susquehanna Staem
Electric Station Units 1 & 2. W/930415 Ltr.

DISTRIBUTION CODE: IE24D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 10
TITLE: Monthly Operating Report (per Tech Specs)

NOTES:


	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL	ID CODE/NAME		LTR	ENCL
	PD1-2 LA		3	3	PD1-2 PD		1	1
	CLARK, R		1	1				
INTERNAL:	ACRS		10	10	AEOD/DOA		1	1
	AEOD/DSP/TPAB		1	1	NRR/DORS/OEAB		1	1
	NRR/DRIL/RPEB		1	1	<u>REG FILE</u> 01		1	1
	RGN1		1	1				
EXTERNAL:	EG&G BRYCE, J.H		1	1	NRC PDR		1	1
	NSIC		1	1				

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK;
ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 24 ENCL 24

MR

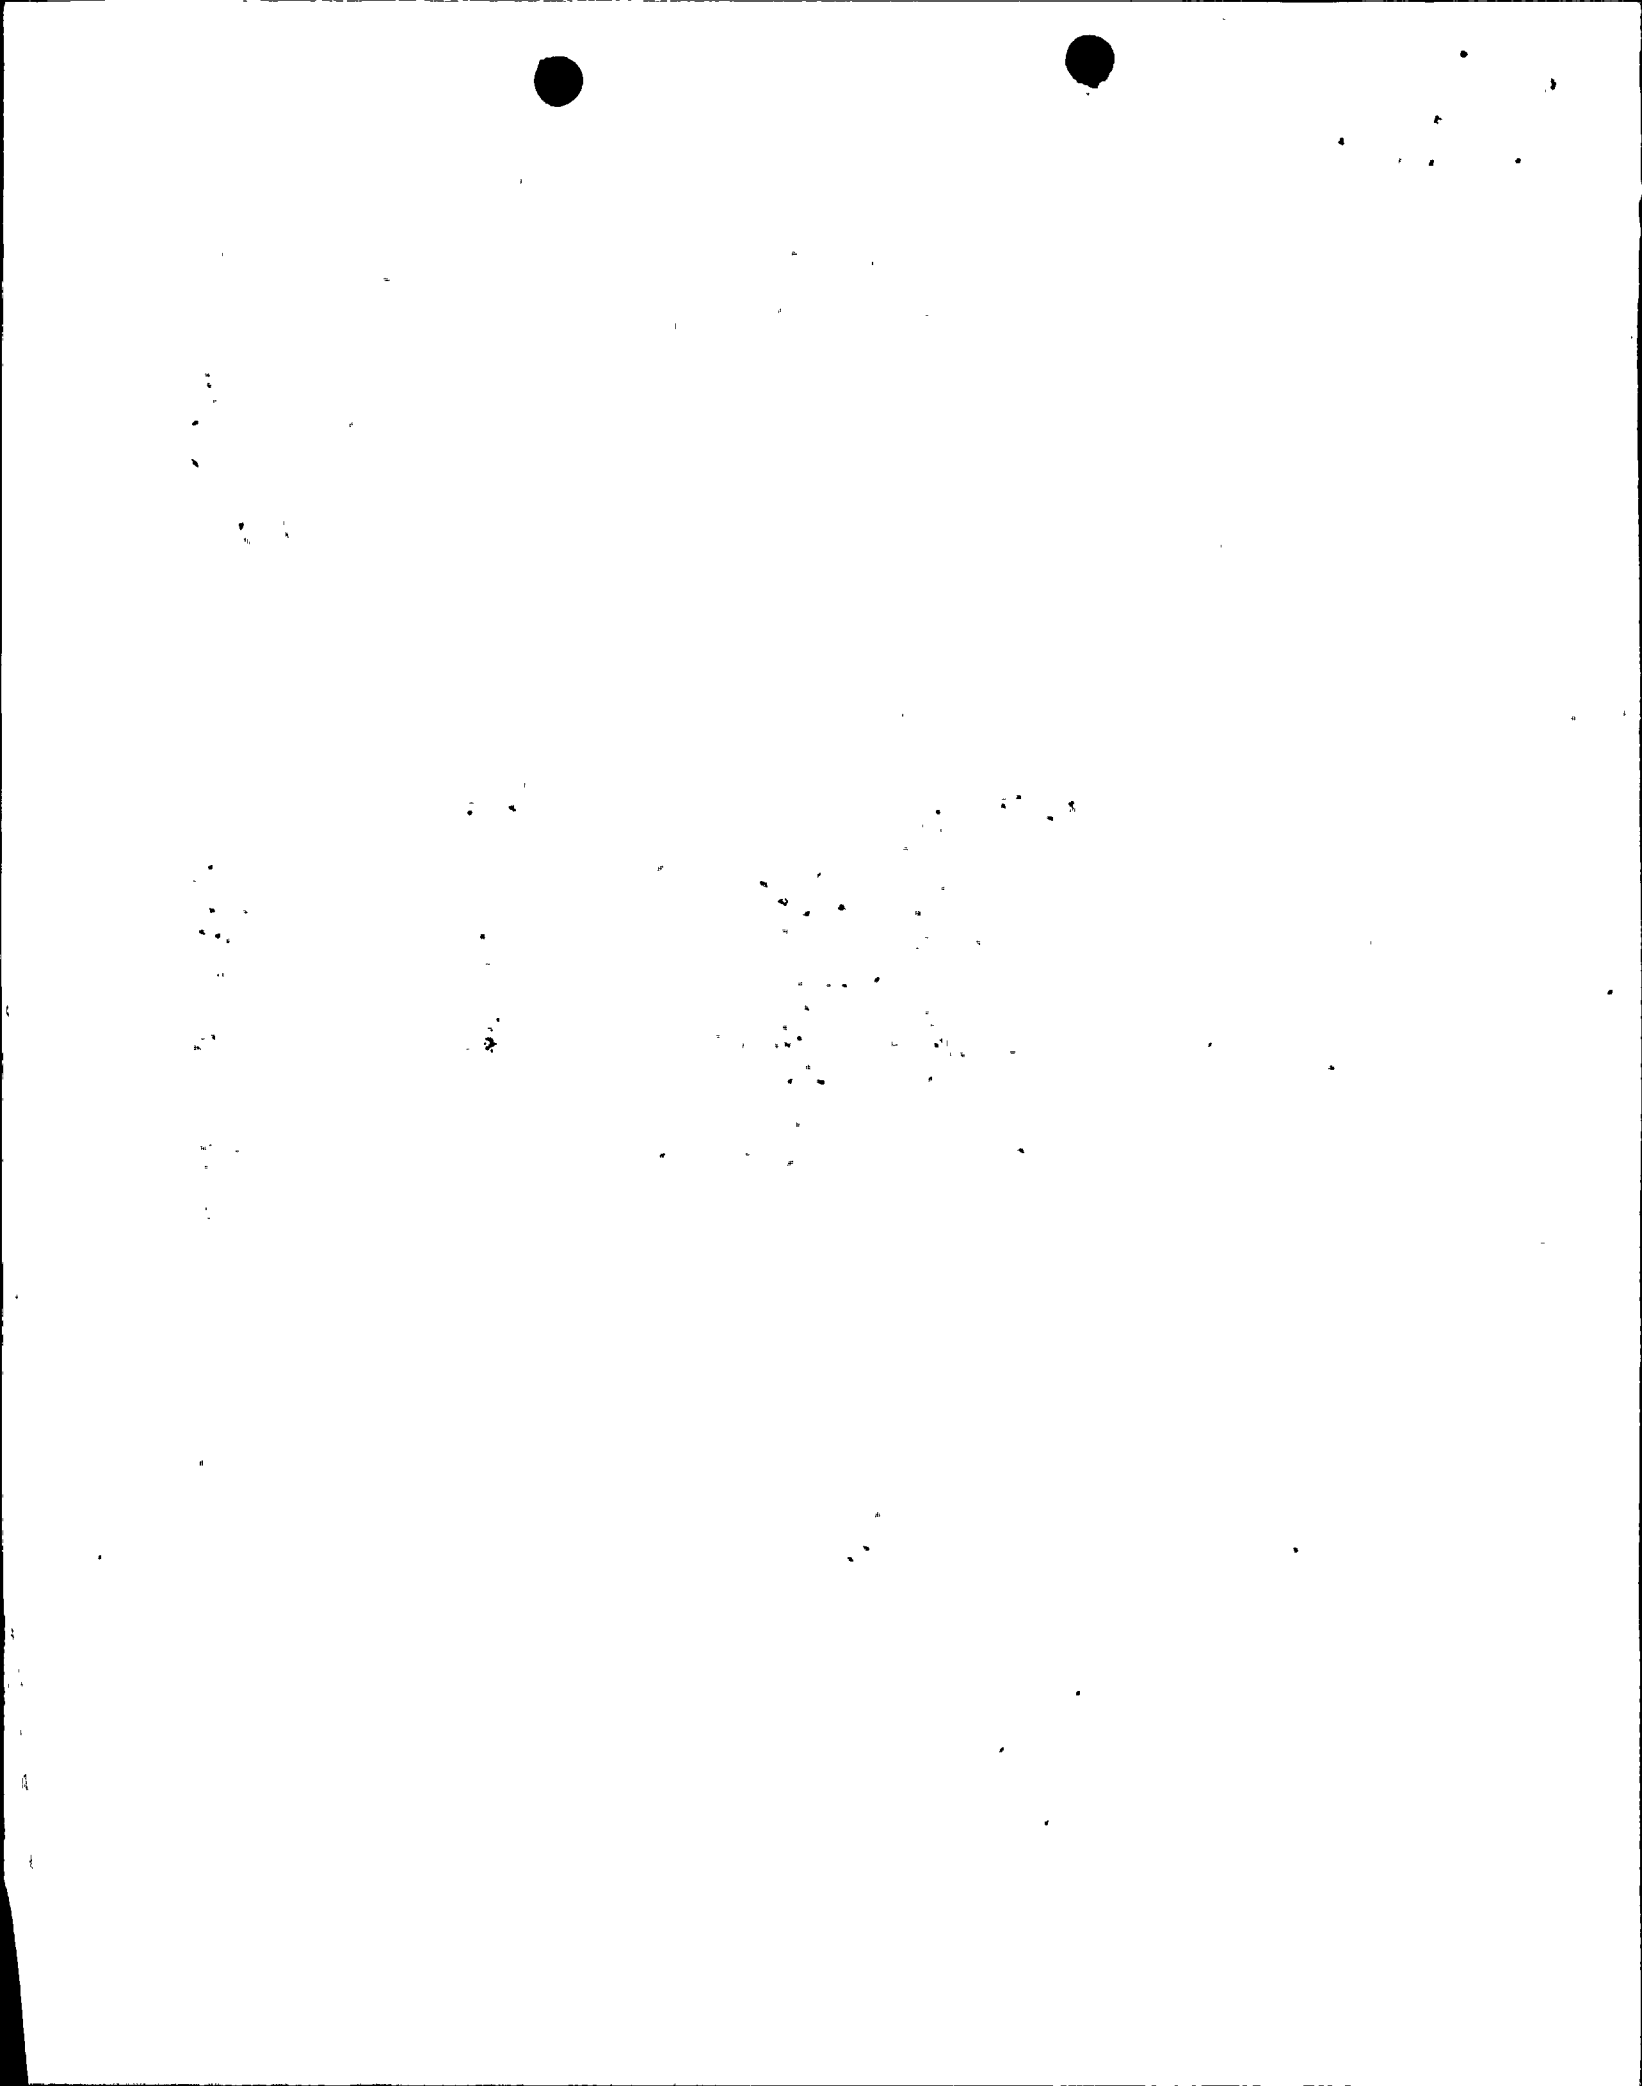



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 215/774-5151

Robert G. Byram
Senior Vice President-Nuclear
215/774-7502

Submitted pursuant to
Technical Specifications
Section 6.9.1.6

APR 15 1993


U.S. Nuclear Regulatory Commission
Attn.: Document Control Desk
Washington, D.C. 20555

SUSQUEHANNA STEAM ELECTRIC STATION
MONTHLY OPERATING REPORTS
PLA-3960 FILE R41-2A

Docket Nos. 50-387/NPF-14
and 50-388/NPF-22

The March 1993 monthly operating reports for Susquehanna SES Units 1 and 2 are attached.

Very truly yours,

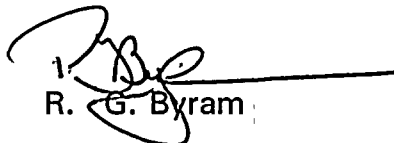
R. G. Byram

Attachment

cc: NRC Region I
Mr. G. S. Barber, NRC Resident Inspector
Mr. R. J. Clark, NRC Sr. Project Manager


190115
9304190359 930331
PDR ADDCK 05000387
R PDR

Test 1/1

1901 21 57

1901 21 57

AVERAGE DAILY UNIT POWER LEVEL

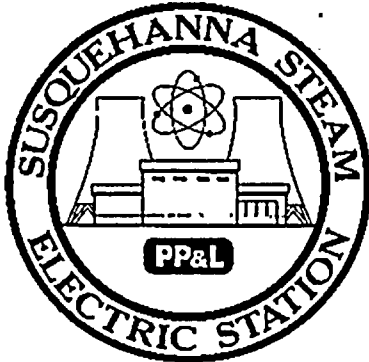

DOCKET NO. 50-387

UNIT: One

DATE: 04-12-93

COMPLETED BY: K.A. Young

TELEPHONE: (717)542-3251


MONTH March 1993

DAY	AVERAGE DAILY POWER LEVEL (MWe-Net)
1	1046
2	1044
3	1045
4	1044
5	1045
6	1046
7	1045
8	1044
9	1045
10	1047
11	1046
12	1047
13	1047
14	1048
15	1048
16	1047


DAY	AVERAGE DAILY POWER LEVEL (Mwe-Net)
17	1046
18	1049
19	1048
20	1048
21	1045
22	1046
23	1046
24	1046
25	1046
26	1012
27	544
28	735
29	957
30	1043
31	817

INSTRUCTIONS

On this format, list the average daily unit power level in MWe-Net for each day in the reporting month. Compute to the nearest whole megawatt.

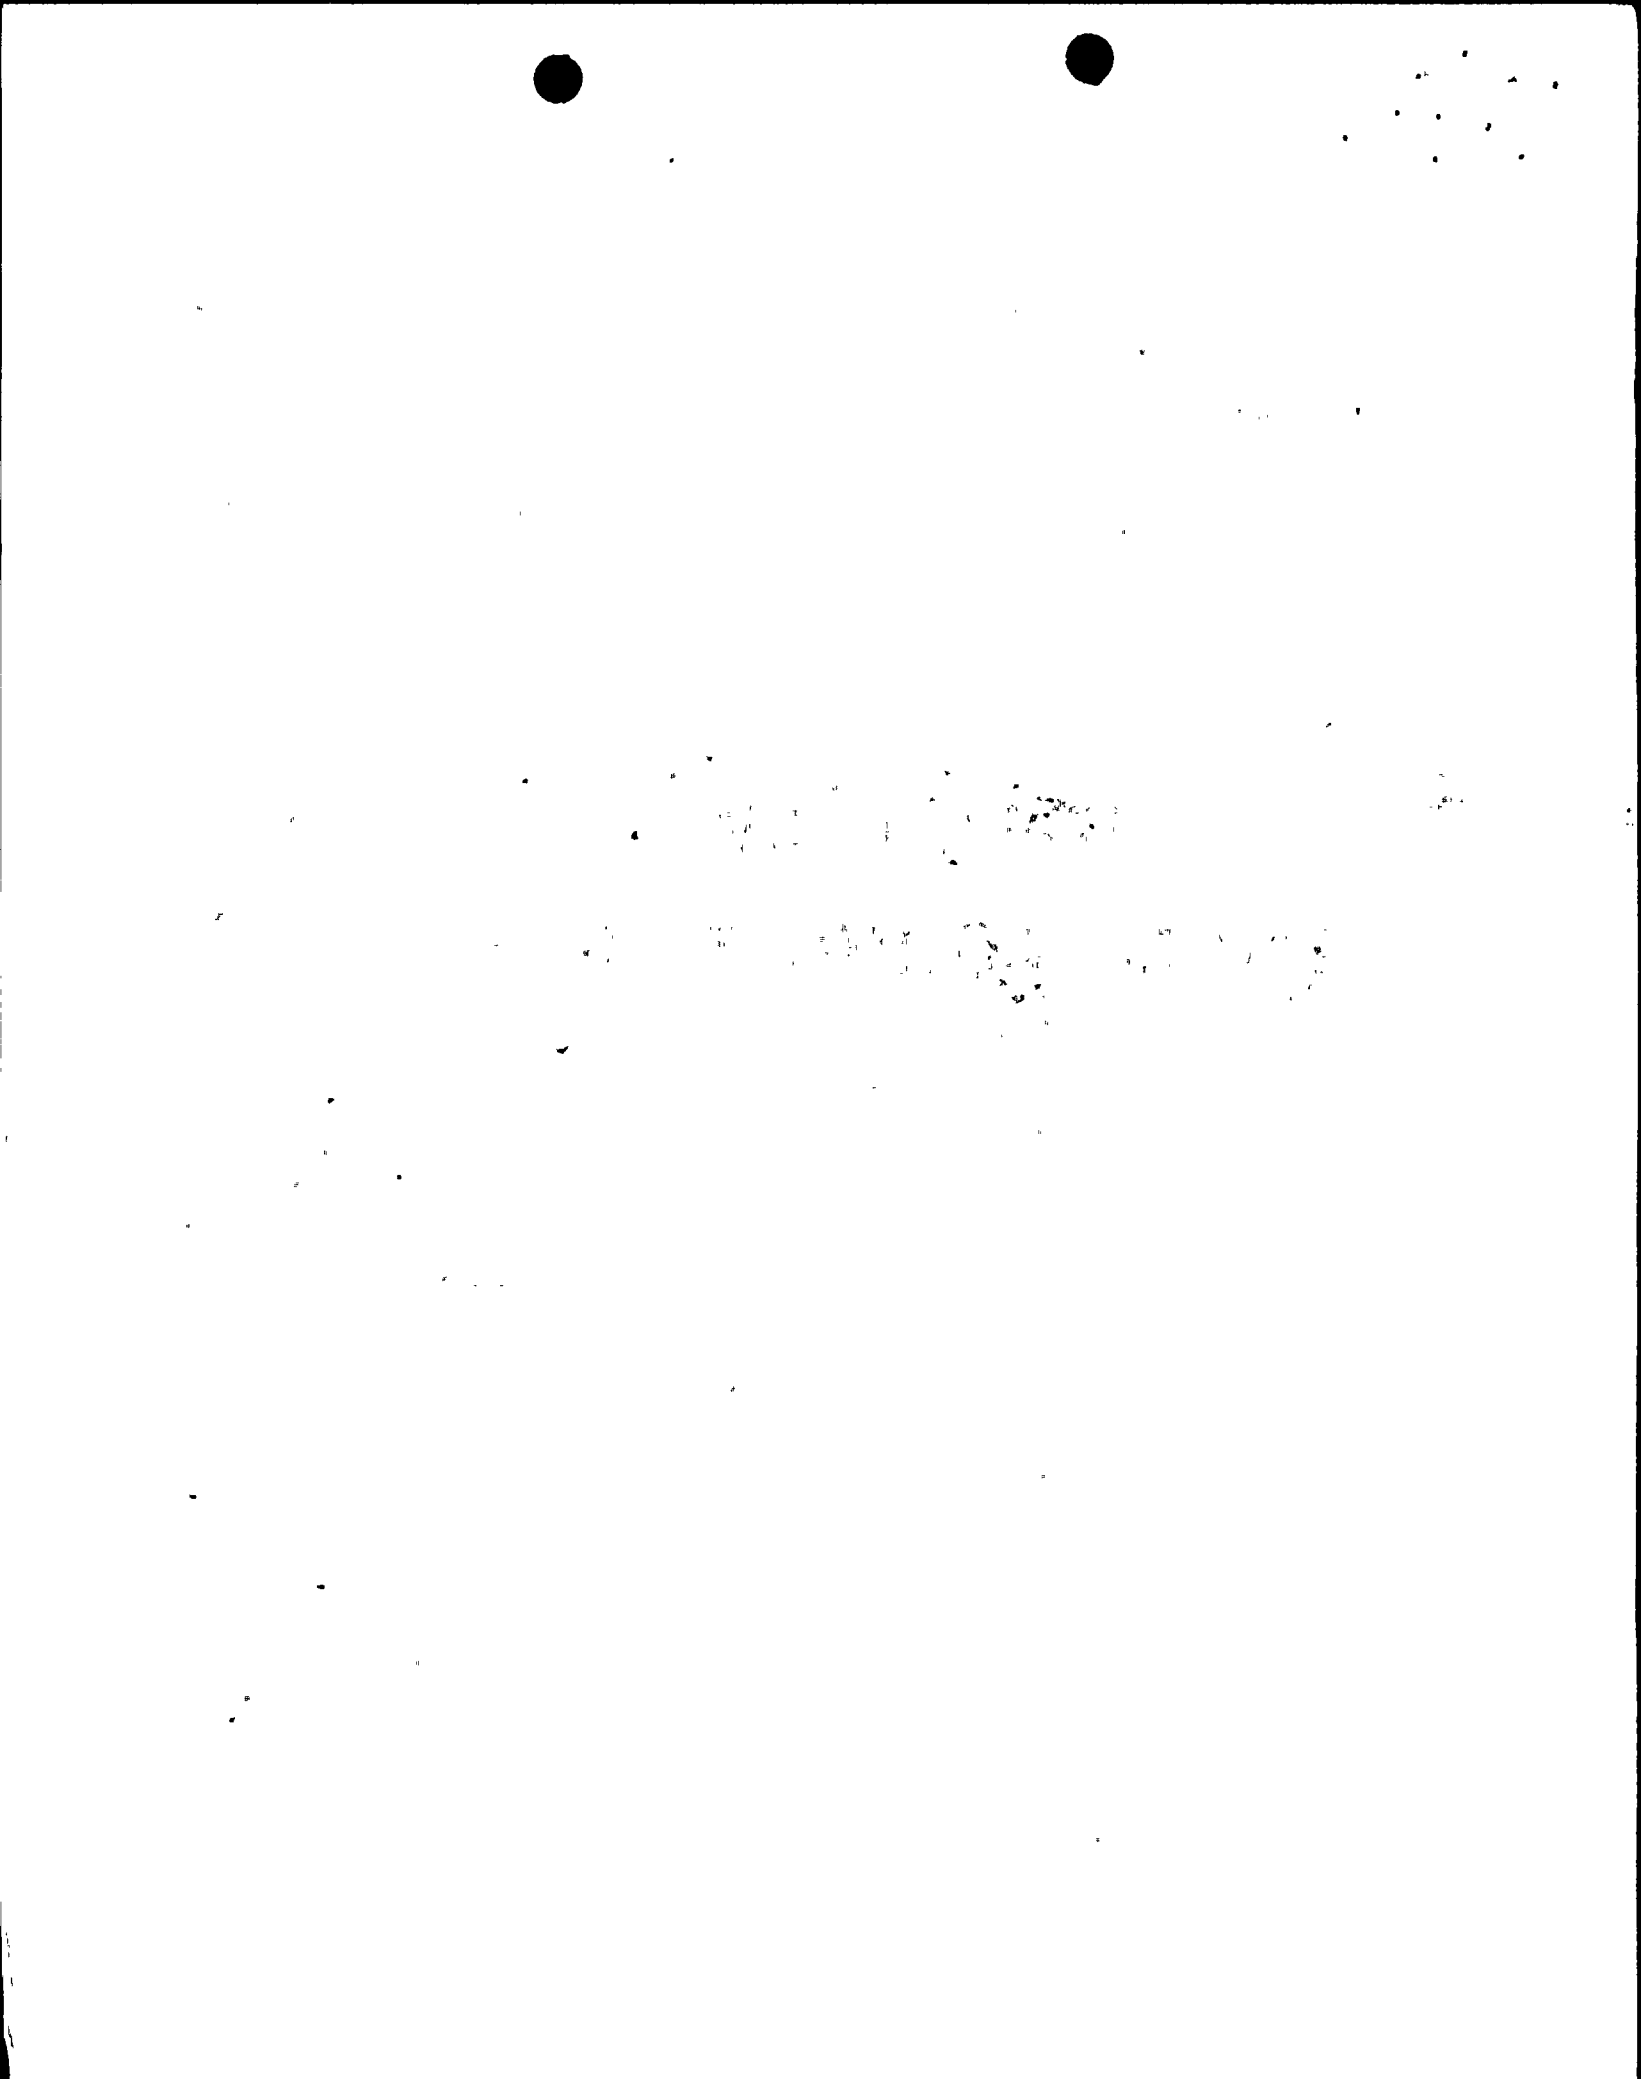

OPERATING DATA REPORT

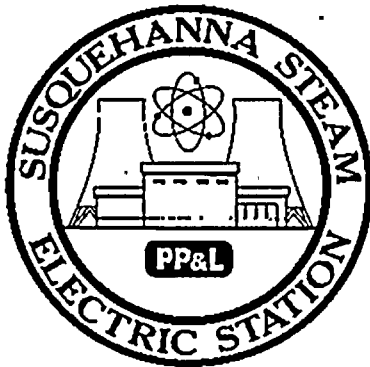

DOCKET NO.: 50-387
 DATE: 04-12-93
 COMPLETED BY: K.A. Young
 TELEPHONE: (717) 542-3251

Notes

OPERATING STATUS

1. Unit Name: Susquehanna Steam Electric Station (Unit 1)
2. Reporting Period: March 1993
3. Licensed Thermal Power (Mwt): 3293
4. Nameplate Rating (Gross MWe): 1152
5. Design Electrical Rating (Net MWe): 1050
6. Maximum Dependable Capacity (Gross MWe): 1078
7. Maximum Dependable Capacity (Net MWe): 1040
8. If Changes Occur in Capacity Ratings (Items Number 3 Through 7) Since Last Report. Give Reasons: None


9. Power Level To Which Restricted, If Any (Net MWe): None
10. Reasons For Restrictions, If Any: N/A

	This Month	Yr-to-Date	Cumulative
11. Hours In Reporting Period	<u>744</u>	<u>2160</u>	<u>86,041</u>
12. Number of Hrs Reactor Was Critical	<u>744</u>	<u>2160</u>	<u>67,833.2</u>
13. Reactor Reserve Shutdown Hours	<u>0</u>	<u>0</u>	<u>1032</u>
14. Hours Generator On-Line	<u>744</u>	<u>2160</u>	<u>66,458.9</u>
15. Unit Reserve Shutdown Hours	<u>0</u>	<u>0</u>	<u>0</u>
16. Gross Thermal Energy Generated (MWH)	<u>2,359,380</u>	<u>6,999,164</u>	<u>208,796,829</u>
17. Gross Electrical Energy Generated (MWH)	<u>776,138</u>	<u>2,308,560</u>	<u>68,254,440</u>
18. Net Electric Energy Generated (MWH)	<u>750,298</u>	<u>2,230,823</u>	<u>65,596,612</u>
19. Unit Service Factor	<u>100</u>	<u>100</u>	<u>77.2</u>
20. Unit Availability Factor	<u>100</u>	<u>100</u>	<u>77.2</u>
21. Unit Capacity Factor (Using MDC Net)	<u>97.0</u>	<u>99.3</u>	<u>73.3</u>
22. Unit Capacity Factor (Using DER Net)	<u>96.0</u>	<u>98.4</u>	<u>72.6</u>
23. Unit Forced Outage Rate	<u>0</u>	<u>0</u>	<u>7.4</u>
24. Shutdowns Scheduled Over Next 6 Months (Type, Date and Duration of Each)			

25. If Shut Down At End of Report Period, Estimated Date of Startup: _____
26. Units In Test Status (Prior to Commercial Operation): _____

	FORECAST	ACHIEVED
INITIAL CRITICALITY	_____	_____
INITIAL ELECTRICITY	_____	_____
COMMERCIAL OPERATION	_____	_____

UNIT SHUTDOWNS AND POWER REDUCTIONS



REPORT MONTH March 1993

DOCKET NO. 50-387
 UNIT NAME One
 DATE 04-12-93
 COMPLETED BY K.A. Young
 TELEPHONE (717) 542-3251

NO.	DATE	TYPE ¹	DURATION (HOURS)	REASON ²	METHOD OF SHUTTING DOWN REACTOR ³	LICENSEE EVENT REPORT#	SYSTEM CODE ⁴	COMPONENT CODE ⁵	CAUSE & CORRECTIVE ACTION TO PREVENT RECURRENCE
2	930326	S	0.0	B	5	N/A	XX	ZZZ	Unit One commenced a power reduction at 2200 hours March 26 for scheduled maintenance. Power level was reduced to as low as 36% for control rod sequence exchange and Rx Recirc M/G set brush change outs. Maintenance activities performed during power ascension schedule included: Feedwater flow transmitter replacements, installation of special test flow transmitter under plant bypass program, and I&C tuning of feed water flow control for single element operation. Unit returned to 100% power at 1800 hours March 29.


F: Forced
 S: Scheduled

Reason:
 A-Equipment Failure (Explain)
 B-Maintenance or Test
 C-Refueling
 D-Regulatory Restriction
 E-Operator Training & License Examination
 F-Administrative
 G-Operational Error (Explain)
 H-Other (Explain)


Method:
 1-Manual
 2-Manual Scram
 3-Automatic Scram
 4-Continuation from previous month
 5-Reduction
 9-Other

Exhibit G-Instructions for preparation of Data Entry Sheets for Licensee Event Report (LER) File (NUREG 0161)

5
 Exhibit I-Same Source



UNIT SHUTDOWNS AND POWER REDUCTIONS



REPORT MONTH March 1993

DOCKET NO.	<u>50-387</u>
UNIT NAME	<u>One</u>
DATE	<u>04-12-93</u>
COMPLETED BY	<u>K. A. Young</u>
TELEPHONE	<u>(717) 542-3251</u>

NO.	DATE	TYPE ¹	DURATION (HOURS)	REASON ²	METHOD OF SHUTTING DOWN REACTOR ³	LICENSEE EVENT REPORT#	SYSTEM CODE ⁴	COMPONENT CODE ⁵	CAUSE & CORRECTIVE ACTION TO PREVENT RECURRENCE
3	930331	F	0.0	A	5	NA	SJ	LCV	Unit One commenced a power reduction at 0001 hours March 31. Normal level control valve for the 4C feedwater heater failed close causing the "C" Feedwater string to isolate. Reactor power level was reduced to 80%. Repairs were made to LV10408C. Unit returned to 100% power at 1100 hours on April 1.

F: Forced
S: Scheduled

Reason:
A-Equipment Failure (Explain)
B-Maintenance or Test
C-Refueling
D-Regulatory Restriction
E-Operator Training & License Examination
F-Administrative
G-Operational Error (Explain)
H-Other (Explain)

Method:
1-Manual
2-Manual Scram
3-Automatic Scram
4-Continuation
5-Reduction
9-Other

G-Instructions Exhibit
for preparation of Data
Entry Sheets for Licensee
Event Report (LER) File (NUREG
0161)
5
Exhibit I-Same Source

SUSQUEHANNA STEAM ELECTRIC STATION

Docket Number 50-387 Date: 04-12-93

Completed by K. A. Young Telephone: (717) 542-3251

Challenges to Main Steam Safety Relief Valves


None.

Changes to the Offsite Dose Calculation Manual


None.

Major Changes to Radioactive Waste Treatment Systems

None.



AVERAGE DAILY UNIT POWER LEVEL

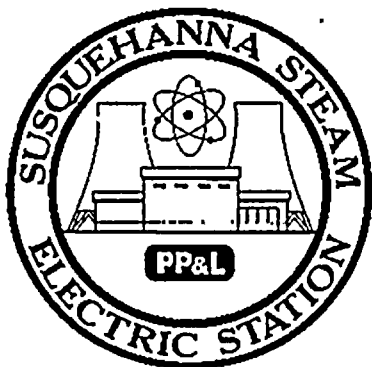

DOCKET NO.: 50-388

UNIT: Two

DATE: 04-12-93

COMPLETED BY: K.A. Young

TELEPHONE: (717)542-3251


MONTH March 1993

DAY	AVERAGE DAILY POWER LEVEL (MWe-Net)	DAY	AVERAGE DAILY POWER LEVEL (MWe-Net)
1	<u>1063</u>	17	<u>1061</u>
2	<u>997</u>	18	<u>1063</u>
3	<u>719</u>	19	<u>1037</u>
4	<u>1018</u>	20	<u>1054</u>
5	<u>1064</u>	21	<u>1061</u>
6	<u>1064</u>	22	<u>1063</u>
7	<u>1063</u>	23	<u>1063</u>
8	<u>1063</u>	24	<u>1062</u>
9	<u>1064</u>	25	<u>1063</u>
10	<u>1064</u>	26	<u>1061</u>
11	<u>1063</u>	27	<u>1058</u>
12	<u>1065</u>	28	<u>1053</u>
13	<u>1065</u>	29	<u>1056</u>
14	<u>1064</u>	30	<u>1058</u>
15	<u>1063</u>	31	<u>1057</u>
16	<u>1061</u>		

INSTRUCTIONS

On this format, list the average daily unit power level in MWe-Net for each day in the reporting month. Compute to the nearest whole megawatt.

OPERATING DATA REPORT

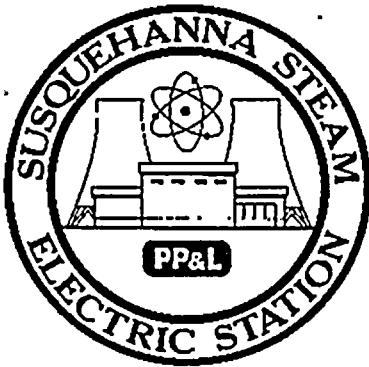

DOCKET NO. 50-388
 DATE: 04-12-93
 COMPLETED BY: K.A. Young
 TELEPHONE: (717) 542-3251

Notes

OPERATING STATUS


1. Unit Name: Susquehanna Steam Electric Station (Unit 2)
2. Reporting Period: March 1993
3. Licensed Thermal Power (Mwt): 3293
4. Nameplate Rating (Gross MWe): 1152
5. Design Electrical Rating (Net MWe): 1050
6. Maximum Dependable Capacity (Gross MWe): 1082
7. Maximum Dependable Capacity (Net MWe): 1044
8. If Changes Occur in Capacity Ratings (Items Number 3 Through 7) Since Last Report. Give Reasons: N/A


9. Power Level To Which Restricted, If Any (Net MWe): None
10. Reasons For Restrictions, If Any: N/A

	This Month	Yr-to-Date	Cumulative
11. Hours In Reporting Period	<u>744</u>	<u>2160</u>	<u>71,280</u>
12. Number of Hrs Reactor Was Critical	<u>744</u>	<u>2,035.9</u>	<u>59,273.5</u>
13. Reactor Reserve Shutdown Hours	<u>0</u>	<u>0</u>	<u>717.9</u>
14. Hours Generator On-Line	<u>744</u>	<u>1974.1</u>	<u>58,091.4</u>
15. Unit Reserve Shutdown Hours	<u>0</u>	<u>0</u>	<u>0</u>
16. Gross Thermal Energy Generated (MWH)	<u>2,412,631</u>	<u>6,356,964</u>	<u>184,349,423</u>
17. Gross Electrical Energy Generated (MWH)	<u>805,084</u>	<u>2,122,245</u>	<u>60,487,979</u>
18. Net Electric Energy Generated (MWH)	<u>778,290</u>	<u>2,046,676</u>	<u>58,213,990</u>
19. Unit Service Factor	<u>100</u>	<u>91.4</u>	<u>81.5</u>
20. Unit Availability Factor	<u>100</u>	<u>91.4</u>	<u>81.5</u>
21. Unit Capacity Factor (Using MDC Net)	<u>100.2</u>	<u>90.8</u>	<u>78.2</u>
22. Unit Capacity Factor (Using DER Net)	<u>99.6</u>	<u>90.2</u>	<u>77.8</u>
23. Unit Forced Outage Rate	<u>0</u>	<u>8.6</u>	<u>5.5</u>
24. Shutdowns Scheduled Over Next 6 Months (Type, Date and Duration of Each)			

25. If Shut Down At End of Report Period, Estimated Date of Startup: _____
26. Units In Test Status (Prior to Commercial Operation): _____

	FORECAST	ACHIEVED
INITIAL CRITICALITY	_____	_____
INITIAL ELECTRICITY	_____	_____
COMMERCIAL OPERATION	_____	_____





UNIT SHUTDOWNS AND POWER REDUCTIONS

REPORT MONTH March 1993

DOCKET NO. 50-388
 UNIT NAME Two
 DATE 04-12-93
 COMPLETED BY K. A. Young
 TELEPHONE (717) 542-3251

NO.	DATE	TYPE ¹	DURATION (HOURS)	REASON ²	METHOD OF SHUTTING DOWN REACTOR ³	LICENSEE EVENT REPORT#	SYSTEM CODE ⁴	COMPONENT CODE ⁵	CAUSE & CORRECTIVE ACTION TO PREVENT RECURRENCE
3	930302	S	0.0	B	5	NA	SG	TBG	Unit Two commenced a power reduction at 2200 hours March 2 for scheduled maintenance. Power level was reduced to as low as 60% for condenser tube leak investigation in the "D" and "C" water boxes. Tubes were plugged in the "C" water box. Unit returned to 100% power operation at 1400 hours on March 4.

¹
 F: Forced
 S: Scheduled

²
 Reason:
 A-Equipment Failure (Explain)
 B-Maintenance or Test
 C-Refueling
 D-Regulatory Restriction
 E-Operator Training & License Examination
 F-Administrative
 G-Operational Error (Explain)
 H-Other (Explain)

³
 Method:
 1-Manual
 2-Manual Scram
 3-Automatic Scram
 4-Continuation
 from previous month
 5-Reduction
 9-Other

⁴
 Exhibit G-Instructions
 for preparation of Data
 Entry Sheets for Licensee
 Event Report (LER) File (NUREG
 0161)
⁵
 Exhibit I-Same Source

SUSQUEHANNA STEAM ELECTRIC STATION

Docket Number 50-388 Date: 04-12-93

Completed by K. A. Young Telephone: (717) 542-3251

Challenges to Main Steam Safety Relief Valves

None.

Changes to the Offsite Dose Calculation Manual

None.

Major Changes to Radioactive Waste Treatment Systems

None.

