

ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9406130264 DOC. DATE: 94/06/06 NOTARIZED: YES DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388

AUTH. NAME AUTHOR AFFILIATION
 BYRAM, R.G. Pennsylvania Power & Light Co.
 RECIPIENT NAME RECIPIENT AFFILIATION
 MILLER, C.L. Project Directorate I-2

SUBJECT: Forwards proposed Amends 166 & 121 to Licenses NPF-14 & NPF-22, respectively, changing TS 3.1.5 re standby liquid control sys operable during Operational Condition 5 w/any control rod withdrawn.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+25
 TITLE: OR Submittal: General Distribution

NOTES:


	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL	ID CODE/NAME		LTTR	ENCL
	PD1-2 LA		1	1	PD1-2 PD		1	1
	POSLUSNY, C		2	2				
INTERNAL:	ACRS		6	6	NRR/DE/EELB		1	1
	NRR/DORS/ONDD		1	1	NRR/DRCH/HICB		1	1
	NRR/DRPW		1	1	NRR/DSSA/SPLB		1	1
	NRR/DSSA/SRXB		1	1	NUDOCS-ABSTRACT		1	1
	OC/LEDCEB		1	0	OGC/HDS2		1	0
	<u>REG FILE</u> 01		1	1				
EXTERNAL:	NRC PDR		1	1	NSIC		1	1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 22 ENCL 20

AA2

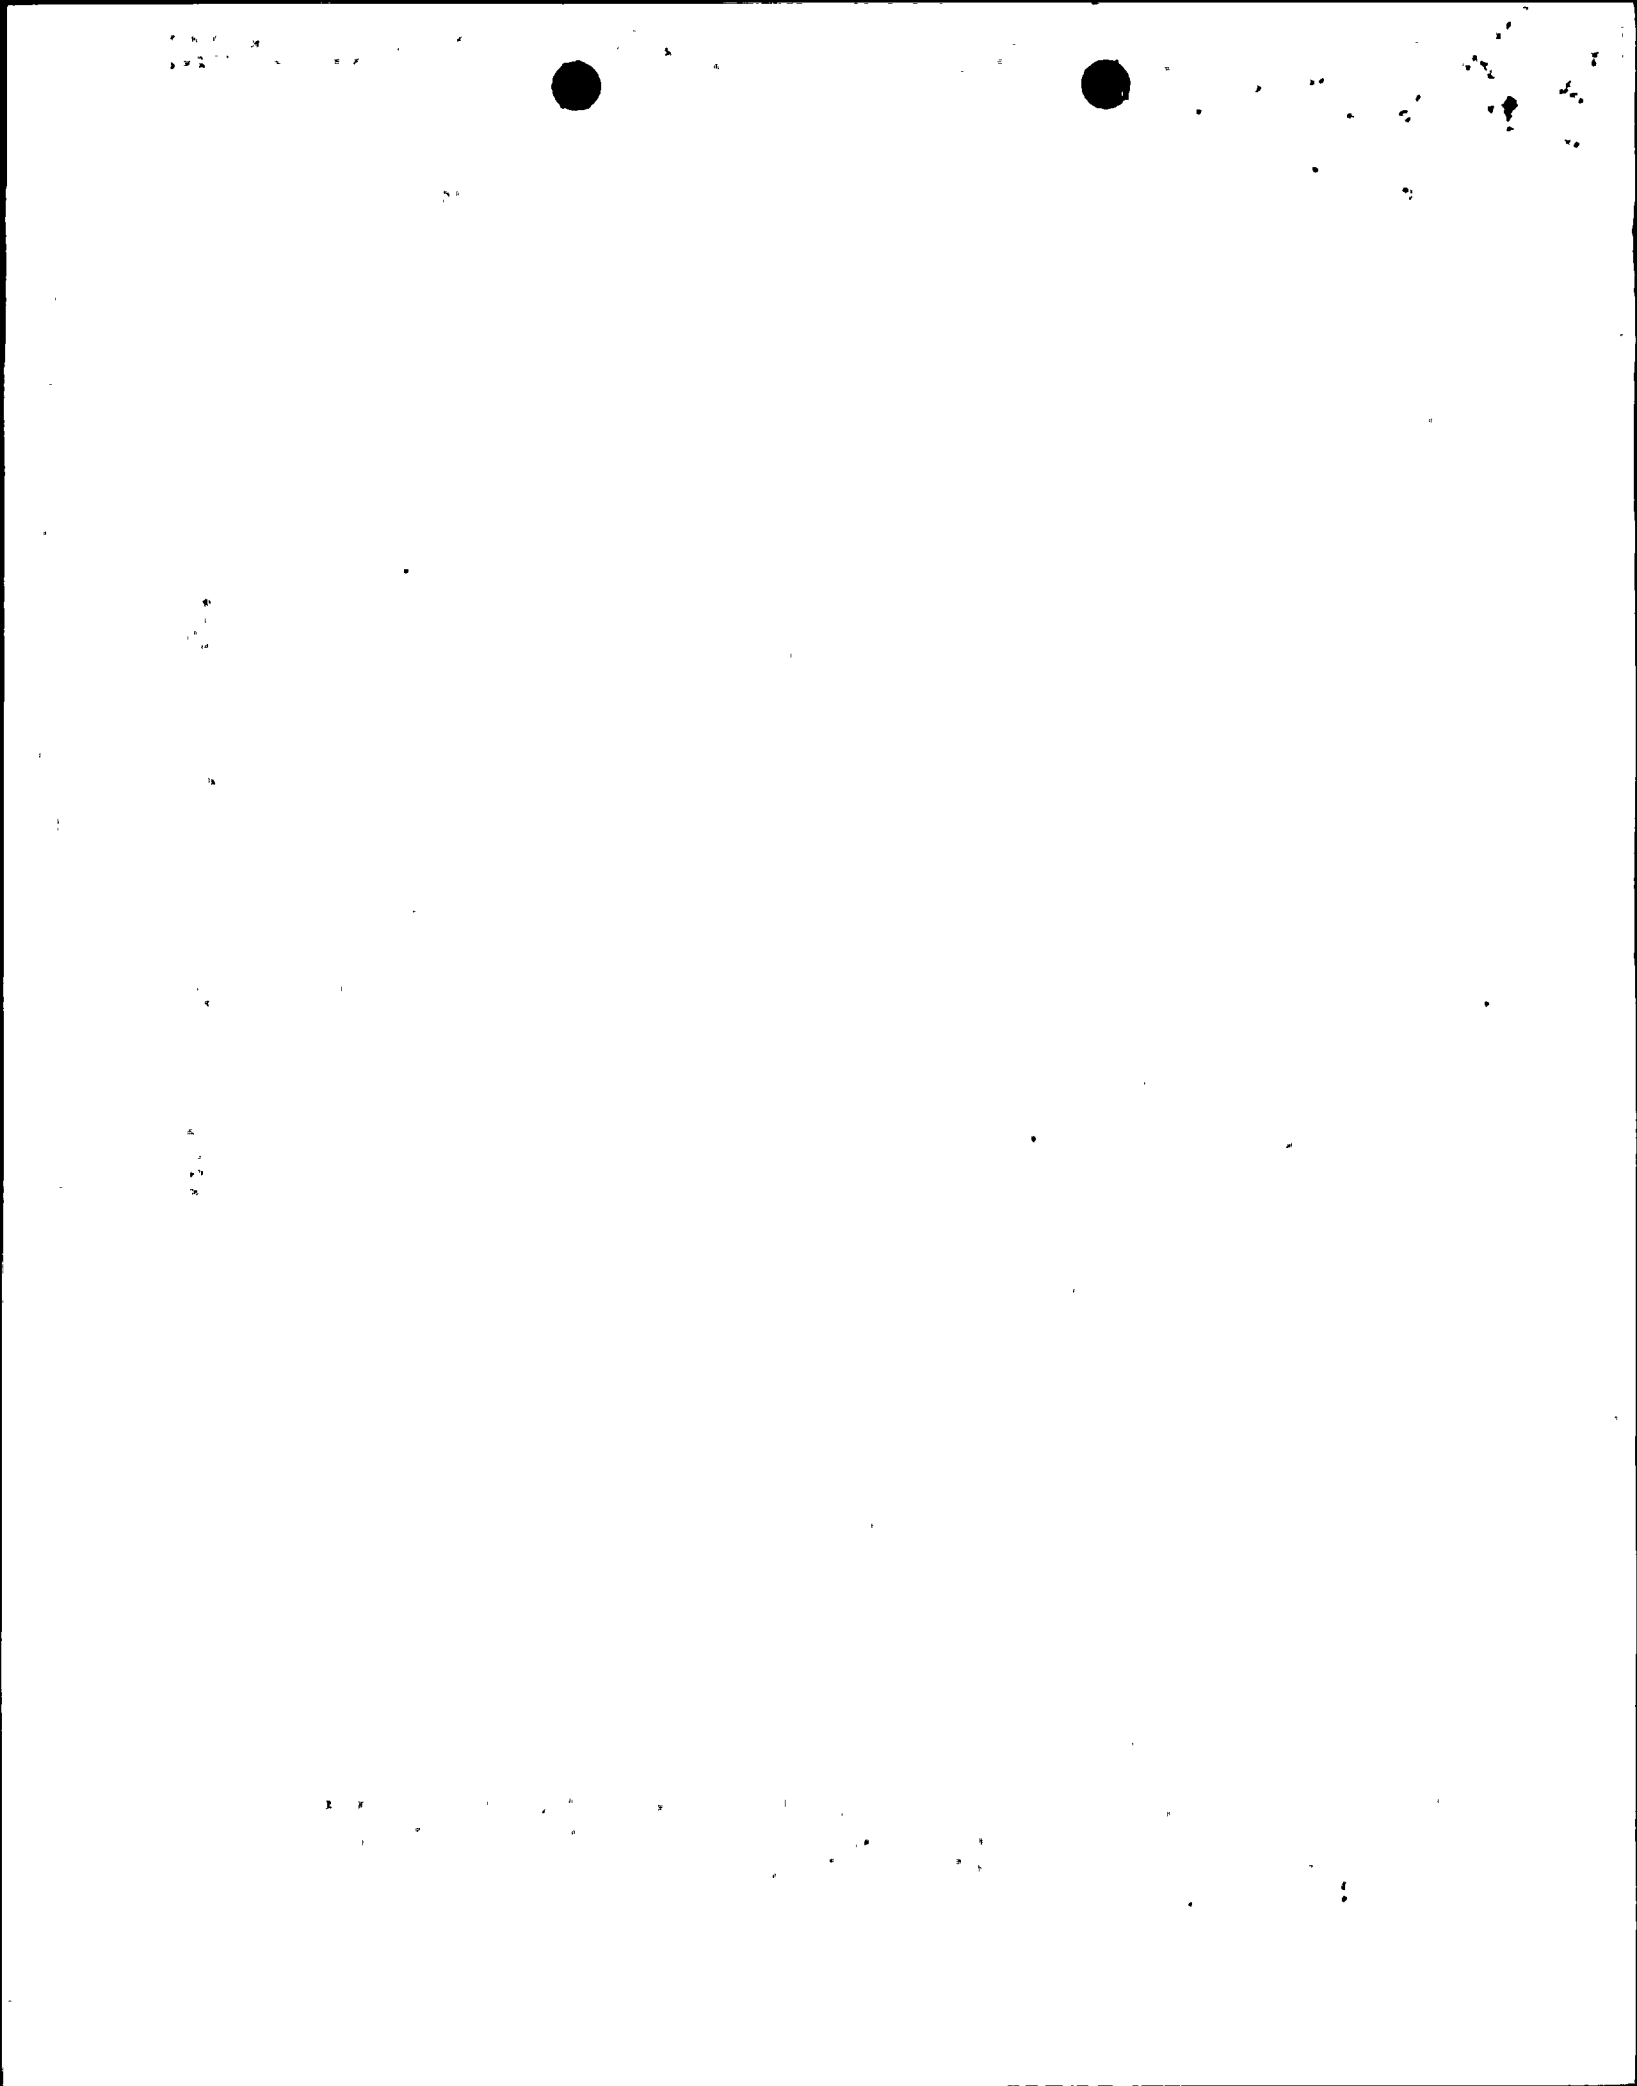



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 610/774-5151

Robert G. Byram
Senior Vice President—Nuclear
610/774-7502
Fax: 610/774-5019

JUN 06 1994

Director of Nuclear Reactor Regulation
Attention: Mr. C. L. Miller, Project Director
Project Directorate I-2
Division of Reactor Projects
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

SUSQUEHANNA STEAM ELECTRIC STATION
PROPOSED AMENDMENT NO. 166 TO LICENSE NPF-14 AND
PROPOSED AMENDMENT NO. 121 TO LICENSE NPF-22:
STANDBY LIQUID CONTROL Docket Nos. 50-387
PLA-4151 FILES R41-2/A17-2 and 50-388

Dear Mr. Miller:

The purpose of this letter is to propose changes to the Susquehanna SES Units 1 and 2 Technical Specifications. Currently, Susquehanna Technical Specification 3.1.5 requires having the Standby Liquid Control (SLC) System operable during OPERATIONAL CONDITION 5 with any control rod withdrawn (OPCON 5*). In addition, Susquehanna Technical Specification Surveillance Requirement 4.1.5.d.3 requires an operability check be performed on the Standby Liquid Control (SLC) System tank heaters every 18 months. The proposed Technical Specification change will delete the OPCON 5* operability and 18 month surveillance requirements for the SLC System.

The attached analysis discusses the safety basis for the proposed Technical Specification changes and concludes that the changes involve no significant hazards. These changes have been reviewed by the Plant Operations Review Committee (PORC) and the Susquehanna Review Committee (SRC) and have been approved by both committees. A similar Technical Specification change was approved for the Niagara Mohawk Power Corporation - Nine Mile Point.

Pennsylvania Power & Light is committed to making these changes to enhance resource utilization by eliminating unnecessary surveillance activity, increasing the available work window for SLC maintenance during outages, and eliminating the need for two Technical Specification Interpretations associated with SLC

130000
9406130264 940606
PDR ADDCK 05000387
P PDR


ADD1

Mr. C. L. Miller
FILES R41-2/A17-2
PLA-4151

operability. As a result of the proposed changes, Pennsylvania Power & Light expects to reduce SLC related costs in excess of the \$100,000 limit associated with the Cost Beneficial Licensing Action Program.

Any questions regarding this request should be directed to Mr. Terence Bannon at (610) 774-7918.

Very truly yours,

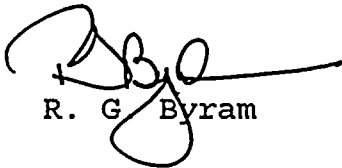

R. G. Byram

Attachment

cc: NRC Document Control Desk (original)
NRC Region I
Mr. G. S. Barber, NRC Sr. Resident Inspector - SSES
Mr. C. Poslusny, Jr., NRC Project Manager - Rockville
Mr. W. P. Dornsife, Pa DER