

PRIORITY 1
(ACCELERATED RIDS PROCESSING)

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9407150101 DOC.DATE: 94/07/11 NOTARIZED: NO DOCKET #
 FACIL:50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388
 AUTH.NAME AUTHOR AFFILIATION
 BYRAM,R.G. Pennsylvania Power & Light Co.
 RECIP.NAME RECIPIENT AFFILIATION
 MILLER,C.L. Project Directorate I-2

SUBJECT: Forwards revised Tables 7-4 & 7-5 to reactor vessel matl surveillance test rept for Unit 2.Tables include data for heat 659N315 inadvertently omitted from original tables.

DISTRIBUTION CODE: A008D COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 2+2
 TITLE: OR/Licensing Submittal: Reactor Vessel Matl Surveillance Rpt - App H,

NOTES:


	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PD1-2 PD	1 1	POSLUSNY,C	2 2
INTERNAL:	ACRS	6 6	NRR/DE/ECGB	1 1
	NRR/DE/EMCB	1 1	NRR/DSSA	1 1
	NRR/DSSA/SRXB	1 1	OC/LEDCB	1 0
	OGC/HDS2	1 0	REG FILE 01	1 1
	RES/DSIR/EIB	1 1	RES/MEB	1 1
EXTERNAL:	NRC PDR	1 1	NSIC	1 1
	ORNL KAM,F	1 1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 504-2083) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 21 ENCL 19

P
R
I
O
R
I
T
Y
1
D
O
C
U
M
E
N
T

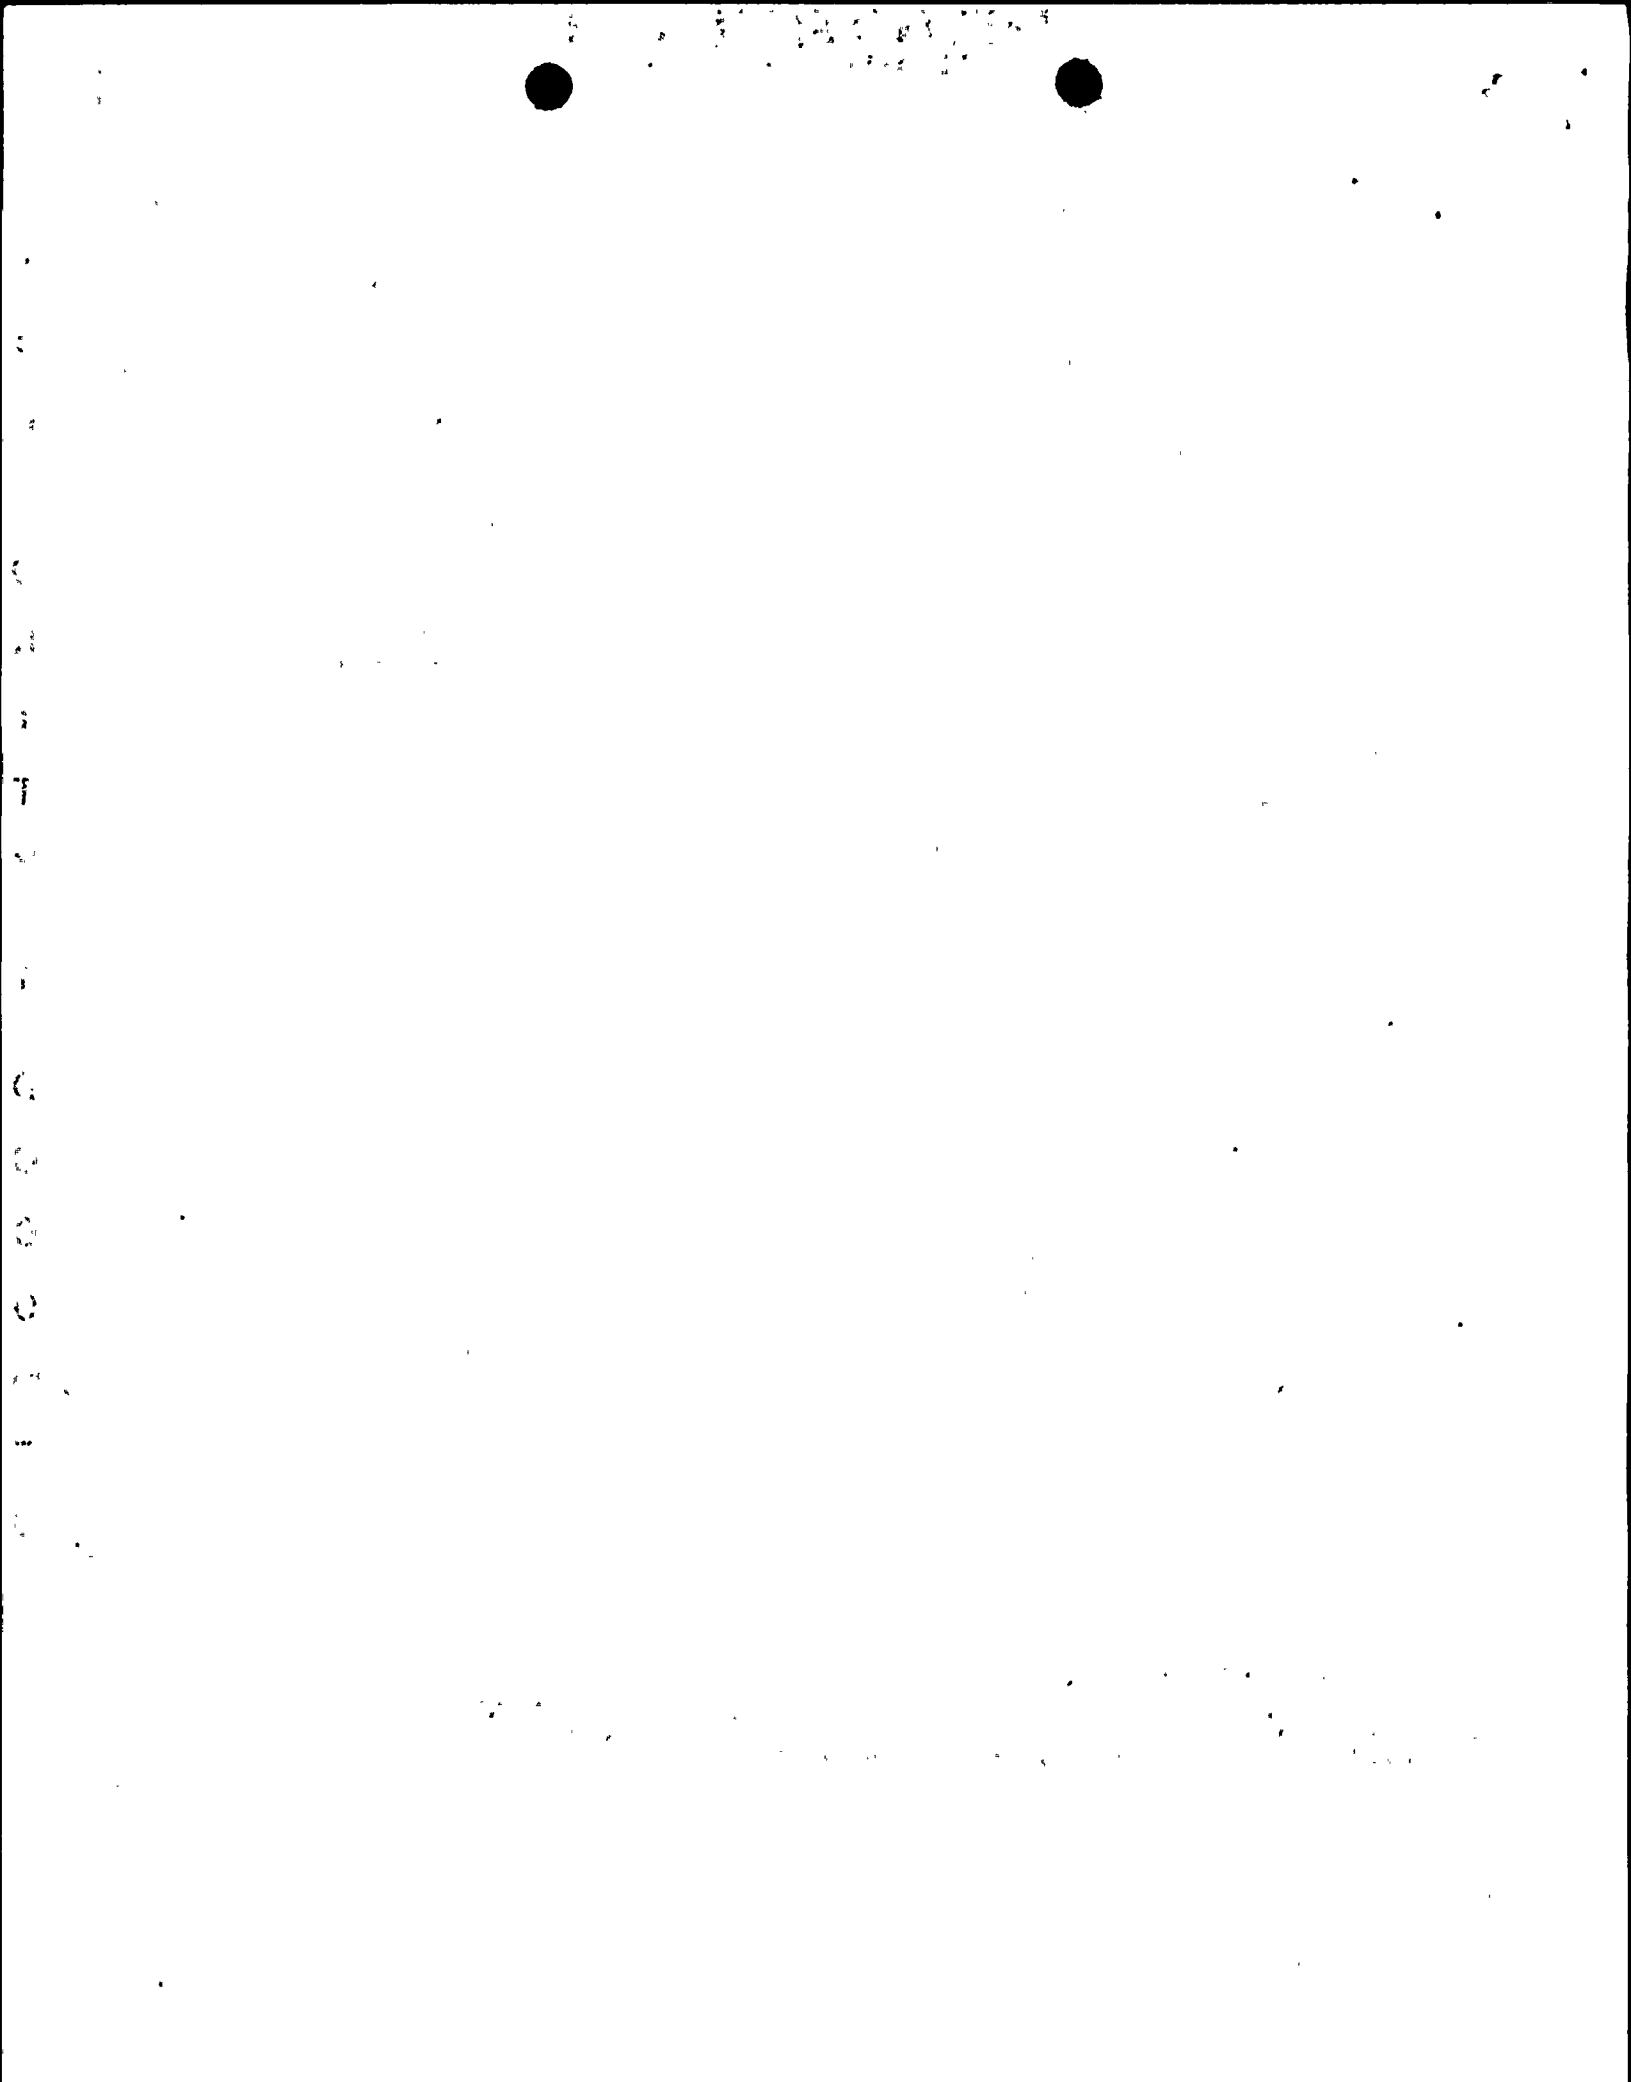



Pennsylvania Power & Light Company

Two North Ninth Street • Allentown, PA 18101-1179 • 610/774-5151

Robert G. Byram
Senior Vice President—Nuclear
610/774-7502
Fax: 610/774-5019

JUL 11 1994

Director of Nuclear Reactor Regulation
Attn.: Mr. C. L. Miller, Project Director
Project Directorate I-2
Division of Reactor Projects
U S. Nuclear Regulatory Commission
Washington, DC 20555

SUSQUEHANNA STEAM ELECTRIC STATION
REVISION TO REACTOR VESSEL MATERIAL
SURVEILLANCE TEST REPORT PER 10CFR50
APPENDIX H FOR UNIT 2
PLA-4169 FILE R41-2

Docket No. 50-388


Dear Mr. Miller:

Ref.: PLA-4026, R.G. Byram to C.L. Miller, "Submittal of Reactor Vessel Material Surveillance Test Report Per 10CFR50 Appendix H for Unit 2," dated September 28, 1993.

This letter serves to forward copies of two revised tables to be added to the subject report forwarded to NRC under cover of the referenced PLA-4026. The tables include data for heat 659N315 inadvertently omitted from the original tables. The new data do not change the conclusions of the referenced report, but must be included for completeness. Please remove the previously sent tables 7-4 and 7-5 and replace them with the attached versions.

Please call Mr. J.B. Wesner at (610) 774-7911, if you have any questions.

Very truly yours,

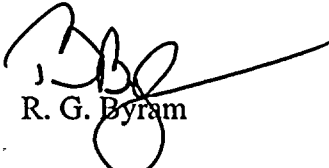
R. G. Byram

Attachments: Revised Tables 7-4 and 7-5 to
Reactor Vessel Material Surveillance Test Report for Unit 2

9407150101 940711
PDR ADOCK 05000388
PDR

ADD 1/1

APP 1 197

cc: ~~NRC Document Control Desk (original)~~
NRC Region I
Mr. G. S. Barber, NRC Sr. Resident Inspector - SSES
Mr. C. Poslusny, Jr., NRC Sr. Project Manager