

# CATEGORY 2

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9607180086 DOC. DATE: 96/07/10 NOTARIZED: NO DOCKET # 05000387  
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv 05000387  
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv 05000388  
 AUTH. NAME AUTHOR AFFILIATION  
 BYRAM, R.G. Pennsylvania Power & Light Co.  
 RECIPIENT NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)

SUBJECT: Withdraws pending request for deviation & exemption to certain requirements associated w/access authorization. C

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2 A  
 TITLE: OR Submittal: General Distribution T

NOTES: 05000387 E

	RECIPIENT		COPIES		RECIPIENT		COPIES		
	ID CODE/NAME		LTR	ENCL	ID CODE/NAME		LTR	ENCL	
	PDI-2 LA		1	1	PDI-2 PD		1	1	O
	POSLUSNY, C		1	1					R
INTERNAL:	ACRS		1	1	FILE CENTER 01		1	1	Y
	NRR/DE/EMCB		1	1	NRR/DRCH/HICB		1	1	
	NRR/DSSA/SPLB		1	1	NRR/DSSA/SRXB		1	1	
	NUDOCS-ABSTRACT		1	1	OGC/HDS2		1	0	2
EXTERNAL:	NOAC		1	1	NRC PDR		1	1	

NOTES: 1 1 D

SECOND DISTRIBUTION DUE  
 TO NEW RIDS CODE.

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM OWFN 5D-5 (EXT. 415-2083) TO ELIMINATE YOUR NAME FROM  
 DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 14 ENCL 13

C  
A  
T  
E  
N  
T  
E  
R  
N  
T  
O  
C  
U  
M  
E  
N  
T



1. 2. 3.

4. 5. 6. 7. 8. 9. 10.

11. 12. 13. 14. 15.



**Pennsylvania Power & Light Company**

Two North Ninth Street • Allentown, PA 18101-1179 • 610/774-5151

Robert G. Byram  
Senior Vice President-Nuclear  
610/774-7502  
Fax: 610/774-5019

JUL 10 1996

U.S. Nuclear Regulatory Commission  
Attn.: Document Control Desk  
Washington, D.C. 20555

**SUSQUEHANNA STEAM ELECTRIC STATION  
WITHDRAW OF DEVIATION AND EXEMPTION REQUESTS:  
ACCESS AUTHORIZATION REQUIREMENTS  
PLA-4476**

**FILES R41-1/A17-2**

Docket Nos. 50-387  
and 50-388

Reference: PLA-4406, Access Authorization Requirements, from R. G. Byram to NRC-DCD, January 17, 1996.

The purpose of this letter is to withdraw Pennsylvania Power & Light (PP&L) Company's pending request for a deviation and exemption to certain requirements associated with Access Authorization. Specifically, PP&L had requested a deviation from the guidance associated with 10 CFR 73.56 concerning personnel access authorization requirements, and an exemption to 10 CFR 73.57 concerning requirements for criminal history checks of individuals granted unescorted access.

PP&L believes that enhancements can be made to these regulations to provide greater flexibility and cost effectiveness in the processing of workers who are returning to a plant-site within an operating cycle. We believe cost effective changes can be made without decreasing the effectiveness of the overall Access Authorization process. However, discussions with NRC personnel indicate that a consensus on the requested changes can not be achieved in time to support the processing of workers for our upcoming refueling outages. As a result, PP&L is withdrawing the request made under the referenced submittal. We will continue to support the need for change to Access Authorization regulations by supporting ongoing work of the Nuclear Energy Institute in this same area. We encourage the NRC to work with the industry to enhance this area of regulation.

Any questions regarding this submittal should be directed to Mr. Terence Bannon at (610) 774-4019.

Very truly yours,

*R. G. Byram*  
R. G. Byram

*Jan*

*ACD 1/1*

180040

~~9607180088~~

*2pp*

copy: Regional Administrator - Region I  
Ms. M. Banerjee, NRC Sr. Resident Inspector  
Mr. C. Poslusny, Jr., NRC Sr. Project Manager  
Mr. W. P. Dornsife, Pa. DEP  
Mr. W. Rasin, NEI



100  
100  
100

100

100

# CATEGORY 1

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9607180088    DOC.DATE: 96/07/10    NOTARIZED: NO    DOCKET #  
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv    05000387  
       50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv    05000388  
 AUTH.NAME                    AUTHOR AFFILIATION  
 BYRAM, R.G.                  Pennsylvania Power & Light Co.  
 RECIPIENT NAME              RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Withdraws pending request for deviation & exemption to certain requirements associated w/access authorization.

DISTRIBUTION CODE: S003D    COPIES RECEIVED: LTR 1 ENCL 0    SIZE: 2  
 TITLE: Non-Proprietary Info Re Security Plans


NOTES: 05000387

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID	CODE/NAME	LTR	ENCL	ID	CODE/NAME	LTR	ENCL
	PD1-2	PD	1	0	POSLUSNY, C		1	0
INTERNAL:	ACRS		1	1	FILE CENTER	01	1	1
EXTERNAL:	NRC	PDR	1	1				
NOTES:			1	1				

NOTE TO ALL "RIDS" RECIPIENTS:  
 PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM OWFN 5D-5 (EXT. 415-2083) TO ELIMINATE YOUR NAME FROM  
 DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR    6    ENCL    0

C  
A  
T  
E  
G  
O  
R  
Y  
  
1  
  
D  
O  
C  
U  
M  
E  
N  
T

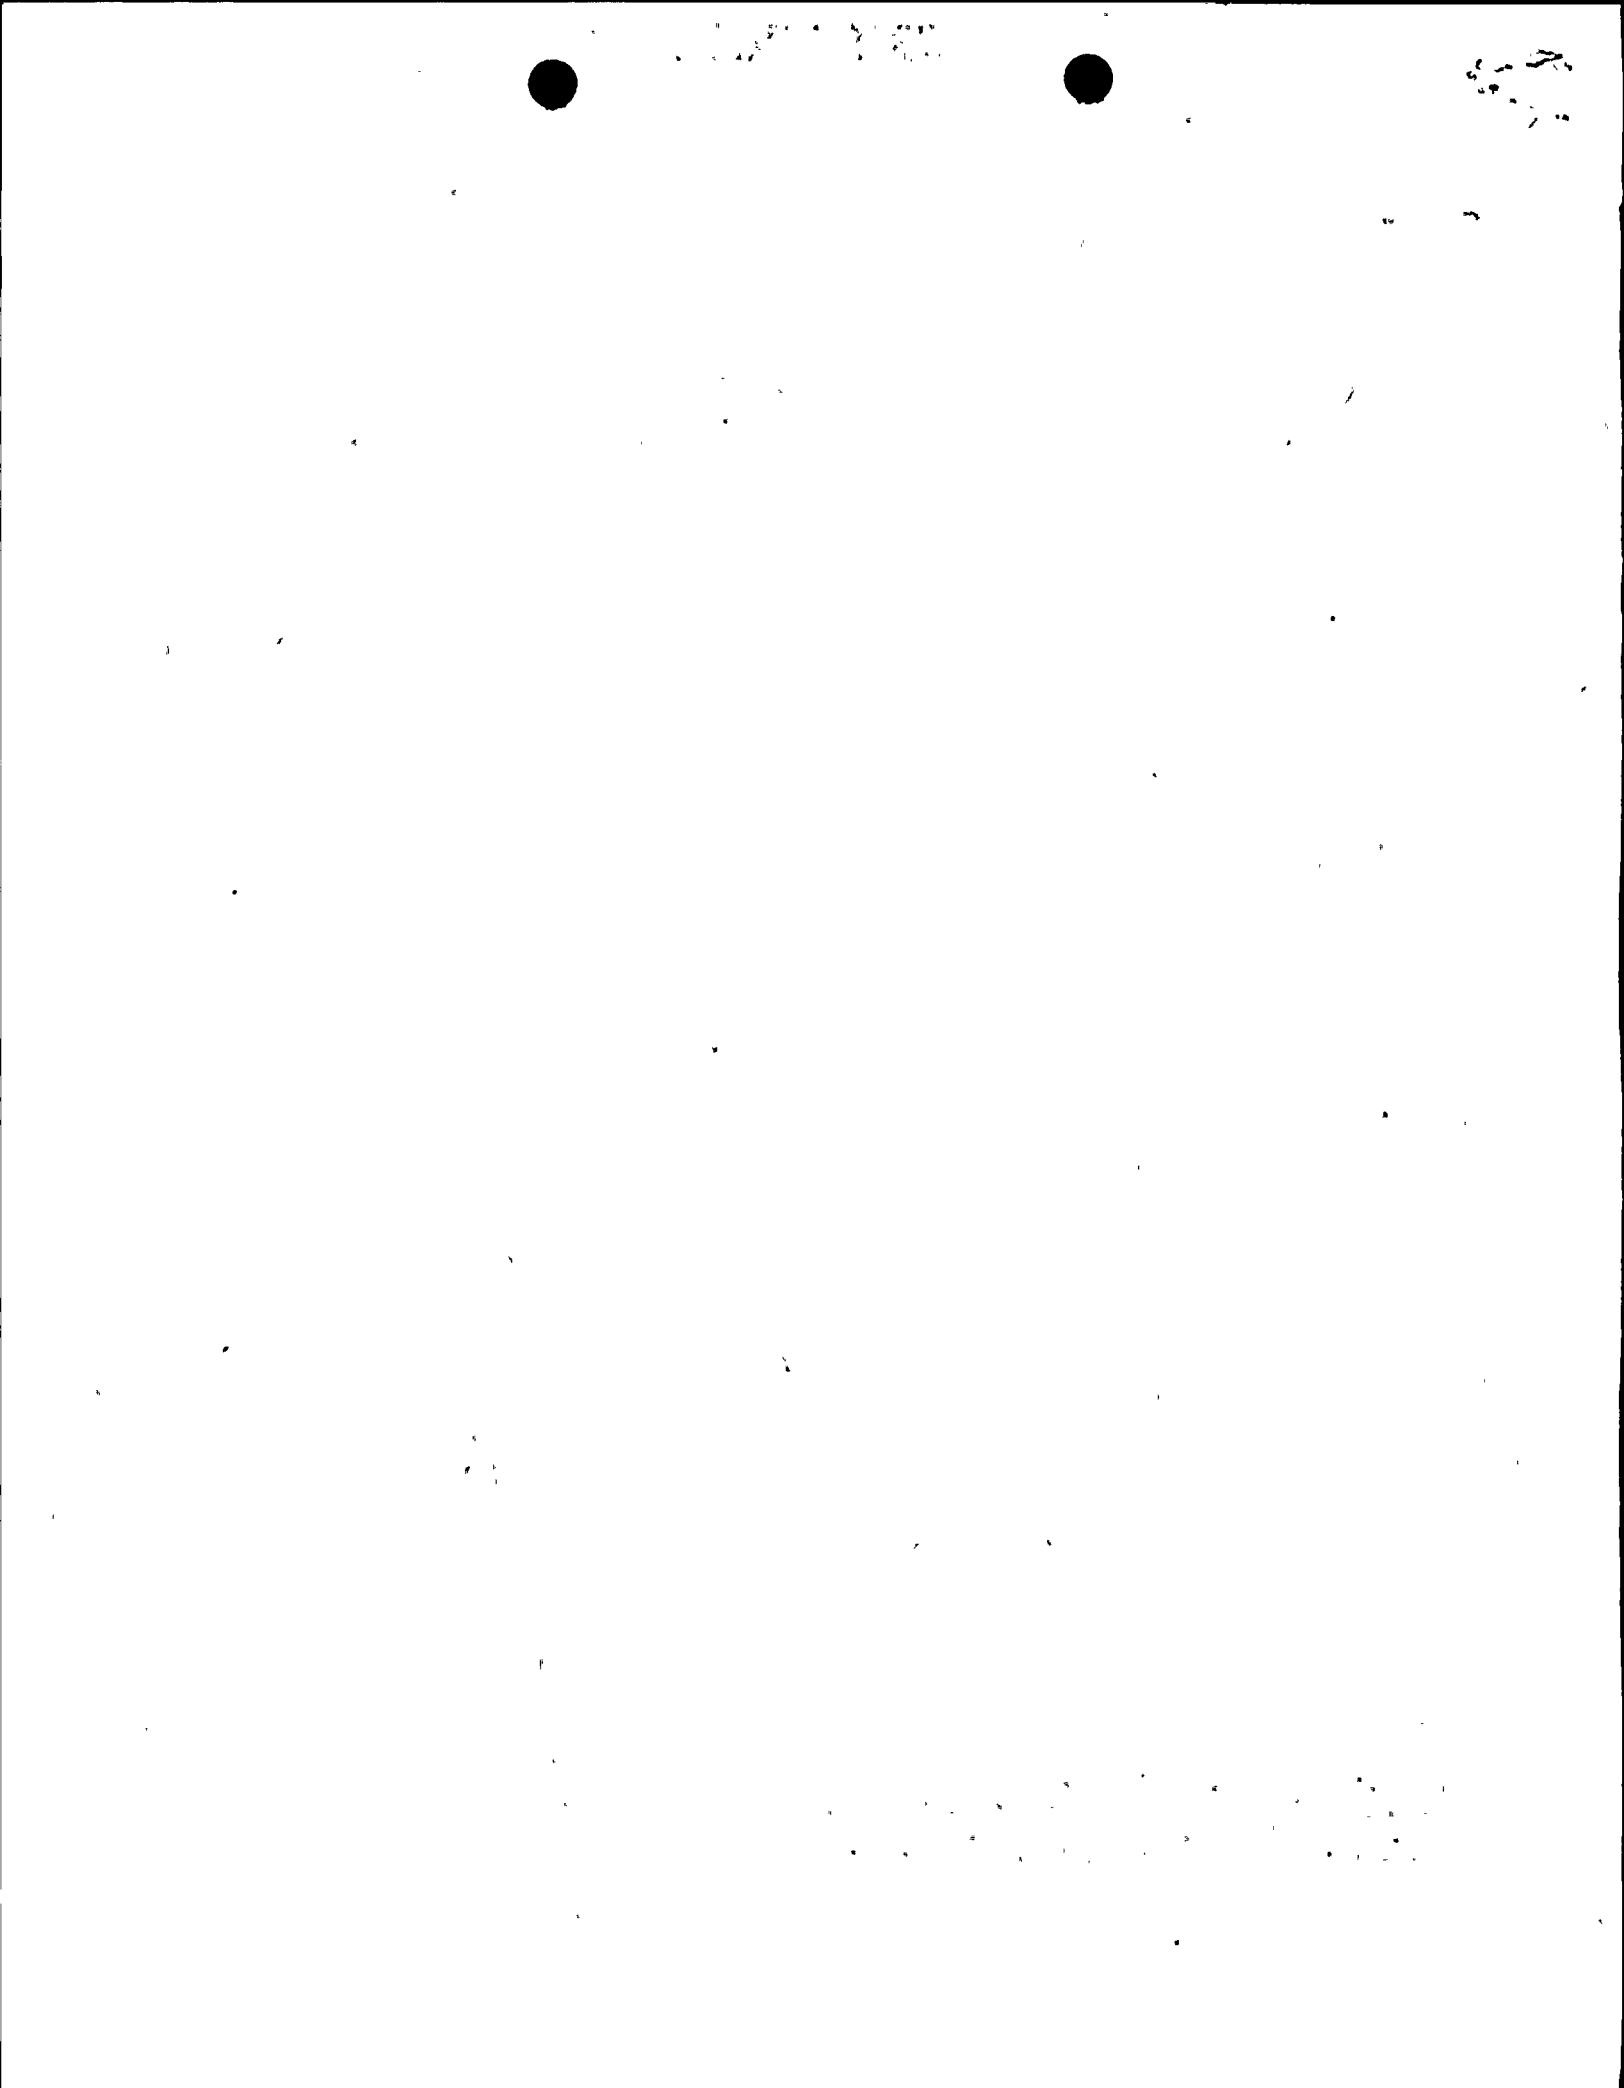



**Pennsylvania Power & Light Company**

Two North Ninth Street • Allentown, PA 18101-1179 • 610/774-5151

Robert G. Byram  
Senior Vice President-Nuclear  
610/774-7502  
Fax: 610/774-5019

JUL 10 1996

U.S. Nuclear Regulatory Commission  
Attn.: Document Control Desk  
Washington, D.C. 20555

Tac m94150  
m94151

**SUSQUEHANNA STEAM ELECTRIC STATION  
WITHDRAW OF DEVIATION AND EXEMPTION REQUESTS:  
ACCESS AUTHORIZATION REQUIREMENTS  
PLA-4476**

**FILES R41-1/A17-2**

Docket Nos. 50-387  
and 50-388


Reference: PLA-4406, Access Authorization Requirements, from R. G. Byram to NRC-DCD, January 17, 1996.

The purpose of this letter is to withdraw Pennsylvania Power & Light (PP&L) Company's pending request for a deviation and exemption to certain requirements associated with Access Authorization. Specifically, PP&L had requested a deviation from the guidance associated with 10 CFR 73.56 concerning personnel access authorization requirements, and an exemption to 10 CFR 73.57 concerning requirements for criminal history checks of individuals granted unescorted access.

PP&L believes that enhancements can be made to these regulations to provide greater flexibility and cost effectiveness in the processing of workers who are returning to a plant site within an operating cycle. We believe cost effective changes can be made without decreasing the effectiveness of the overall Access Authorization process. However, discussions with NRC personnel indicate that a consensus on the requested changes can not be achieved in time to support the processing of workers for our upcoming refueling outages. As a result, PP&L is withdrawing the request made under the referenced submittal. We will continue to support the need for change to Access Authorization regulations by supporting ongoing work of the Nuclear Energy Institute in this same area. We encourage the NRC to work with the industry to enhance this area of regulation.

Any questions regarding this submittal should be directed to Mr. Terence Bannon at (610) 774-4019.

Very truly yours,

  
R. G. Byram

9607180088 960710  
PDR ADOCK 05000387  
F PDR

S003  
1/0





copy: Regional Administrator - Region I  
Ms. M. Banerjee, NRC Sr. Resident Inspector  
Mr. C. Poslusny, Jr., NRC Sr. Project Manager  
Mr. W. P. Dornsife, Pa. DEP  
Mr. W. Rasin, NEI

