

# CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9704240074      DOC. DATE: 97/04/07      NOTARIZED: YES      DOCKET #  
 FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv      05000387  
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv      05000388  
 AUTH. NAME      AUTHOR AFFILIATION  
 BYRAM, R.G.      Pennsylvania Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Forwards amends 208 & 167 to licenses NPF-14 & NPF-22 re typo correction to single CR withdrawal in hot & cold shutdown.

DISTRIBUTION CODE: A001D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 2 + 4  
 TITLE: OR Submittal: General Distribution


NOTES: 05000387

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME	LTR	ENCL	ID CODE/NAME		LTR	ENCL		
	PD1-2 LA	1	1	PD1-2 PD	1	1			
	POSLUSNY, C	1	1						
INTERNAL:	ACRS	1	1	<u>FILE CENTER 01</u>	1	1			
	NRR/DE/ECGB/A	1	1	NRR/DE/EMCB	1	1			
	NRR/DRCH/HICB	1	1	NRR/DSSA/SPLB	1	1			
	NRR/DSSA/SRXB	1	1	NUDOCS-ABSTRACT	1	1			
	OGC/HDS2	1	0						
EXTERNAL:	NOAC	1	1	NRC PDR	1	1			
NOTES:		1	1						

C  
A  
T  
E  
G  
O  
R  
Y  
1  
D  
O  
C  
U  
M  
E  
N  
T

NOTE TO ALL "RIDS" RECIPIENTS:  
 PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 15 ENCL 14





**Pennsylvania Power & Light Company**

Two North Ninth Street • Allentown, PA 18101-1179 • 610/774-5151

Robert G. Byram  
Senior Vice President-Generation and  
Chief Nuclear Officer  
610/774-7502  
Fax: 610/774-5019

APR 07 1997

U.S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Mail Station P1-137  
Washington, DC 20555

**SUSQUEHANNA STEAM ELECTRIC STATION  
CORRECTION TO PROPOSED AMENDMENT  
NO. 208 TO LICENSE NO. NPF-14 AND  
PROPOSED AMENDMENT NO. 167 TO LICENSE  
NO. NPF-22: SINGLE CONTROL ROD  
WITHDRAWAL IN HOT SHUTDOWN AND  
COLD SHUTDOWN  
PLA-4598**

Docket Nos. 50-387  
and 50-388

**FILE R41-2**

Pennsylvania Power & Light Company is providing the following typographical correction to proposed Amendment No. 208 to License NPF-14 and proposed Amendment No. 167 to License No. NPF-22: Single Control Rod Withdrawal In Hot Shutdown And Cold Shutdown:

- Footnote + for Specification 3/4.10.8 for both proposed amendments should read:  
“+ Not required to be met if LCO requirements are being satisfied by 3.10.8.d.1”
- Footnote ++ for Specification 3/4.10.8 for both proposed amendments should read:  
“++ Not required to be met if LCO requirements are being satisfied by 3.10.8.b and 3.10.8.c”

During the preparation of the proposed amendments, the wrong specifications were inadvertently referenced in these footnotes. These changes do not change the technical content of the proposed amendments.

A mark-up of the corrected pages is attached.

A 001 1/1

9704240074 970407  
PDR ADOCK 05000387  
PDR


230123



Handwritten scribble or signature in the bottom left corner.

If you have any questions, please contact Mr. C. T. Coddington at (717) 542-3294.

Very truly yours,

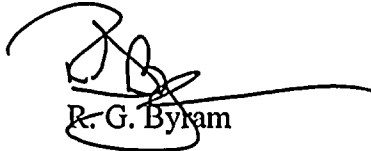

R. G. Byham

Attachment

copy: NRC Region I  
Mr. K. Jenison,  
Mr. C. Poslusny, Jr.  
Mr. W. P. Dornsife,

NRC Sr. Resident Inspector  
NRC Sr. Project Manager  
PA DEP