

# CATEGORY 1

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9708130159      DOC. DATE: 97/08/07      NOTARIZED: NO      DOCKET #  
FACIL: 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylvania      05000388  
AUTH. NAME      AUTHOR AFFILIATION  
BYRAM, R.G.      Pennsylvania Power & Light Co.      *see*  
RECIP. NAME      RECIPIENT AFFILIATION      *Reports*  
                                 Document Control Branch (Document Control Desk)

SUBJECT: Forwards "ISI Outage Summary Rept," for Unit 2 Eighth Refueling & Insp Outage, for NRC use.

DISTRIBUTION CODE: A047D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 1 + 450  
TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	PD1-2 LA		1	1	PD1-2 PD		1	1	
	POSLUSNY, C		1	1					
INTERNAL:	ACRS		1	1	AEOD/SPD/RAB		1	1	
	FILE CENTER 01		1	1	NRR/DE/EMEB		1	1	
	NUDOCS-ABSTRACT		1	1	OGC/HDS2		1	0	
	RES/DET/EIB		1	1	RES/DET/EMMEB		1	1	
EXTERNAL:	LITCO ANDERSON		1	1	NOAC		1	1	
	NRC PDR		1	1					


NOTE TO ALL "RIDS" RECIPIENTS:  
PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
ROOM OWFN 5D-5 (EXT. 415-2083) TO ELIMINATE YOUR NAME FROM  
DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 14 ENCL 13

C  
A  
T  
E  
G  
O  
R  
Y  
  
1  
  
D  
O  
C  
U  
M  
E  
N  
T



1

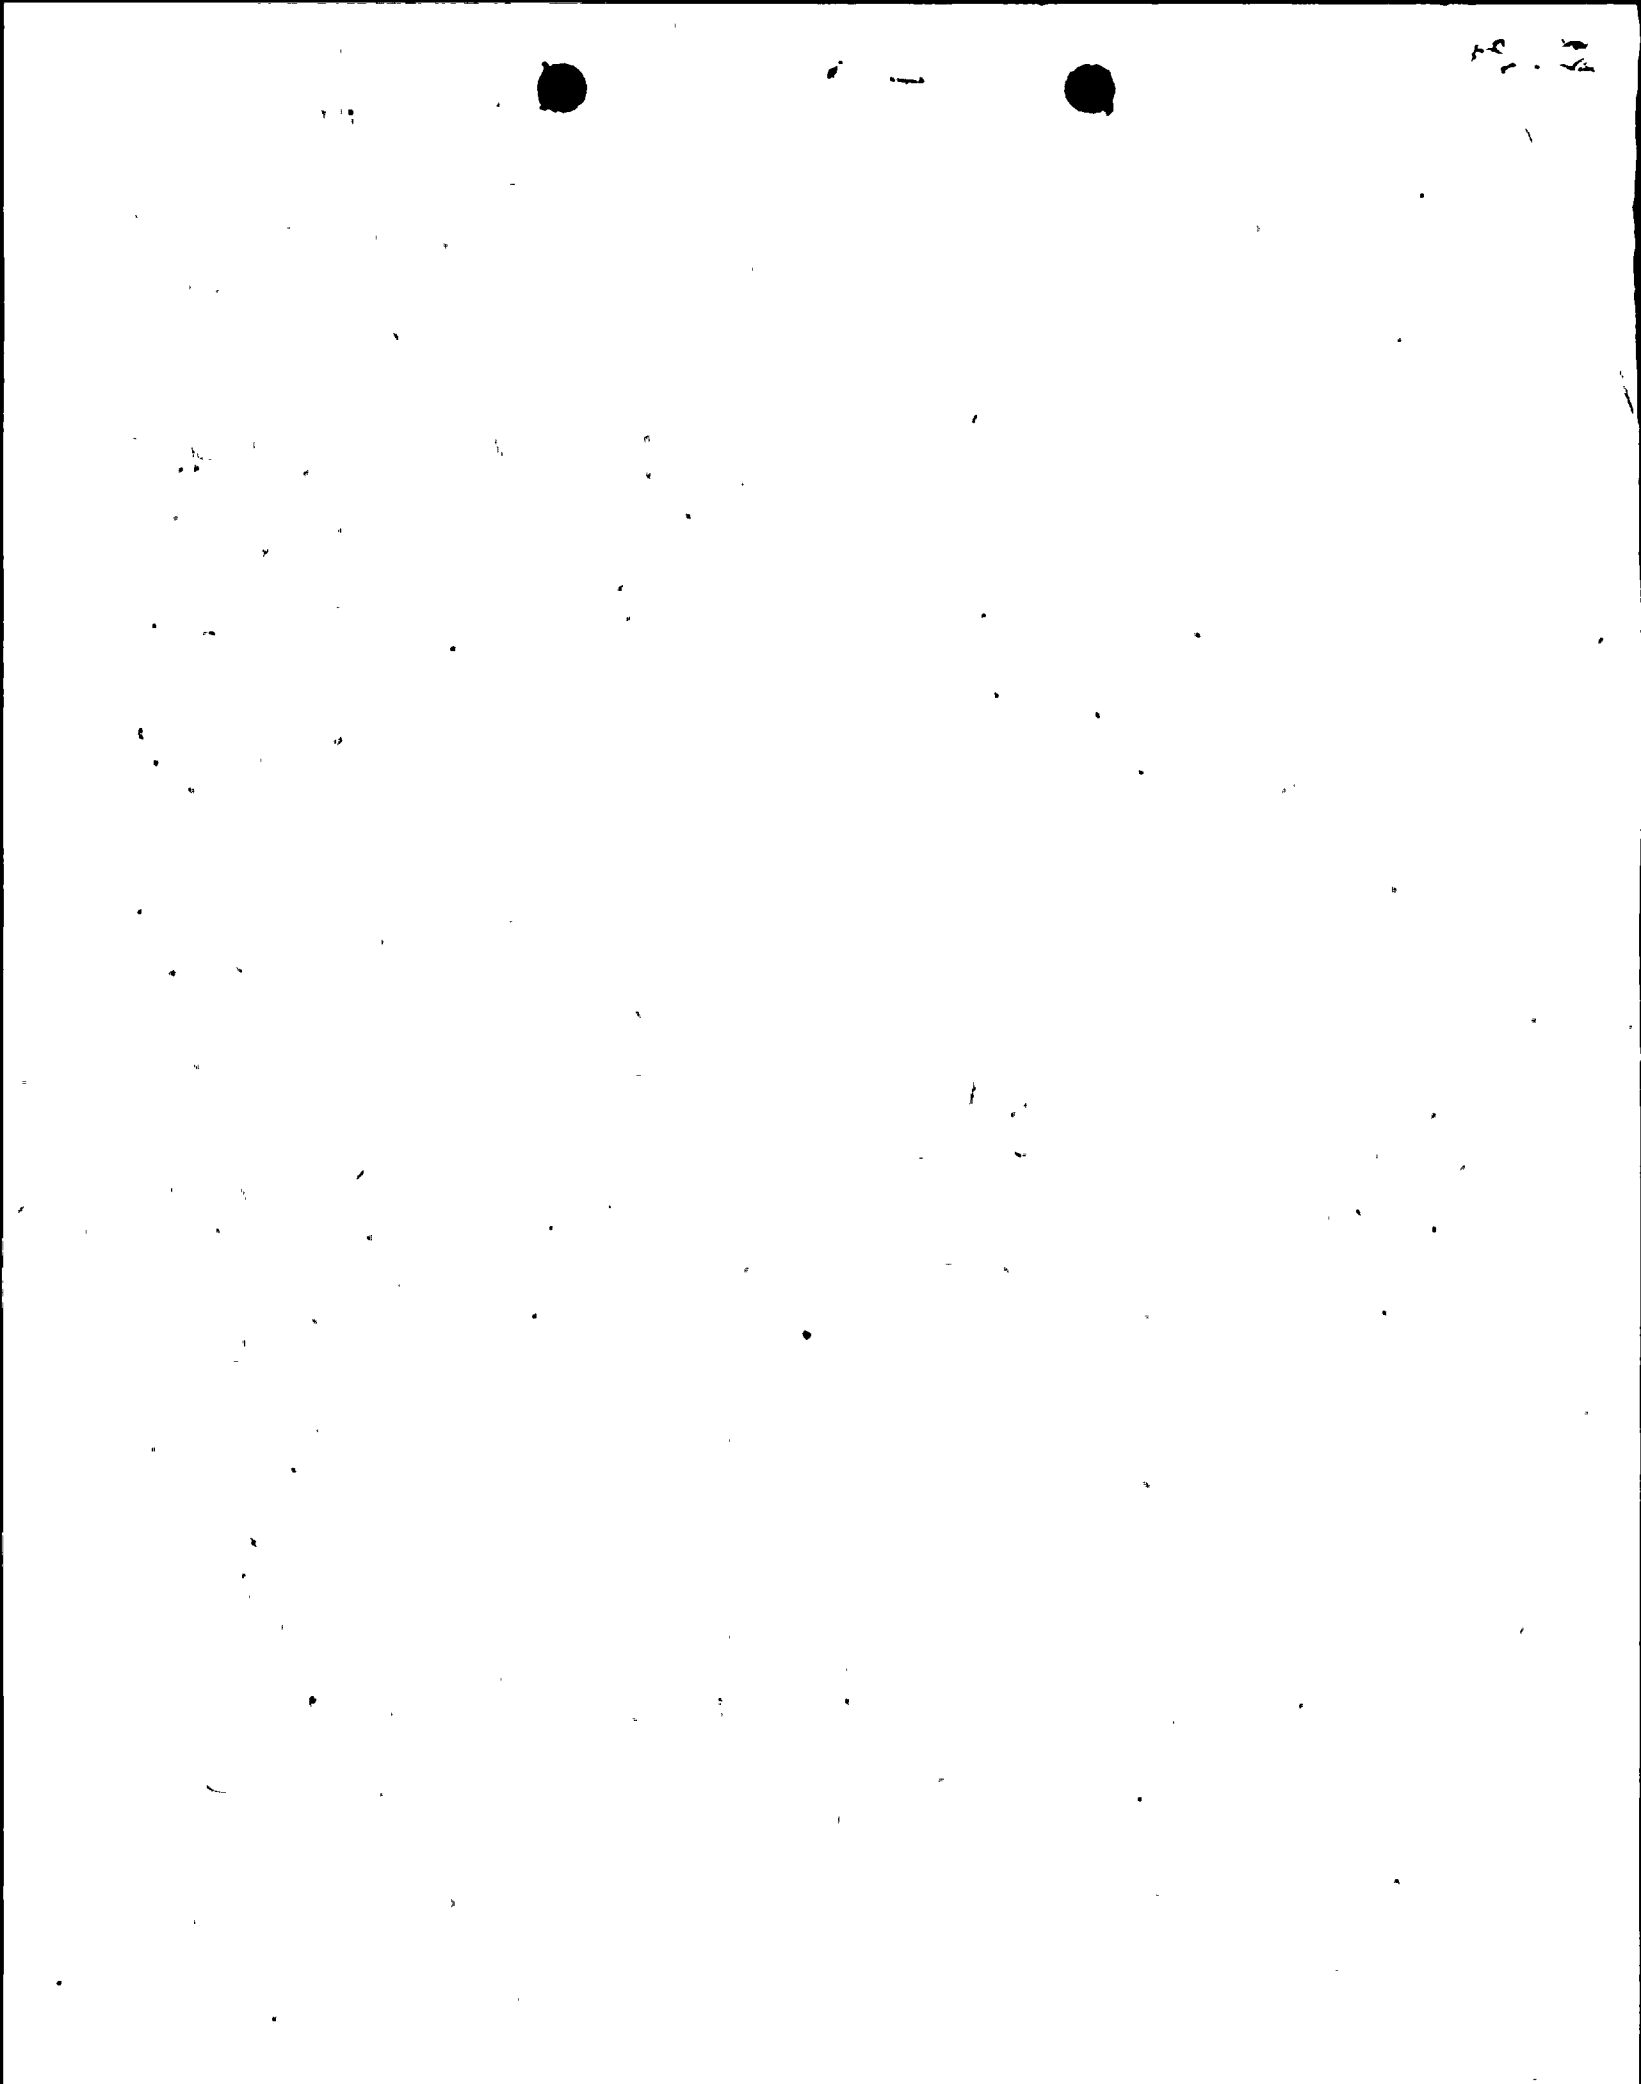



**Pennsylvania Power & Light Company**

Two North Ninth Street • Allentown, PA 18101-1179 • 610/774-5151

Robert G. Byram  
*Senior Vice President*  
*Generation and Chief Nuclear Officer*  
610/774-7502  
Fax: 610/774-5019

AUG 07 1997

U.S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Mail Station P1-137  
Washington, DC 20555

SUSQUEHANNA STEAM ELECTRIC STATION  
UNIT 2 EIGHTH REFUELING AND INSPECTION OUTAGE  
ISI SUMMARY REPORT  
PLA-4654 FILE R41-2

Docket No 50-388

Attached for your use is a copy of the Susquehanna Steam Electric Station Inservice Inspection Outage Summary Report for the Unit 2 Eighth Refueling and Inspection Outage. A copy of this report has also been sent to the Commonwealth of Pennsylvania.

If you have any questions, please contact C. T. Coddington at (717) 542-3294.

Very truly yours,

R. G. Byram

Attachment

1/1  
A077

cc: NRC Region I (w/o)  
Mr. K. Jenison, NRC Sr. Resident Inspector  
Mr. C. Poslusny, NRC Sr. Project Manager

9708130159 970807  
PDR ADDCK 05000388  
G PDR



120252



INSERVICE INSPECTION

# OUTAGE SUMMARY REPORT

Pennsylvania Power & Light Company  
Two North Ninth Street  
Allentown, PA 18101-1179

**COVER PAGE**

Susquehanna Steam Electric Station  
P.O. Box 467  
Berwick, PA 18603

**UNIT 2 - 8TH REFUEL OUTAGE**

COMPLETION DATE - AUGUST 8, 1997

COMMERCIAL SERVICE DATE - February 12, 1985

ORIGINAL  
BOOK 1 OF 1