

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9803170349 DOC. DATE: 98/03/06 NOTARIZED: NO DOCKET #
 FACIL: 50-387 Susquehanna Steam Electric Station; Unit 1, Pennsylva 05000387
 50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylva 05000388
 AUTH. NAME AUTHOR AFFILIATION
 BYRAM, R.G. Pennsylvania Power & Light Co.
 RECIPIENT NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Withdraws proposed amends 199 & 157 to licenses NPF-14 & NPF-22 re deletion of rod block monitor. Subsequent amends raise rod block monitor setpoints & eliminates need for amend.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: General Distribution


NOTES: 05000387

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	PD1-2 LA		1	1		PD1-2 PD		1	1
	NERSES, V		1	1					
INTERNAL:	ACRS		1	1		<u>FILE CENTER</u> 01		1	1
	NRR/DE/ECGB/A		1	1		NRR/DE/EMCB		1	1
	NRR/DRCH/HICB		1	1		NRR/DSSA/SPLB		1	1
	NRR/DSSA/SRXB		1	1		NUDOCS-ABSTRACT		1	1
	OGC/HDS2		1	0					
EXTERNAL:	NOAC		1	1		NRC PDR		1	1
NOTES:			1	1					

NOTE TO ALL "RIDS" RECIPIENTS:
 PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 15 ENCL 0

C
A
T
E
G
O
R
Y
1
D
O
C
U
M
E
N
T

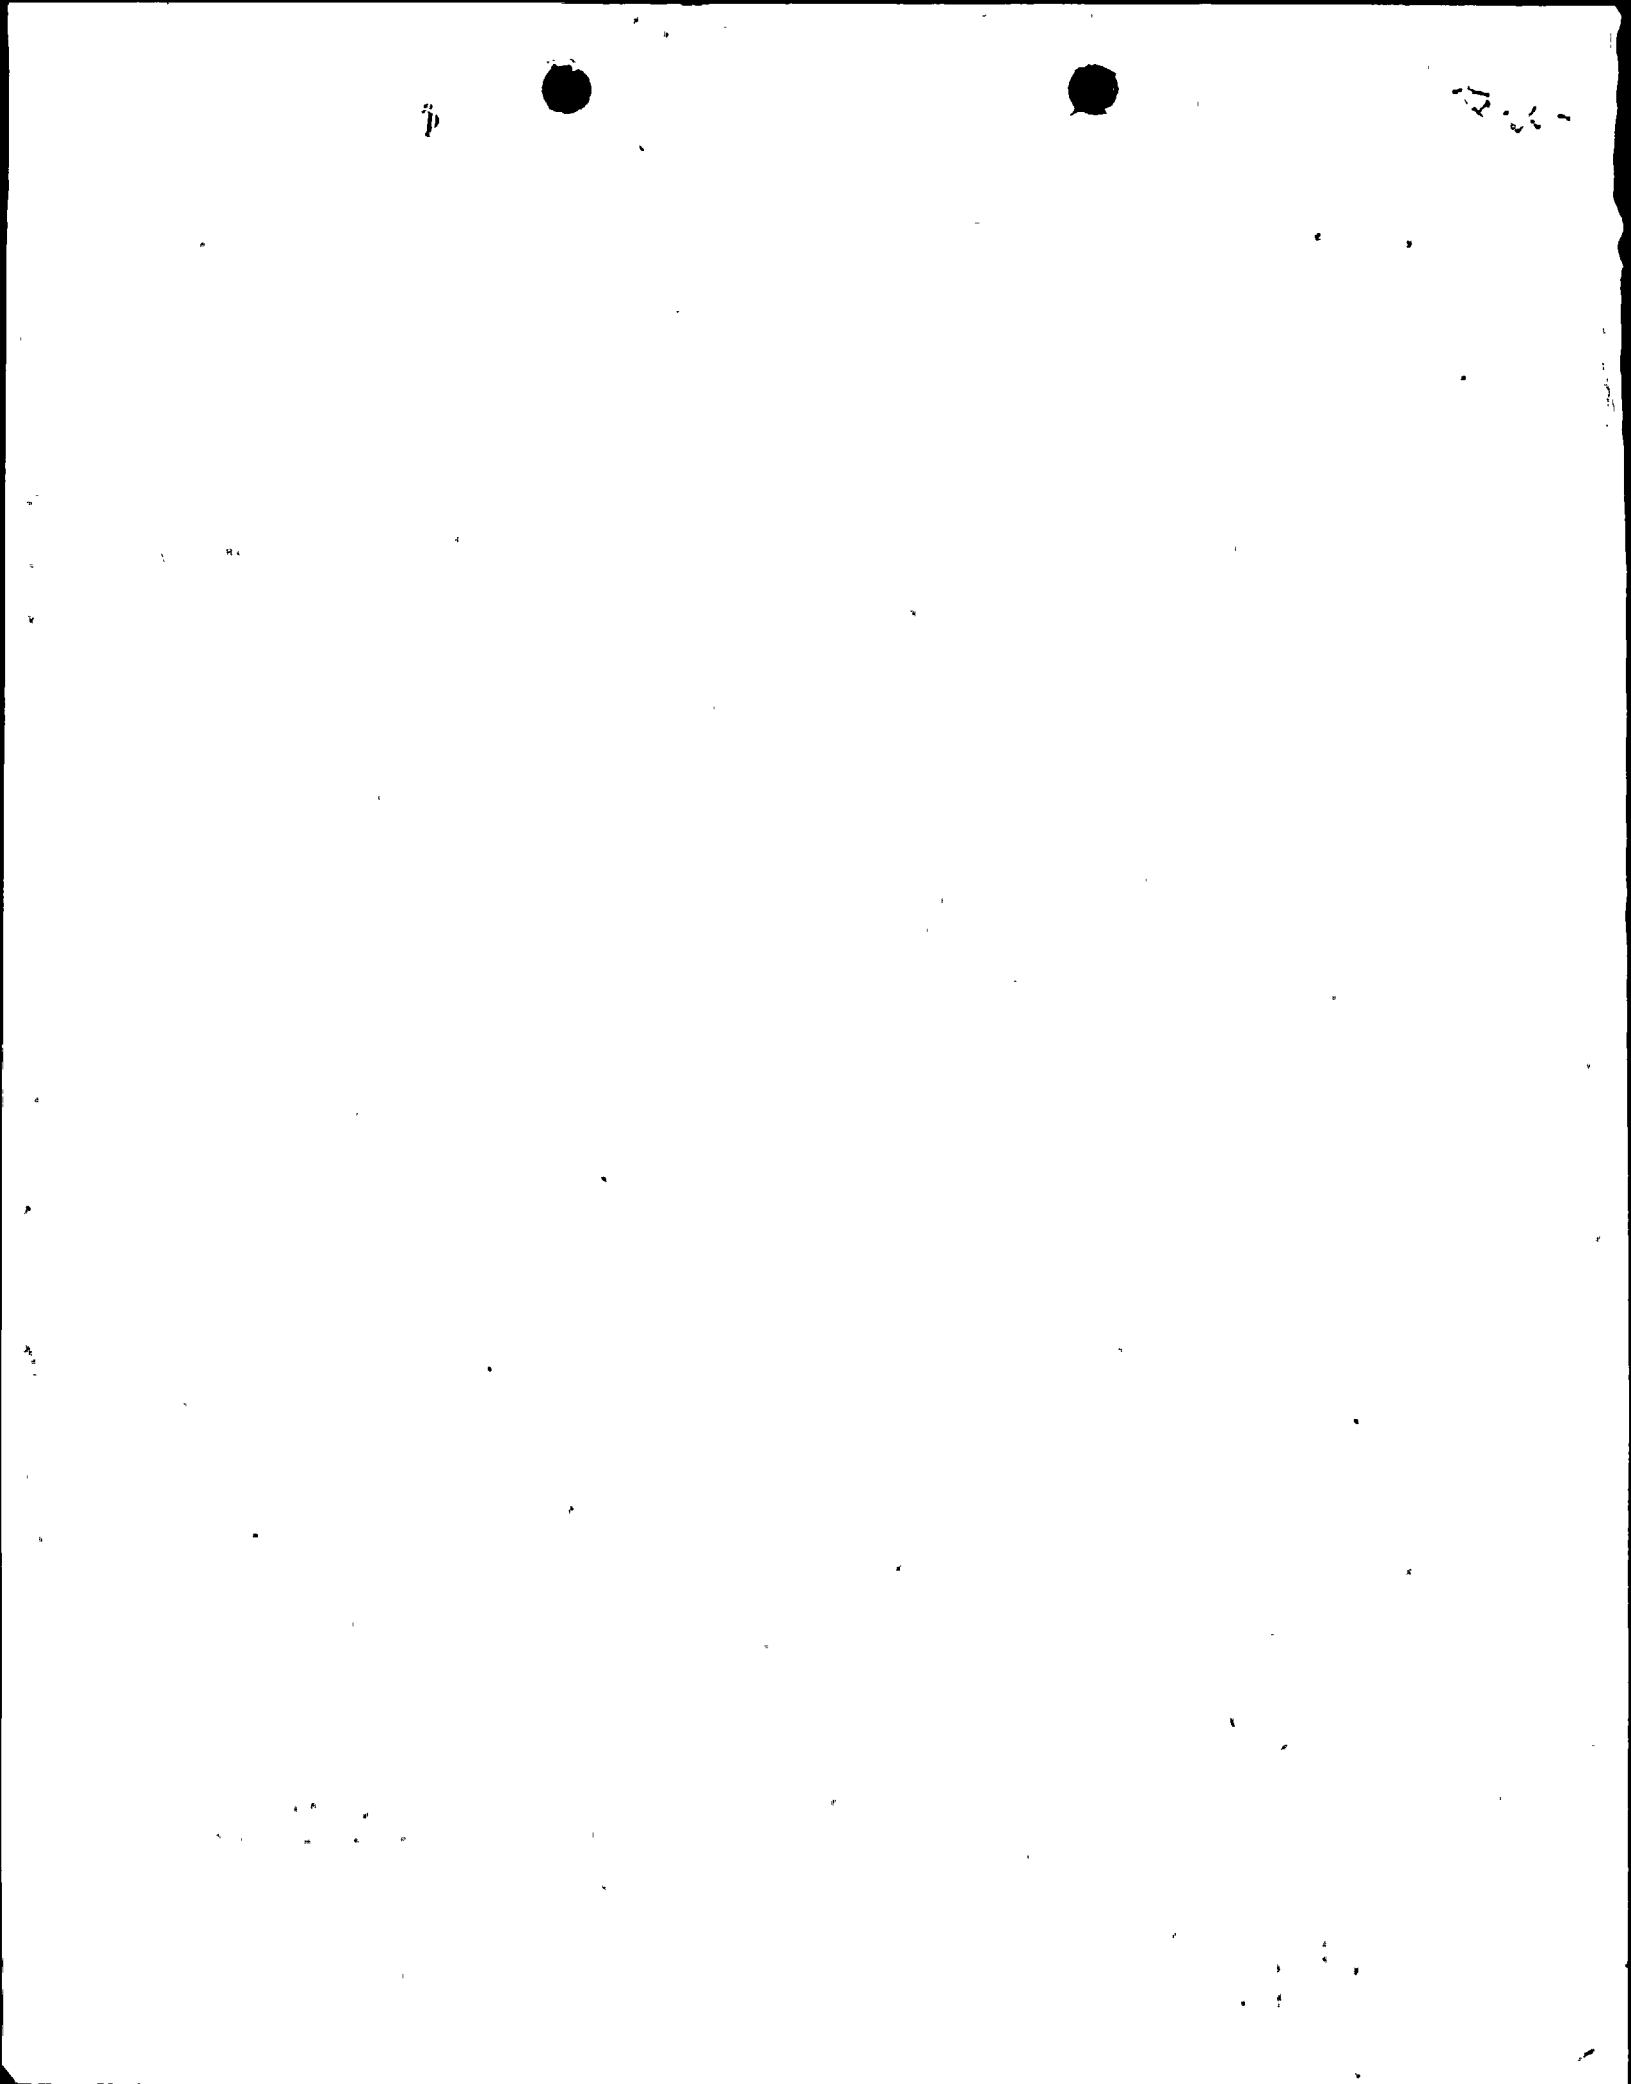

Robert G. Byram
Senior Vice President
Generation and Chief Nuclear Officer
Tel. 610.774.7502 Fax 610.774.5019
E-mail: rgbyram@papl.com

PP&L, Inc.
Two North Ninth Street
Allentown, PA 18101-1179
Tel. 610.774.5151
http://www.papl.com/



MAR 06 1998

U. S. Nuclear Regulatory Commission
Attn.: Document Control Desk
Mail Station PI-137
Washington, D. C. 20555

**SUSQUEHANNA STEAM ELECTRIC STATION
WITHDRAWAL OF PROPOSED LICENSE AMENDMENT
NO. 199 TO LICENSE NO. NPF-14 AND
NO. 157 TO LICENSE NO. NPF-22:
REMOVAL OF ROD BLOCK MONITOR
FROM TECHNICAL SPECIFICATIONS
PLA-4629**

**Docket Nos. 50-387
and 50-388**


FILES A17-2/R41-2

- References: 1) PLA-4426, "Proposed Amendment No. 199 to License No. NPF-14 and No. 157 to License No. NPF-22: Removal of the Rod Block Monitoring System From Technical Specifications," February 29, 1996.
- 2) PLA-4528, "Proposed Amendment No. 207 to License NPF-14 and No. 165 to License NPF-22: Changes to Rod Block Monitor (RBM) Setpoints and Channel Calibration Frequency," November 27, 1996.
- 3) PLA-4561, "Revision to Proposed Amendment No. 207 to License NPF-14 and No. 165 to License NPF-22: Changes to Rod Block Monitor (RBM) Setpoints and Channel Calibration Frequency," February 12, 1997.

The purpose of this letter is to withdraw PP&L, Inc.'s (PP&L) pending request (Reference 1) for a license amendment associated with the deletion of the Rod Block Monitor. PP&L has proposed a subsequent amendment (References 2 and 3) which raises the Rod Block Monitor setpoints and eliminates the need for the Reference 1 proposed amendment. As a result, PP&L no longer requires a separate submittal concerning the deletion of the Rod Block Monitor.

Any questions regarding this request should be directed to Mr. A. J. Roscioli at (610) 774-4019.

Sincerely,

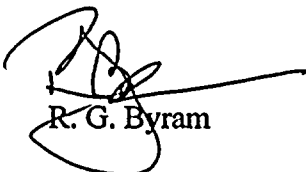
R. G. Byram

copy: NRC Region I
Mr. V. Nerses, NRC Sr. Project Manager - OWFN
Mr. K. M. Jenison, NRC Sr. Resident Inspector - SSES
Mr. K. Kerns, PA DEP

9803170349 980306
PDR ADOCK 05000387
P PDR



ADDI/O

