

# CATEGORY 1

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9808240199      DOC. DATE: 98/08/18      NOTARIZED: NO      DOCKET #  
FACIL: 50-387 Susquehanna Steam Electric Station, Unit 1, Pennsylv      05000387  
50-388 Susquehanna Steam Electric Station, Unit 2, Pennsylv      05000388  
AUTH. NAME      AUTHOR AFFILIATION  
BYRAM, R.G.      Pennsylvania Power & Light Co.  
RECIP. NAME      RECIPIENT AFFILIATION  
Records Management Branch (Document Control Desk)

SUBJECT: Forwards semi-annual fitness-for-duty performance data rept      C  
for period covering 980101-0630, per 10CFR26.71(d).      A

DISTRIBUTION CODE: A021D      COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3  
TITLE: "Semiannual Fitness for Duty Program Performance Rept/Data" 10CFR26.71

NOTES:      05000387E

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	
	PD1-2 PD	1 1	NERSES, V.	1 1	G
INTERNAL:	ACRS	1 1	<del>FILE CENTER 01</del>	1 1	O
	NRR/DRCH/HOHB	1 1	NRR/DRPM/PSGB	1 1	R
	NUDOCS-ABSTRACT	1 1	RGN1	1 1	Y
EXTERNAL:	NOAC	1 1	NRC PDR	1 1	1
NOTES:		1 1			


NOTE TO ALL "RIDS" RECIPIENTS:  
PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS  
OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL  
DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 11 ENCL 11

C  
A  
E  
G  
O  
R  
Y  
1  
D  
O  
C  
U  
M  
E  
N  
T

Robert G. Byram  
Senior Vice President  
Generation and Chief Nuclear Officer  
Tel. 610.774.7502 Fax 610.774.5019  
E-mail: rgbyram@papl.com

PP&L, Inc.  
Two North Ninth Street  
Allentown, PA 18101-1179  
Tel. 610.774.5151  
<http://www.papl.com/>



AUG 18 1998

Submitted pursuant  
to 10CFR26.71(d)


U.S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Mail Station P1-137  
Washington, DC 20555

**SUSQUEHANNA STEAM ELECTRIC STATION  
SEMI-ANNUAL PART 26 PERFORMANCE DATA REPORT  
FOR JANUARY 1 TO JUNE 30, 1998**  
PLA-4966 FILE R41-2

Docket Nos. 50-387  
and 50-388

Attached is PP&L's semi-annual Fitness-For-Duty performance report covering the period of January 1, 1998 through June 30, 1998. This report consolidates corporate and station data for Susquehanna SES, Units 1 and 2.

Sincerely,

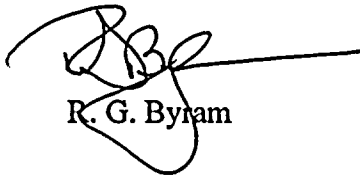


R. G. Byram

Attachment

copy: NRC Region I  
Mr. K. Jenison, NRC Sr. Resident Inspector  
Mr. V. Nerses, NRC Sr. Project Manager

*Handwritten:* A021/1

9808240199 980818  
PDR ADOCK 05000387  
R PDR



**Fitness For Duty Program  
Performance Data  
Personnel Subject to 10CFR26**

<b>Pennsylvania Power &amp; Light Company</b>	<b>June 30, 1998</b>
Company	6 Months Ending
<b>Susquehanna Steam Electric Station</b>	
Location	
<b>Lisa M. Yupco, Site Access Services Supervisor</b>	<b>(717) 542-3201</b>
Contact	Phone (Include Area Code)
Cutoffs: Screen/Confirmation (ng/ml) <input type="checkbox"/> Appendix A to 10CFR 26	
Marijuana      50    /    10	Amphetamines      300    /    100
Cocaine        300    /    50	Phencyclidine      25     /    10
Opiates        300    /    100	Alcohol (%BAC)    0.04%

Testing Results		Licensee Employees		Long-Term Contractor Personnel		Short-Term Contractor Personnel	
		1610		N/A		455	
Average Number with Unescorted Access							
Categories		# Tested	# Positive NRC/PPL	# Tested	# Positive	# Tested	# Positive NRC/PPL
Pre-Access		382	0	N/A	N/A	704	4
For Cause	Post Accident	0	0	N/A	N/A	0	0
	Observed Behavior	0	0	N/A	N/A	1	1
Random		495	2	N/A	N/A	227	0
Follow-up		5	0	N/A	N/A	0	0
Other		0	0	N/A	N/A	10	0
<b>Total</b>		<b>877</b>	<b>2</b>	<b>N/A</b>	<b>N/A</b>	<b>942</b>	<b>5</b>

### Breakdown of Confirmed positive Tests for Specific Substances

	Marijuana	Cocaine	Opiates	Amphetamines	Phencyclidine	Alcohol	Refusal To Test
<b>Licensee Employees</b>	1	0	0	1	0	0	0
<b>Long-Term Contractors</b>	-	-	-	-	-	-	-
<b>Short-Term Contractors</b>	1	0	0	0	0	3	1
<b>Total</b>	2	0	0	1	0	3	1

