

**ATTACHMENT B**  
**PROPOSED CHANGES TO APPENDIX A**  
**TECHNICAL SPECIFICATIONS**

Revised Pages

- DPR-19 and DPR-25 (Dresden Units 2 and 3)
  - Page B3/4.6-26
  
- DPR-29 (Quad Cities Unit 1)
  - Page 3.6/4.6-16
  - Page 3.6/4.6-17
  
- DPR-30 (Quad Cities Unit 2)
  - Page 3.6/4.6-8
  - Page 3.6/4.6-9

9107310254 910726  
PDR ADDCK 05000237  
P PDR

3.6 LIMITING CONDITION FOR OPERATION BASES (Cont'd.)

INSERT  
1

B. Pressurization Temperature - The reactor coolant system is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, restrictions have been placed on the operating conditions to which it can be subjected. These restrictions on inservice hydrostatic testing, on heatup and cooldown, and on critical core operation shown in Figure 3.6.1, were established to be in conformance with Appendix G to 10 CFR 50.

In evaluating the adequacy of ferritic steels Sa302B it is necessary that the following be established:

- a) The reference nil-ductility temperature ( $RT_{NDT}$ ) for all vessel and adjoining materials,
- b) the relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies greater than one Mev), and
- c) the fluence at the location of a postulated flow.

The initial  $RT_{NDT}$  of the main closure flange, the shell and head materials connecting to these flanges, and connecting welds is 10°F. However, the vertical electroslag welds which terminate immediately below the vessel flange have an  $RT_{NDT}$  of 40°F. (Reference Appendix F to the FSAR) The closure flanges and connecting shell materials are not subject to any appreciable neutron radiation exposure, nor are the vertical electroslag seams. The flange area is moderately stressed by tensioning the head bolts. Therefore, as is indicated in curves (a) and (b) of Figure 3.6.1, the minimum temperature of the vessel shell immediately below the vessel flange is established as 100°F below a pressure of 400 psig. (40°F + 60°F, where 40°F is the  $RT_{NDT}$  of the electroslag weld and 60°F is a conservatism required by the ASME Code). Above approximately 400 psig pressure, the stresses associated with pressurization are more limiting than the bolting stresses, a fact that is reflected in the non-linear portion of curves (a) and (b). Curve (c), which defines the temperature limitations for critical core operation, was established per Section IV 2.c. of Appendix G of 10CFR50. Each of the curves, (a), (b) and (c) define temperature limitations for unirradiated ferric steels. Provision has been made for the modification of these curves to account for the change in  $RT_{NDT}$  as a result of neutron embrittlement.

B 3/4.6-26

3688a  
3123A

## INSERT '1'

- B. Pressurization Temperature - The reactor vessel is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, pressure-temperature limits have been established for the operating conditions to which the reactor vessel can be subjected. Figure 3.6.1 presents the pressure-temperature curves for those operating conditions; Inservice Hydrostatic Testing (Curve A), Non-Nuclear Heatup/Cooldown (Curve B), and Core Critical Operation (Curve C). These curves have been established to be in conformance with Appendix G to 10 CFR 50 and Regulatory Guide 1.99, Revision 2, and take into account the change in reference nil-ductility transition temperature ( $RT_{NDT}$ ) as a result of neutron embrittlement. The adjusted reference temperature (ART) of the limiting vessel material is used to account for irradiation effects.

Three vessel regions are considered for the development of the pressure-temperature curves: 1) the core beltline region; 2) the non-beltline region (other than the closure flange region); and 3) the closure flange region. The beltline region is defined as that region of the reactor vessel that directly surrounds the effective height of the reactor core (between the bottom and top of active fuel), and is subject to an  $RT_{NDT}$  adjustment to account for irradiation embrittlement. The non-beltline and closure flange regions receive insufficient fluence to necessitate an  $RT_{NDT}$  adjustment. These regions contain components which include; the reactor vessel nozzles, closure flanges, top and bottom head plates, control rod drive penetrations, and shell plates that do not directly surround the reactor core. Although the closure flange region is a non-beltline region, it (the closure flange region) is treated separately for the development of the pressure-temperature curves to address 10 CFR 50 Appendix G requirements.

In evaluating the adequacy of the steel which comprises the reactor vessel, it is necessary that the following be established: 1) the  $RT_{NDT}$  for all vessel and adjoining materials; 2) the relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies greater than one Mev); and 3) the fluence at the location of a postulated flaw.

### Boltup Temperature

The initial  $RT_{NDT}$  of the main closure flanges, the shell and head materials connecting to these flanges, the connecting welds, and the vertical electroslag welds which terminate immediately below the vessel flange are all 20°F or lower. Therefore, the minimum allowable boltup temperature is established as 80°F ( $RT_{NDT} + 60^\circ\text{F}$ ) which includes a 60°F conservatism required by the original ASME Code of construction.

### Curve A - Hydrotesting

As indicated in Curve A of Figure 3.6.1 for system hydrotesting, the minimum metal temperature of the reactor vessel shell is 80°F for reactor pressures less than 312 psig. This 80°F minimum boltup temperature is based on a  $RT_{NDT}$  of 20°F for the top head plate (most limiting material) and a 60°F conservatism required by the original ASME Code of construction.

At reactor pressures greater than 312 psig the minimum vessel metal temperature is established as 110°F. The 110°F minimum temperature is based on a closure flange region  $RT_{NDT}$  of 20°F and a 90°F conservatism required by 10 CFR 50 Appendix G for pressure in excess of 20% of the preservice hydrostatic test pressure (1563 psig).

At approximately 620 psig reactor pressure the effects of pressurization become more limiting than the boltup stresses at the closure flange region, as shown by the non-linear portion of Curve A intersecting the vertical 110°F line. The non-linear portion of the curve is dependent on the non-beltline region (which is actually more limiting than the beltline region through a vessel exposure of 22 effective full power years), and based on a  $RT_{NDT}$  of 40°F.

### Curve B - Non-Nuclear Heatup/Cooldown

Curve B of Figure 3.6.1 applies during heatups with non-nuclear heat (e.g. recirculation pump heat) and during cooldowns when the reactor is not critical (e.g. following a scram). The curve provides the minimum reactor vessel metal temperatures based on the most limiting vessel stress (non-beltline stresses).

As indicated by the vertical 80°F line, the boltup stresses at the closure flange region are most limiting below approximately 80 psig. Above approximately 80 psig, pressurization and thermal stresses become more limiting than the boltup stresses, which is reflected by the non-linear portion of Curve B. The non-linear portion of the curve is dependent on the non-beltline region (which is actually more limiting than the beltline region through a vessel exposure of 22 effective full power years), and based on a  $RT_{NDT}$  of 40°F.

### Curve C - Core Critical Operation

Curve C, the core critical operation curve shown in Figure 3.6.1, is generated in accordance with 10 CFR 50 Appendix G which requires core critical pressure-temperature limits to be 40°F above any Curve A or B limits. Since Curve B is more limiting, Curve C is Curve B plus 40°F.

3.6 LIMITING CONDITION FOR OPERATION BASES (Cont'd.)

**B. Pressurization Temperature** - The reactor coolant system is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, restrictions have been placed on the operating conditions to which it can be subjected. These restrictions on inservice hydrostatic testing, on heatup and cooldown, and on critical core operation shown in Figure 3.6.1, were established to be in conformance with Appendix G to 10 CFR 50.

In evaluating the adequacy of ferritic steels SA302B it is necessary that the following be established:

- a) The reference nil-ductility temperature ( $RT_{NDT}$ ) for all vessel and adjoining materials,
- b) the relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies greater than one Mev), and
- c) the fluence at the location of a postulated flow.

The initial  $RT_{NDT}$  of the main closure flange, the shell and head materials connecting to these flanges, and connecting welds is 10°F. However, the vertical electroslag welds which terminate immediately below the vessel flange have an  $RT_{NDT}$  of 40°F. (Reference Appendix F to the FSAR) The closure flanges and connecting shell materials are not subject to any appreciable neutron radiation exposure, nor are the vertical electroslag seams. The flange area is moderately stressed by tensioning the head bolts. Therefore, as is indicated in curves (a) and (b) of Figure 3.6.1, the minimum temperature of the vessel shell immediately below the vessel flange is established as 100°F below a pressure of 400 psig. (40°F + 60°F, where 40°F is the  $RT_{NDT}$  of the electroslag weld and 60°F is a conservatism required by the ASME Code). Above approximately 400 psig pressure, the stresses associated with pressurization are more limiting than the bolting stresses, a fact that is reflected in the non-linear portion of curves (a) and (b). Curve (c), which defines the temperature limitations for critical core operation, was established per Section IV 2.2. of Appendix G of 10CFR50. Each of the curves, (a), (b) and (c) define temperature limitations for unirradiated ferric steels. Provision has been made for the modification of these curves to account for the change in  $RT_{NDT}$  as a result of neutron embrittlement.

B 3/4.6-26

## INSERT '2'

- B. Pressurization Temperature - The reactor vessel is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, pressure-temperature limits have been established for the operating conditions to which the reactor vessel can be subjected. Figure 3.6.1 presents the pressure-temperature curves for those operating conditions; Inservice Hydrostatic Testing (Curve A), Non-Nuclear Heatup/Cooldown (Curve B), and Core Critical Operation (Curve C). These curves have been established to be in conformance with Appendix G to 10 CFR 50 and Regulatory Guide 1.99, Revision 2, and take into account the change in reference nil-ductility transition temperature ( $RT_{NDT}$ ) as a result of neutron embrittlement. The adjusted reference temperature (ART) of the limiting vessel material is used to account for irradiation effects.

Three vessel regions are considered for the development of the pressure-temperature curves: 1) the core beltline region; 2) the non-beltline region (other than the closure flange region); and 3) the closure flange region. The beltline region is defined as that region of the reactor vessel that directly surrounds the effective height of the reactor core (between the bottom and top of active fuel), and is subject to an  $RT_{NDT}$  adjustment to account for irradiation embrittlement. The non-beltline and closure flange regions receive insufficient fluence to necessitate an  $RT_{NDT}$  adjustment. These regions contain components which include; the reactor vessel nozzles, closure flanges, top and bottom head plates, control rod drive penetrations, and shell plates that do not directly surround the reactor core. Although the closure flange region is a non-beltline region, it (the closure flange region) is treated separately for the development of the pressure-temperature curves to address 10 CFR 50 Appendix G requirements.

In evaluating the adequacy of the steel which comprises the reactor vessel, it is necessary that the following be established: 1) the  $RT_{NDT}$  for all vessel and adjoining materials; 2) the relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies greater than one Mev); and 3) the fluence at the location of a postulated flaw.

### Boltup Temperature

The initial  $RT_{NDT}$  of the main closure flanges, the shell and head materials connecting to these flanges, and connecting welds is 10°F; however, the vertical electroslag welds which terminate immediately below the vessel flange have an  $RT_{NDT}$  of 40°F. Therefore, the minimum allowable boltup temperature is established as 100°F ( $RT_{NDT} + 60^\circ\text{F}$ ), which includes a 60°F conservatism required by the original ASME Code of construction.

## INSERT '2' (CONTINUED)

### Curve A - Hydrotesting

As indicated in Curve A of Figure 3.6.1 for system hydrotesting, the minimum metal temperature of the reactor vessel shell is 100°F for reactor pressures less than 312 psig. This 100°F minimum boltup temperature is based on a  $RT_{NDT}$  of 40°F for the electroslag weld immediately below the vessel flange and a 60°F conservatism required by the original ASME Code of construction.

At reactor pressures greater than 312 psig the minimum vessel metal temperature is established as 130°F. The 130°F minimum temperature is based on a closure flange region  $RT_{NDT}$  of 40°F and a 90°F conservatism required by 10 CFR 50 Appendix G for pressure in excess of 20% of the preservice hydrostatic test pressure (1563 psig).

At approximately 650 psig the effects of pressurization are more limiting than the boltup stresses at the closure flange region, hence a family of non-linear curves intersect the 130°F vertical line. Beltline as well as non-beltline curves have been provided to allow separate monitoring of the two regions. Beltline curves as a function of vessel exposure for 12, 14 and 16 effective full power years (EFPY) are presented to allow the use of the appropriate curve up to 16 EFPY of operation.

### Curve B - Non-Nuclear Heatup/Cooldown

Curve B of Figure 3.6.1 applies during heatups with non-nuclear heat (e.g., recirculation pump heat) and during cooldowns when the reactor is not critical (e.g., following a scram). The curve provides the minimum reactor vessel metal temperatures based on the most limiting vessel stress.

As indicated by the vertical 100°F line, the boltup stresses at the closure flange region are most limiting for reactor pressures below approximately 110 psig. For reactor pressures greater than approximately 110 psig, pressurization and thermal stresses become more limiting than the boltup stresses, which is reflected by the non-linear portion of Curve B. The non-linear portion of the curve is dependent on non-beltline and beltline regions, with the beltline region temperature limits having been adjusted to account for vessel irradiation (up to a vessel exposure of 16 EFPY). The non-beltline region is limiting between approximately 110 psig and 830 psig. Above approximately 830 psig, the beltline region becomes limiting.

### Curve C - Core Critical Operation

Curve C, the core critical operation curve shown in Figure 3.6.1, is generated in accordance with 10 CFR 50 Appendix G which requires core critical pressure-temperature limits to be 40°F above any Curve A or B limits. Since Curve B is more limiting, Curve C is Curve B plus 40°F.

### 3.6 LIMITING CONDITIONS FOR OPERATION BASES

#### A. Thermal Limitations

The reactor vessel design specification requires that the reactor vessel be designed for a maximum heatup and cooldown rate of the contained fluid (water) of 100°F/hour averaged over a period of 1 hour. This rate has been chosen based on past experience with operating power plants. The associated time periods for heatup and cooldown cycles when the 100°F/hr rate is limiting provides for efficient but safe plant operation.

The reactor vessel manufacturer has designed the vessel to the above temperature criterion. In the course of completing the design, the manufacturer performed a detailed stress analysis. This analysis includes more severe thermal conditions than those which would be encountered during normal heating and cooling operations.

Specific analyses were made based on a heating and cooling rate of 100°F/hr applied continuously over a temperature range of 100°F to 550°F. Because of the slow temperature-time response of the massive flanges relative to the adjacent head and shell sections, calculated temperatures obtained were 500°F (shell) and 360°F (flange) (140°F differential).

Both axial and radial thermal stresses were considered to act concurrently with full primary loadings. Calculated stresses were within ASME Boiler and Pressure Vessel Code Section III stress intensity and fatigue limits even at the flange area where maximum stress occurs.

The flange metal temperature differential of 140°F occurred as a result of sluggish temperature response and the fact that the heating rate continued over a 450°F coolant temperature range.

The uncontrolled cooldown rate of 240°F/hr was based on the maximum expected transient over the lifetime of the reactor vessel. This maximum expected transient is the injection of cold water into the vessel by the high-pressure coolant injection subsystem. This transient was considered in the design of the pressure vessel, and ten such cycles were considered in the design. Detailed stress analyses were conducted to assure that the injection of cold water into the vessel by the HPCI would not exceed ASME stress code limitations.

#### B. Pressurization Temperature

~~The reactor coolant system is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, restrictions have been placed on the operating conditions to which it can be subjected. These restrictions on inservice hydrostatic testing, on heatup and cooldown, and on~~

↖  
**INSERT**  
**'3'**



critical core operation shown in Figure 3.6-1, were established to be in conformance with Appendix G to 10CFR50.

INSERT  
'3' →  
In evaluating the adequacy of ferritic steels Sa302B it is necessary that the following be established:

1. The reference nil-ductility temperature ( $RT_{NDT}$ ) for all vessel and adjoining materials.
2. The relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies  $> \text{Mev}$ ), and
3. The fluence at the location of a postulated flaw.

The initial  $RT_{NDT}$  of the main closure flange, the shell and head materials connecting to these flanges, and connecting welds is  $10^{\circ}\text{F}$ . However, the vertical electroslag welds which terminate immediately below the vessel flange have an  $RT_{NDT}$  of  $40^{\circ}\text{F}$  (Reference Appendix F to the Dresden FSAR). The closure flanges and connecting shell materials are not subject to any appreciable neutron radiation exposure, nor are the vertical electroslag seams. The flange area is moderately stressed by tensioning the head bolts. Therefore, as is indicated in curves (a) and (b) of Figure 3.6-1, the minimum temperature of the vessel shell immediately below the vessel flange is established as  $100^{\circ}\text{F}$  below a pressure of 400 psig. ( $40^{\circ}\text{F} + 60^{\circ}\text{F}$ , where  $40^{\circ}\text{F}$  is the  $RT_{NDT}$  of the electroslag weld and  $60^{\circ}\text{F}$  is a conservatism required by the ASME Code). Above approximately 400 psig pressure, the stresses associated with pressurization are more limiting than the bolting stresses, a fact that is reflected in the non-linear portion of curves (a) and (b). Curve (c), which defines the temperature limitations for critical core operation, was established per Section IV of Appendix G of 10CFR50. Each of the curves, (a), (b) and (c) define temperature limitations for unirradiated ferritic steels. Provision has been made for the modification of these curves to account for the change in  $RT_{NDT}$  as a result of neutron embrittlement.

The withdrawal schedule in Table 4.6-2 is based on the three capsule surveillance program as defined in Section II.C of 10 CFR 50 Appendix H. The accelerated capsule (Near Core Top Guide) are not required by Appendix H but will be tested to provide additional information on the vessel material.

This surveillance program conforms to ASTM E 185-73 "Recommended Practice for Surveillance Tests for Nuclear Reactor Vessels" with one exception. The base metal specimens of the vessel were made with their longitudinal axes parallel to the principle rolling direction of the vessel plate.

## INSERT '3'

### B. Pressurization Temperature

The reactor vessel is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, pressure-temperature limits have been established for the operating conditions to which the reactor vessel can be subjected. Figure 3.6-1 presents the pressure-temperature curves for those operating conditions; Inservice Hydrostatic Testing (Curve A), Non-Nuclear Heatup/Cooldown (Curve B), and Core Critical Operation (Curve C). These curves have been established to be in conformance with Appendix G to 10 CFR 50 and Regulatory Guide 1.99, Revision 2, and take into account the change in reference nil-ductility transition temperature ( $RT_{NDT}$ ) as a result of neutron embrittlement. The adjusted reference temperature (ART) of the limiting vessel material is used to account for irradiation effects.

Three vessel regions are considered for the development of the pressure-temperature curves: 1) the core beltline region; 2) the non-beltline region (other than the closure flange region); and 3) the closure flange region. The beltline region is defined as that region of the reactor vessel that directly surrounds the effective height of the reactor core (between the bottom and top of active fuel), and is subject to an  $RT_{NDT}$  adjustment to account for irradiation embrittlement. The non-beltline and closure flange regions receive insufficient fluence to necessitate an  $RT_{NDT}$  adjustment. These regions contain components which include; the reactor vessel nozzles, closure flanges, top and bottom head plates, control rod drive penetrations, and shell plates that do not directly surround the reactor core. Although the closure flange region is a non-beltline region, it (the closure flange region) is treated separately for the development of the pressure-temperature curves to address 10 CFR 50 Appendix G requirements.

In evaluating the adequacy of the steel which comprises the reactor vessel, it is necessary that the following be established: 1) the  $RT_{NDT}$  for all vessel and adjoining materials; 2) the relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies greater than one Mev); and 3) the fluence at the location of a postulated flaw.

#### Boltup Temperature

The initial  $RT_{NDT}$  of the main closure flanges, the shell and head materials connecting to these flanges, and connecting welds is 10°F; however, the vertical electroslag welds which terminate immediately below the vessel flange have an  $RT_{NDT}$  of 40°F. Therefore, the minimum allowable boltup temperature is established as 100°F ( $RT_{NDT} + 60^\circ\text{F}$ ), which includes a 60°F conservatism required by the original ASME Code of construction.

## INSERT '3' (CONTINUED)

### Curve A - Hydrotesting

As indicated in Curve A of Figure 3.6-1 for system hydrotesting, the minimum metal temperature of the reactor vessel shell is 100°F for reactor pressures less than 312 psig. This 100°F minimum boltup temperature is based on a  $RT_{NDT}$  of 40°F for the electrosag weld immediately below the vessel flange and a 60°F conservatism required by the original ASME Code of construction.

At reactor pressures greater than 312 psig the minimum vessel metal temperature is established as 130°F. The 130°F minimum temperature is based on a closure flange region  $RT_{NDT}$  of 40°F and a 90°F conservatism required by 10 CFR 50 Appendix G for pressure in excess of 20% of the preservice hydrostatic test pressure (1563 psig).

At approximately 650 psig the effects of pressurization are more limiting than the boltup stresses at the closure flange region, hence a family of non-linear curves intersect the 130°F vertical line. Beltline as well as non-beltline curves have been provided to allow separate monitoring of the two regions. Beltline curves as a function of vessel exposure for 12, 14 and 16 effective full power years (EFPY) are presented to allow the use of the appropriate curve up to 16 EFPY of operation.

### Curve B - Non-Nuclear Heatup/Cooldown

Curve B of Figure 3.6-1 applies during heatups with non-nuclear heat (e.g., recirculation pump heat) and during cooldowns when the reactor is not critical (e.g., following a scram). The curve provides the minimum reactor vessel metal temperatures based on the most limiting vessel stress.

As indicated by the vertical 100°F line, the boltup stresses at the closure flange region are most limiting for reactor pressures below approximately 110 psig. For reactor pressures greater than approximately 110 psig, pressurization and thermal stresses become more limiting than the boltup stresses, which is reflected by the non-linear portion of Curve B. The non-linear portion of the curve is dependent on non-beltline and beltline regions, with the beltline region temperature limits having been adjusted to account for vessel irradiation (up to a vessel exposure of 16 EFPY). The non-beltline region is limiting between approximately 110 psig and 830 psig. Above approximately 830 psig, the beltline region becomes limiting.

### Curve C - Core Critical Operation

Curve C, the core critical operation curve shown in Figure 3.6-1, is generated in accordance with 10 CFR 50 Appendix G which requires core critical pressure-temperature limits to be 40°F above any Curve A or B limits. Since Curve B is more limiting, Curve C is Curve B plus 40°F.

**INSERT '3' (CONTINUED)**

The withdrawal schedule in Table 4.6-2 is based on the three capsule surveillance program as defined in Section II.C of 10 CFR 50 Appendix H. The accelerated capsule (Near Core Top Guide) are not required by Appendix H.

This surveillance program conforms to ASTM E 185-73 "Recommended Practice for Surveillance Tests for Nuclear Reactor Vessels" with one exception. The base metal specimens of the vessel were made with their longitudinal axes parallel to the principle rolling direction of the vessel plate.

### 3.6 LIMITING CONDITIONS FOR OPERATION BASES

#### A. Thermal Limitations

The reactor vessel design specification requires that the reactor vessel be designed for a maximum heatup and cooldown rate of the contained fluid (water) of 100° F/hour averaged over a period of 1 hour. This rate has been chosen based on past experience with operating power plants. The associated time periods for heatup and cooldown cycles when the 100° F/hr rate is limiting provides for efficient but safe plant operation.

The reactor vessel manufacturer has designed the vessel to the above temperature criterion. In the course of completing the design, the manufacturer performed a detailed stress analysis. This analysis includes more severe thermal conditions than those which would be encountered during normal heating and cooling operations.

Specific analyses were made based on a heating and cooling rate of 100° F/hr applied continuously over a temperature range of 100° F to 550° F. Because of the slow temperature-time response of the massive flanges relative to the adjacent head and shell sections, calculated temperatures obtained were 500° F (shell) and 360° F (flange) (140° F differential).

Both axial and radial thermal stresses were considered to act concurrently with full primary loadings. Calculated stresses were within ASME Boiler and Pressure Vessel Code Section III stress intensity and fatigue limits even at the flange area where maximum stress occurs.

The flange metal temperature differential of 140° F occurred as a result of sluggish temperature response and the fact that the heating rate continued over a 450° F coolant temperature range.

The uncontrolled cooldown rate of 240° F/hr was based on the maximum expected transient over the lifetime of the reactor vessel. This maximum expected transient is the injection of cold water into the vessel by the high-pressure coolant injection subsystem. This transient was considered in the design of the pressure vessel, and ten such cycles were considered in the design. Detailed stress analyses were conducted to assure that the injection of cold water into the vessel by the HPCI would not exceed ASME stress code limitations.

#### B. Pressurization Temperature

The reactor coolant system is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, restrictions have been placed on the operating conditions to which it can be subjected. These restrictions on inservice hydrostatic testing, on heatup and cooldown, and on critical core operation, shown in Figure 3.6.1, were established to be in conformance with Appendix G to 10CFR50.

In evaluating the adequacy of ferritic steels Sa302B it is necessary that the following be established:

↑  
INSERT  
'4'

1. The reference nil-ductility temperature ( $RT_{NDT}$ ) for all vessel and adjoining materials.
2. The relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies  $>1$  Mev), and
3. The fluence at the location of a postulated flaw.

The initial  $RT_{NDT}$  of the main closure flange, the shell and head materials connecting to these flanges, and connecting welds is  $10^{\circ}F$ . However, the vertical electroslag welds which terminate immediately below the vessel flange have an  $RT_{NDT}$  of  $40^{\circ}F$ . Reference Appendix F to the Dresden FSAR. The closure flanges and connecting shell materials are not subject to any appreciable neutron radiation exposure, nor are the vertical electroslag seams. The flange area is moderately stressed by tensioning the head bolts. Therefore, as is indicated in curves (a) and (b) of Figure 3.6.1, the minimum temperature of the vessel shell immediately below the vessel flange is established as  $100^{\circ}F$  below a pressure of 400 psig. ( $40^{\circ}F + 60^{\circ}F$ , where  $40^{\circ}F$  is the  $RT_{NDT}$  of the electroslag weld and  $60^{\circ}F$  is a conservatism required by the ASME Code). Above approximately 400 psig pressure, the stresses associated with pressurization are more limiting than the bolting stresses, a fact that is reflected in the non-linear portion of curves (a) and (b). Curve (c), which defines the temperature limitations for critical core operation, was established per Section IV 2.4 of Appendix G of 10CFR50. Each of the curves, (a), (b) and (c) define temperature limitations for unirradiated ferritic steels. Provision has been made for the modification of these curves to account for the change in  $RT_{NDT}$  as a result of neutron embrittlement.

The withdrawal schedule in Table 4.6.2 is based on the three capsule surveillance program as defined in Section 11.C.3.a of 10 CFR 50 Appendix H. The accelerated capsule (Near Core Top Guide) are not required by Appendix H but will be tested to provide additional information on the vessel material.

This surveillance program conforms to ASTM E 185-73 "Recommended Practice for Surveillance Tests for Nuclear Reactor Vessels" with one exception. The base metal specimens of the vessel were made with their longitudinal axes parallel to the principle rolling direction of the vessel plate.

INSERT

'4' →

## B. Pressurization Temperature

The reactor vessel is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, pressure-temperature limits have been established for the operating conditions to which the reactor vessel can be subjected. Figure 3.6-1 presents the pressure-temperature curves for those operating conditions; Inservice Hydrostatic Testing (Curve A), Non-Nuclear Heatup/Cooldown (Curve B), and Core Critical Operation (Curve C). These curves have been established to be in conformance with Appendix G to 10 CFR 50 and Regulatory Guide 1.99, Revision 2, and take into account the change in reference nil-ductility transition temperature ( $RT_{NDT}$ ) as a result of neutron embrittlement. The adjusted reference temperature (ART) of the limiting vessel material is used to account for irradiation effects.

Three vessel regions are considered for the development of the pressure-temperature curves: 1) the core beltline region; 2) the non-beltline region (other than the closure flange region); and 3) the closure flange region. The beltline region is defined as that region of the reactor vessel that directly surrounds the effective height of the reactor core (between the bottom and top of active fuel), and is subject to an  $RT_{NDT}$  adjustment to account for irradiation embrittlement. The non-beltline and closure flange regions receive insufficient fluence to necessitate an  $RT_{NDT}$  adjustment. These regions contain components which include; the reactor vessel nozzles, closure flanges, top and bottom head plates, control rod drive penetrations, and shell plates that do not directly surround the reactor core. Although the closure flange region is a non-beltline region, it (the closure flange region) is treated separately for the development of the pressure-temperature curves to address 10 CFR 50 Appendix G requirements.

In evaluating the adequacy of the steel which comprises the reactor vessel, it is necessary that the following be established: 1) the  $RT_{NDT}$  for all vessel and adjoining materials; 2) the relationship between  $RT_{NDT}$  and integrated neutron flux (fluence, at energies greater than one Mev); and 3) the fluence at the location of a postulated flaw.

### Boltup Temperature

The initial  $RT_{NDT}$  of the main closure flanges, the shell and head materials connecting to these flanges, and connecting welds is 10°F; however, the vertical electroslag welds which terminate immediately below the vessel flange have an  $RT_{NDT}$  of 40°F. Therefore, the minimum allowable boltup temperature is established as 100°F ( $RT_{NDT} + 60^\circ\text{F}$ ), which includes a 60°F conservatism required by the original ASME Code of construction.

## INSERT '4' (CONTINUED)

### Curve A - Hydrotesting

As indicated in Curve A of Figure 3.6-1 for system hydrotesting, the minimum metal temperature of the reactor vessel shell is 100°F for reactor pressures less than 312 psig. This 100°F minimum boltup temperature is based on a  $RT_{NDT}$  of 40°F for the electroslag weld immediately below the vessel flange and a 60°F conservatism required by the original ASME Code of construction.

At reactor pressures greater than 312 psig the minimum vessel metal temperature is established as 130°F. The 130°F minimum temperature is based on a closure flange region  $RT_{NDT}$  of 40°F and a 90°F conservatism required by 10 CFR 50 Appendix G for pressure in excess of 20% of the preservice hydrostatic test pressure (1563 psig).

At approximately 650 psig the effects of pressurization are more limiting than the boltup stresses at the closure flange region, hence a family of non-linear curves intersect the 130°F vertical line. Beltline as well as non-beltline curves have been provided to allow separate monitoring of the two regions. Beltline curves as a function of vessel exposure for 12, 14 and 16 effective full power years (EFPY) are presented to allow the use of the appropriate curve up to 16 EFPY of operation.

### Curve B - Non-Nuclear Heatup/Cooldown

Curve B of Figure 3.6-1 applies during heatups with non-nuclear heat (e.g., recirculation pump heat) and during cooldowns when the reactor is not critical (e.g., following a scram). The curve provides the minimum reactor vessel metal temperatures based on the most limiting vessel stress.

As indicated by the vertical 100°F line, the boltup stresses at the closure flange region are most limiting for reactor pressures below approximately 110 psig. For reactor pressures greater than approximately 110 psig, pressurization and thermal stresses become more limiting than the boltup stresses, which is reflected by the non-linear portion of Curve B. The non-linear portion of the curve is dependent on non-beltline and beltline regions, with the beltline region temperature limits having been adjusted to account for vessel irradiation (up to a vessel exposure of 16 EFPY). The non-beltline region is limiting between approximately 110 psig and 830 psig. Above approximately 830 psig, the beltline region becomes limiting.

### Curve C - Core Critical Operation

Curve C, the core critical operation curve shown in Figure 3.6-1, is generated in accordance with 10 CFR 50 Appendix G which requires core critical pressure-temperature limits to be 40°F above any Curve A or B limits. Since Curve B is more limiting, Curve C is Curve B plus 40°F.



INSERT '4' (CONTINUED)

The withdrawal schedule in Table 4.6-2 is based on the three capsule surveillance program as defined in Section II.C of 10 CFR 50 Appendix H. The accelerated capsule (Near Core Top Guide) are not required by Appendix H.

This surveillance program conforms to ASTM E 185-73 "Recommended Practice for Surveillance Tests for Nuclear Reactor Vessels" with one exception. The base metal specimens of the vessel were made with their longitudinal axes parallel to the principle rolling direction of the vessel plate.

**ATTACHMENT C**

**FIGURE 3.6.1**

**FOR**

**DRESDEN UNITS 2 AND 3**

MINIMUM REACTOR VESSEL METAL TEMPERATURES (°F)

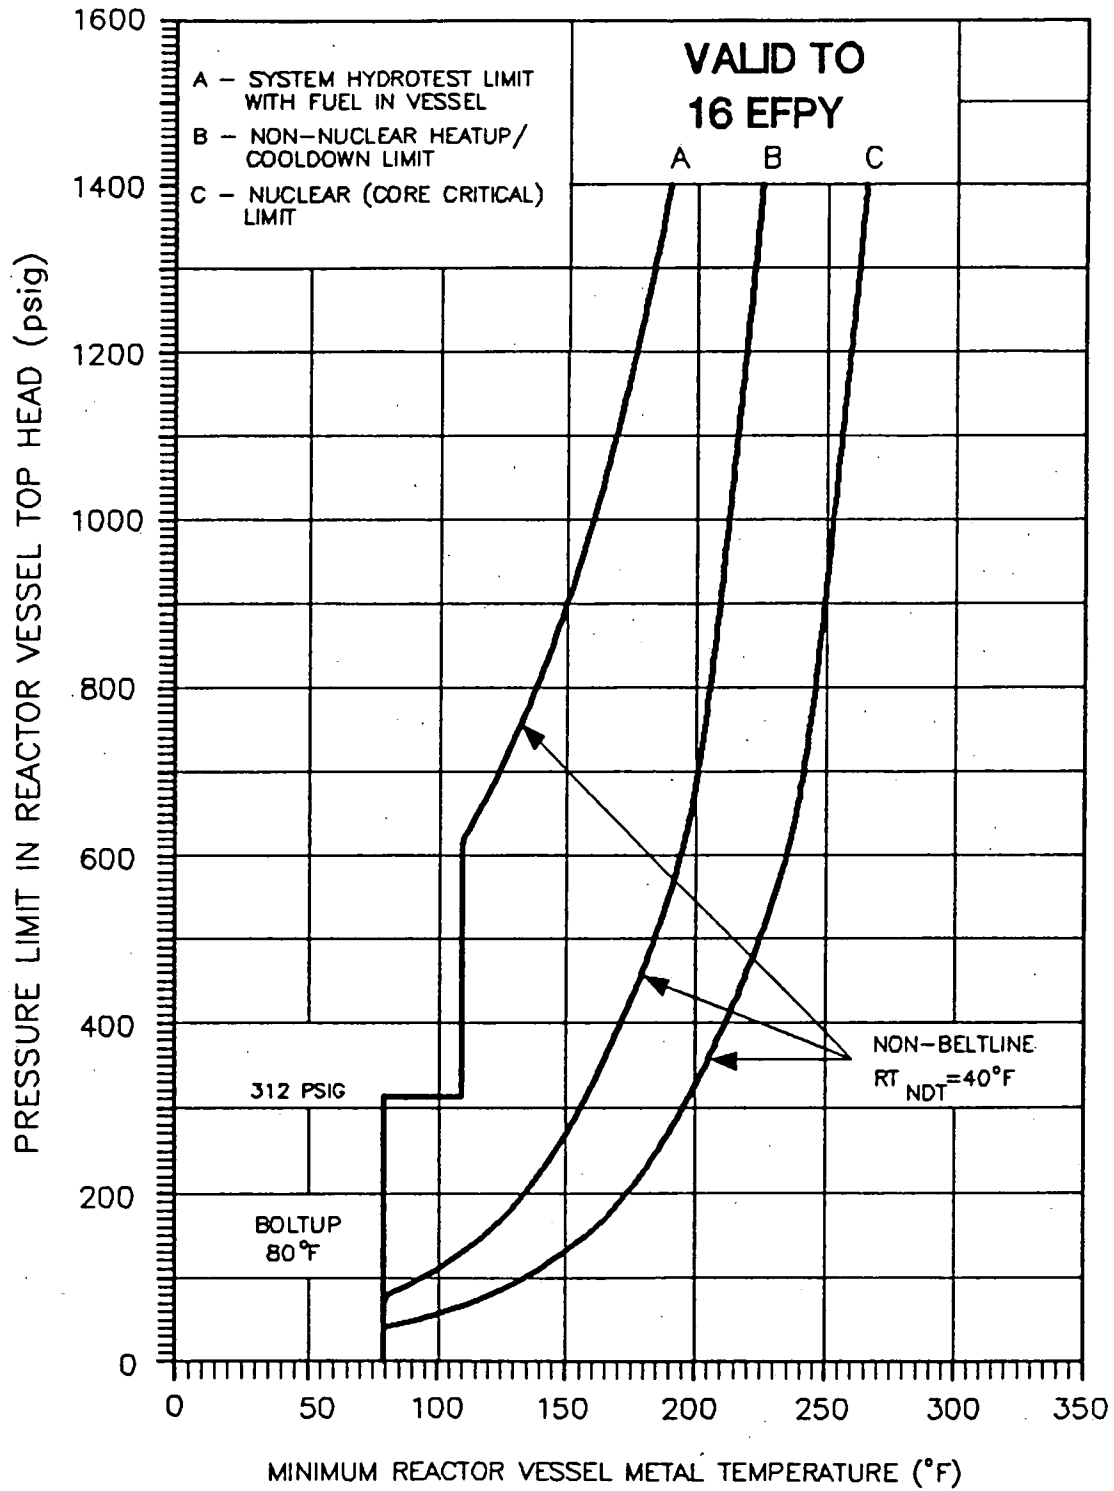


FIGURE 3.6.1

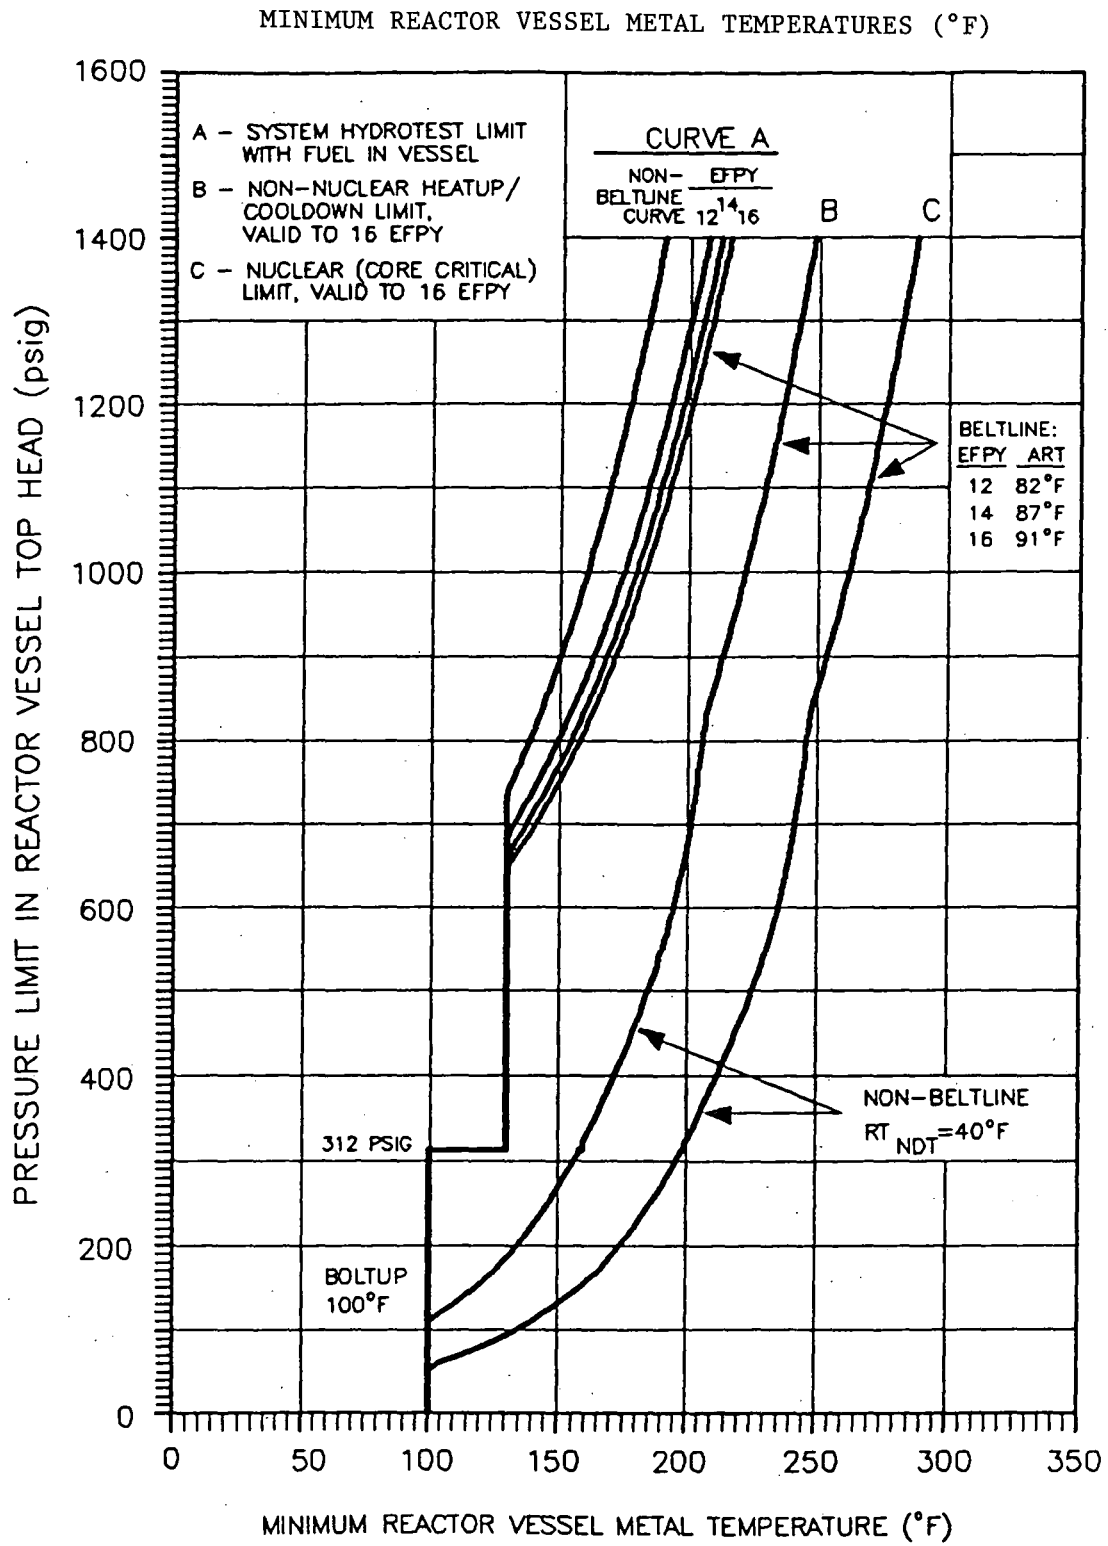


FIGURE 3.6.1

**ATTACHMENT D**

**FIGURE 3.6-1**

**FOR**

**QUAD CITIES UNITS 1 AND 2**

QUAD CITIES

DPR-29

PRESSURE LIMIT AS A FUNCTION OF VESSEL METAL TEMPERATURE

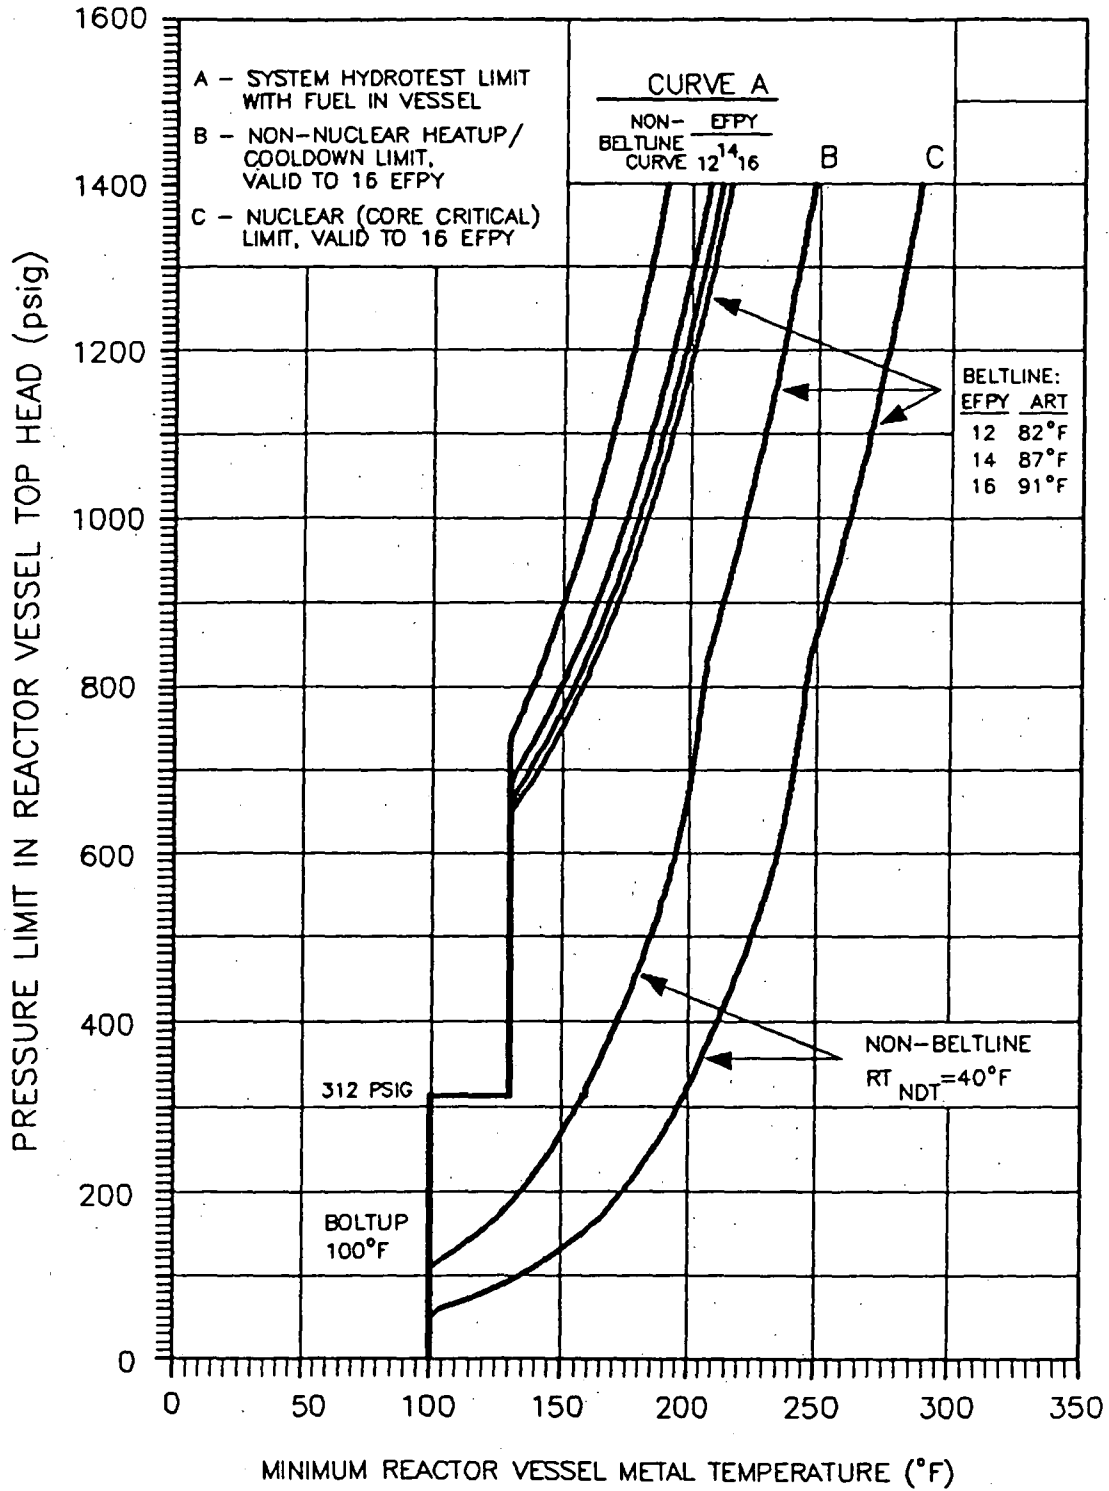


FIGURE 3.6-1

QUAD CITIES

DPR-30

PRESSURE LIMIT AS A FUNCTION OF VESSEL METAL TEMPERATURE

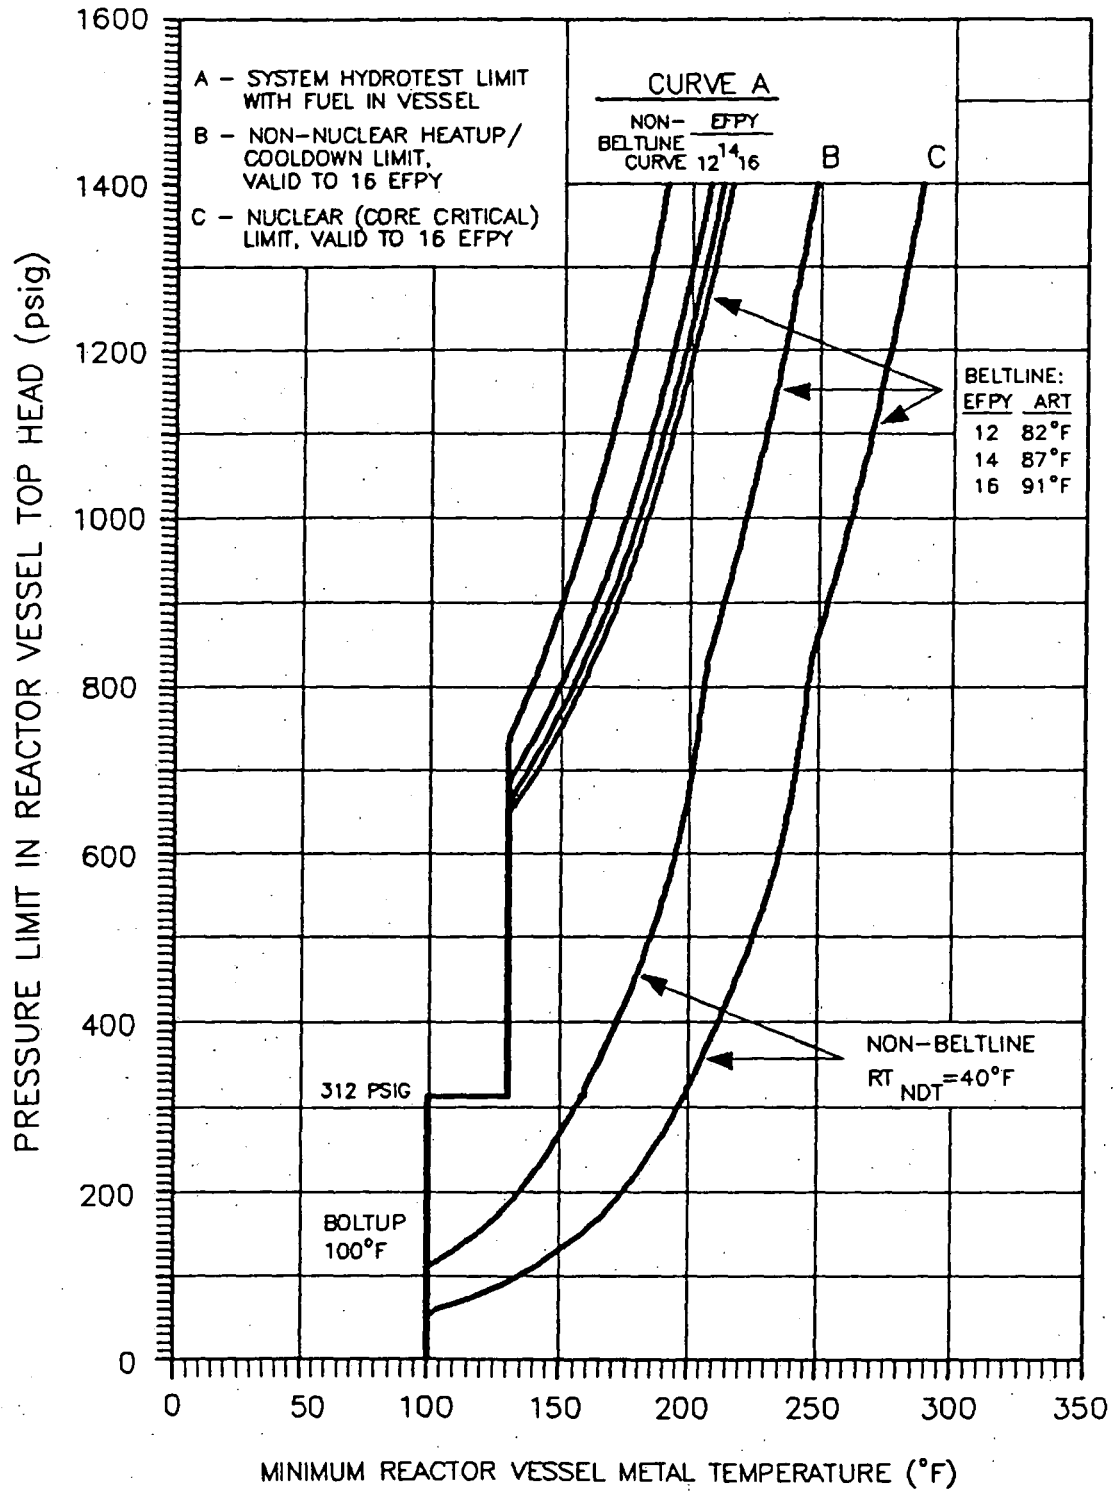


FIGURE 3.6-1