

ATTACHMENT A

Marked-Up Pages

9502010241 950127  
PDR ADDCK 05000237  
P PDR

3.0 LIMITING CONDITION FOR OPERATION  
(Cont'd.)

hot shutdown within  
12 hours, and in at least  
cold shutdown within the  
following 24 hours.

- C. Specifications 3.0.A and  
3.0.B are not applicable in  
refueling or cold shutdown.



INSERT 'A'

INSERT A

D. Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:

1. Inservice Inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, Section 50.55a(g) and 50.55a(f), respectively, except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i) or 50.55a(f)(6)(i), respectively.
2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice <u>inspection and testing activities</u>	Required Frequencies for performing inservice inspection <u>and testing activities</u>
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

3. The provisions of Specification 1.0.CC.a are applicable to the above required frequencies for performing inservice inspection and testing activities.
4. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.
6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.

3.0 LIMITING CONDITION FOR OPERATION BASES

- 3.0.A. This specification delineates the action to be taken for circumstances not directly provided for in the Limiting Condition for Operation statements and whose occurrence would violate the intent of the specification.
- 3.0.B. This specification delineates what additional conditions must be satisfied to permit operation to continue, consistent with the Limiting Condition for Operation statements for power sources, when a normal or emergency power source is not operable. Power sources are defined as AC Auxiliary Electrical Systems as defined in Section 3.9.A.1, 3.9.A.2, and 3.9.A.3. It specifically prohibits operation when one division is inoperable because its normal or emergency power source is inoperable and a system, subsystem, train, component or device in another division is inoperable for another reason.

The provisions of this specification permit the Limiting Condition for Operation Statements associated with individual systems, subsystems, trains, components or devices to be consistent with the Limiting Condition for Operation statements of the associated electrical power source. It allows operation to be governed by the time limits of action statements associated with the Limiting Condition for Operation for the normal or emergency power source, not the individual action statements for each system, subsystem, train, component, or device that is determined to be inoperable solely because of the inoperability of its normal or emergency power source.



INSERT 'B'

## INSERT B

3.0.C N/A

3.0.D Specification 3.0.D establishes the requirement that inservice inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with a periodically updated version of Section XI of the ASME Boiler and Pressure Vessel Code and Addenda as required by 10 CFR 50.55a. These requirements apply except when relief has been provided in writing by the Commission.

This specification includes a clarification of the frequencies for performing the inservice inspection and testing activities required by Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda. This clarification is provided to ensure consistency in surveillance intervals throughout the Technical Specifications and to remove any ambiguities relative to the frequencies for performing the required inservice inspection and testing activities.

Under the terms of this specification, the more restrictive requirements of the Technical Specifications take precedence over the ASME Boiler and Pressure Vessel Code and applicable Addenda.

3.0 LIMITING CONDITION FOR OPERATION  
(Cont'd.)

hot shutdown within  
12 hours, and in at least  
cold shutdown within the  
following 24 hours.

- C. Specifications 3.0.A and  
3.0.B are not applicable in  
refueling or cold shutdown.



INSERT 'A'

INSERT A

D. Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:

1. Inservice Inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, Section 50.55a(g) and 50.55a(f), respectively, except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i) or 50.55a(f)(6)(i), respectively.
2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:


ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice <u>inspection and testing activities</u>	Required Frequencies for performing inservice inspection <u>and testing activities</u>
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

3. The provisions of Specification 1.0.CC.a are applicable to the above required frequencies for performing inservice inspection and testing activities.
4. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.
6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.

3.0 LIMITING CONDITION FOR OPERATION BASES

- 3.0.A. This specification delineates the action to be taken for circumstances not directly provided for in the Limiting Condition for Operation statements and whose occurrence would violate the intent of the specification.
- 3.0.B. This specification delineates what additional conditions must be satisfied to permit operation to continue, consistent with the Limiting Condition for Operation statements for power sources, when a normal or emergency power source is not operable. Power sources are defined as AC Auxiliary Electrical Systems as defined in Section 3.9.A.1, 3.9.A.2, and 3.9.A.3. It specifically prohibits operation when one division is inoperable because its normal or emergency power source is inoperable and a system, subsystem, train, component or device in another division is inoperable for another reason.

The provisions of this specification permit the Limiting Condition for Operation Statements associated with individual systems, subsystems, trains, components or devices to be consistent with the Limiting Condition for Operation statements of the associated electrical power source. It allows operation to be governed by the time limits of action statements associated with the Limiting Condition for Operation for the normal or emergency power source, not the individual action statements for each system, subsystem, train, component, or device that is determined to be inoperable solely because of the inoperability of its normal or emergency power source.

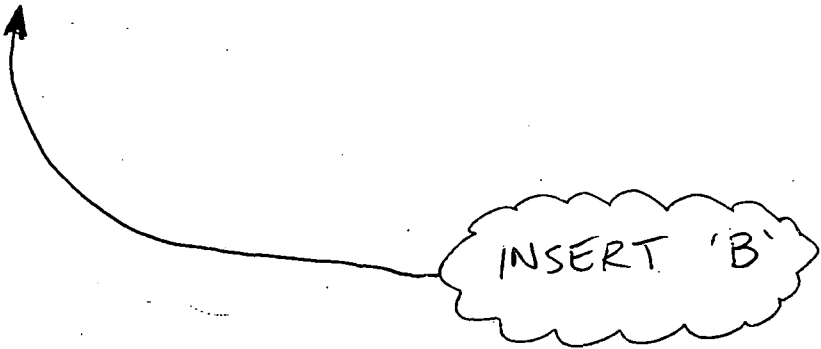



## INSERT B

3.0.C N/A

3.0.D Specification 3.0.D establishes the requirement that inservice inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with a periodically updated version of Section XI of the ASME Boiler and Pressure Vessel Code and Addenda as required by 10 CFR 50.55a. These requirements apply except when relief has been provided in writing by the Commission.

This specification includes a clarification of the frequencies for performing the inservice inspection and testing activities required by Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda. This clarification is provided to ensure consistency in surveillance intervals throughout the Technical Specifications and to remove any ambiguities relative to the frequencies for performing the required inservice inspection and testing activities.

Under the terms of this specification, the more restrictive requirements of the Technical Specifications take precedence over the ASME Boiler and Pressure Vessel Code and applicable Addenda.

ATTACHMENT B

Revised Technical Specification Pages

3.0 LIMITING CONDITION FOR OPERATION  
(cont'd).

hot shutdown within 12 hours, and in at least cold shutdown within the following 24 hours.

- C. Specifications 3.0.A and 3.0.B are not applicable in refueling or cold shutdown.
- D. Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:
1. Inservice Inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, Section 50.55a(g) and 50.55a(f), respectively, except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i) or 50.55a(f)(6)(i), respectively.
  2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

3.0 LIMITING CONDITION FOR OPERATION (cont'd).

<u>ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice inspection and testing activities</u>	<u>Required Frequencies for performing inservice inspection and testing activities</u>
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

3. The provisions of Specification 1.0.CC.a are applicable to the above required frequencies for performing inservice inspection and testing activities.
4. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.
6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.

3.0 LIMITING CONDITION FOR OPERATION BASES

3.0.A. This specification delineates the action to be taken for circumstances not directly provided for in the Limiting Condition for Operation statements and whose occurrence would violate the intent of the specification.

3.0.B. This specification delineates what additional conditions must be satisfied to permit operation to continue, consistent with the Limiting Condition for Operation statements for power sources, when a normal or emergency power source is not operable. Power sources are defined as AC Auxiliary Electrical Systems as defined in Section 3.9.A.1, 3.9.A.2, and 3.9.A.3. It specifically prohibits operation when one division is inoperable because its normal or emergency power source is inoperable and a system, subsystem, train, component or device in another division is inoperable for another reason.

The provisions of this specification permit the Limiting Condition for Operation Statements associated with individual systems, subsystems, trains, components or devices to be consistent with the Limiting Condition for Operation statements of the associated electrical power source. It allows operation to be governed by the time limits of action statements associated with the Limiting Condition for Operation for the normal or emergency power source, not the individual action statements for each system, subsystem, train, component, or device that is determined to be inoperable solely because of the inoperability of its normal or emergency power source.

3.0.C N/A

3.0.D Specification 3.0.D establishes the requirement that inservice inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with a periodically updated version of Section XI of the ASME Boiler and Pressure Vessel Code and Addenda as required by 10 CFR 50.55a. These requirements apply except when relief has been provided in writing by the Commission.

This specification includes a clarification of the frequencies for performing the inservice inspection and testing activities required by Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda. This clarification is provided to ensure consistency in surveillance intervals throughout the Technical Specifications and to remove any ambiguities relative to the frequencies for performing the required inservice inspection and testing activities.

Under the terms of this specification, the more restrictive requirements of the Technical Specifications take precedence over the ASME Boiler and Pressure Vessel Code and applicable Addenda.

3.0 LIMITING CONDITION FOR OPERATION  
(cont'd).

hot shutdown within 12 hours, and in at least cold shutdown within the following 24 hours.

- C. Specifications 3.0.A and 3.0.B are not applicable in refueling or cold shutdown.
- D. Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:
  - 1. Inservice Inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, Section 50.55a(g) and 50.55a(f), respectively, except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i) or 50.55a(f)(6)(i), respectively
  - 2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

3.0 LIMITING CONDITION FOR OPERATION (cont'd).

<u>ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice inspection and testing activities</u>	<u>Required Frequencies for performing inservice inspection and testing activities</u>
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

3. The provisions of Specification 1.0.CC.a are applicable to the above required frequencies for performing inservice inspection and testing activities.
4. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.
6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.

3.0 LIMITING CONDITION FOR OPERATION BASES

3.0.A. This specification delineates the action to be taken for circumstances not directly provided for in the Limiting Condition for Operation statements and whose occurrence would violate the intent of the specification.

3.0.B. This specification delineates what additional conditions must be satisfied to permit operation to continue, consistent with the Limiting Condition for Operation statements for power sources, when a normal or emergency power source is not operable. Power sources are defined as AC Auxiliary Electrical Systems as defined in Section 3.9.A.1, 3.9.A.2, and 3.9.A.3. It specifically prohibits operation when one division is inoperable because its normal or emergency power source is inoperable and a system, subsystem, train, component or device in another division is inoperable for another reason.

The provisions of this specification permit the Limiting Condition for Operation Statements associated with individual systems, subsystems, trains, components or devices to be consistent with the Limiting Condition for Operation statements of the associated electrical power source. It allows operation to be governed by the time limits of action statements associated with the Limiting Condition for Operation for the normal or emergency power source, not the individual action statements for each system, subsystem, train, component, or device that is determined to be inoperable solely because of the inoperability of its normal or emergency power source.

3.0.C N/A

3.0.D Specification 3.0.D establishes the requirement that inservice inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with a periodically updated version of Section XI of the ASME Boiler and Pressure Vessel Code and Addenda as required by 10 CFR 50.55a. These requirements apply except when relief has been provided in writing by the Commission.

This specification includes a clarification of the frequencies for performing the inservice inspection and testing activities required by Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda. This clarification is provided to ensure consistency in surveillance intervals throughout the Technical Specifications and to remove any ambiguities relative to the frequencies for performing the required inservice inspection and testing activities.

Under the terms of this specification, the more restrictive requirements of the Technical Specifications take precedence over the ASME Boiler and Pressure Vessel Code and applicable Addenda.



ATTACHMENT C

Supplemental Technical Specification Upgrade Program  
Marked Up and Revised Pages

**4.0 - SURVEILLANCE REQUIREMENTS**

---

- A. Surveillance Requirements shall be met during the reactor OPERATIONAL MODE(s) or other conditions specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement.
- B. Each Surveillance Requirement shall be performed within the specified surveillance interval with a maximum allowable extension not to exceed 25 percent of the surveillance interval.
- C. Failure to perform a Surveillance Requirement within the allowed surveillance interval, defined by Specification 4.0.B, shall constitute noncompliance with the OPERABILITY requirements for a Limiting Condition for Operation. The time limits of the ACTION requirements are applicable at the time it is identified that a Surveillance Requirement has not been performed. The ACTION requirements may be delayed for up to 24 hours to permit the completion of the surveillance when the allowable outage time limits of the ACTION requirements are less than 24 hours. Surveillance requirements do not have to be performed on inoperable equipment.
- D. Entry into an OPERATIONAL MODE or other specified applicable condition shall not be made unless the Surveillance Requirement(s) associated with the Limiting Condition for Operation have been performed within the applicable surveillance interval or as otherwise specified. This provision shall not prevent passage through or to OPERATIONAL MODE(s) as required to comply with ACTION requirements.
- E. Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:
  - 1. Inservice Inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, Section 50.55a(g),<sup>^</sup> except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i).

or 50.55a(f)(6)(i), respectively

and 50.55a(f), respectively

**4.0 - SURVEILLANCE REQUIREMENTS**

2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice inspection and testing activities	Required Frequencies for performing inservice inspection and testing activities
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days

3. The provisions of Specification 4.0.B are applicable to the above required frequencies for performing inservice inspection and testing activities.
4. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.
6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.

Biennially or every 2 years

At least once per 731 days

#### 4.0 - SURVEILLANCE REQUIREMENTS

---

- A. Surveillance Requirements shall be met during the reactor OPERATIONAL MODE(s) or other conditions specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement.
- B. Each Surveillance Requirement shall be performed within the specified surveillance interval with a maximum allowable extension not to exceed 25 percent of the surveillance interval.
- C. Failure to perform a Surveillance Requirement within the allowed surveillance interval, defined by Specification 4.0.B, shall constitute noncompliance with the OPERABILITY requirements for a Limiting Condition for Operation. The time limits of the ACTION requirements are applicable at the time it is identified that a Surveillance Requirement has not been performed. The ACTION requirements may be delayed for up to 24 hours to permit the completion of the surveillance when the allowable outage time limits of the ACTION requirements are less than 24 hours. Surveillance requirements do not have to be performed on inoperable equipment.
- D. Entry into an OPERATIONAL MODE or other specified applicable condition shall not be made unless the Surveillance Requirement(s) associated with the Limiting Condition for Operation have been performed within the applicable surveillance interval or as otherwise specified. This provision shall not prevent passage through or to OPERATIONAL MODE(s) as required to comply with ACTION requirements.
- E. Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:
  - 1. Inservice Inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, Section 50.55a(g) and 50.55a(f), respectively, except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i) or 50.55a(f)(6)(i), respectively.

4.0 - SURVEILLANCE REQUIREMENTS

---

2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

<u>ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice inspection and testing activities</u>	<u>Required Frequencies for performing inservice inspection and testing activities</u>
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

3. The provisions of Specification 4.0.B are applicable to the above required frequencies for performing inservice inspection and testing activities.
4. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.
6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.